



Enhancing our communities



24 Alfred Street Development

FUNCTIONAL SERVICING REPORT

Pheasant Run Realty Holdings Inc.

Document Control

File:

121108

Date:

May 27,
2022

Prepared by:

Tatham Engineering Limited

115 Sandford Fleming Drive, Suite 200
Collingwood, Ontario L9Y 5A6

T 705-444-2565
tathameng.com

Prepared for:

Pheasant Run Realty Holdings Inc.

10 Keith Avenue, Unit 101
Collingwood, Ontario L9Y 0W5

Authored by:	Reviewed by:
	
Kyle Gowanlock B.A.Sc. Intern Engineer	Doris Casullo P.Eng. Senior Project Manager

Disclaimer	Copyright
The information contained in this document is solely for the use of the Client identified on the cover sheet for the purpose for which it has been prepared and Tatham Engineering Limited undertakes no duty to or accepts any responsibility to any third party who may rely upon this document.	This document may not be used for any purpose other than that provided in the contract between the Owner/Client and the Engineer nor may any section or element of this document be removed, reproduced, electronically stored or transmitted in any form without the express written consent of Tatham Engineering Limited.

Issue	Date	Description
1	February 14, 2022	Draft Plan of Submission Application
2	May 27, 2022	Incorporating DRC Comments

Document Contents

1	Introduction	1
1.1	Objective	1
1.2	Supporting Reports	1
2	Development Site	2
2.1	Site Location & Description	2
2.2	Surface Conditions	2
2.3	Subsurface Conditions	2
2.4	Proposed Development	3
3	Water Supply & Distribution	4
3.1	Existing Infrastructure	4
3.2	Water Demands Assessment	4
3.3	Proposed Infrastructure	5
4	Sanitary Sewage Collection & Conveyance	8
4.1	Existing Infrastructure	8
4.2	Sewage Assessment	8
4.3	Proposed Infrastructure	9
5	Stormwater Management	11
6	Transportation	12
7	Utilities	13
7.1	Electrical Services	13
7.2	Gas Services	13
7.3	Telephone & Internet Services	13
7.4	Postal Services and Delivery	13
8	Summary	14



Tables

Table 1: Water Supply Design Criteria	4
Table 2: Proposed Fire Hydrant Flow Rates.....	6

Appendices

Appendix A: Sanitary Design Sheets
Appendix B: Water Supply Calculations

Drawings

SG01: Site Grading Plan
SS01: Site Servicing Plan
DP01: Pre-Development Drainage Plan
DP02: Post-Development Drainage Plan
Turning Analysis



1 Introduction

Tatham Engineering has been retained by Pheasant Run Realty Holdings Inc. to prepare a Functional Servicing Report to support a Draft Plan of Submission Application (or Approval) for the proposed 24 Alfred Street Development in the Thornbury, Town of The Blue Mountains.

1.1 OBJECTIVE

The primary objective of this report is to address the servicing requirements of the Town of the Blue Mountains and Grey County with respect to the existing and proposed sanitary servicing, water supply and distribution, drainage and stormwater management (SWM), safe vehicular access to the site and utilities common to support a residential development (phone, hydro, cable, TV, gas, etc.).

1.2 SUPPORTING REPORTS

This report was prepared recognizing municipal and provincial guidelines on water resources and the environment, including the following publications:

- *Design Guidelines for Drinking Water Systems, Ministry of Environment (2008);*
- *Design Guidelines for Sewage Works, Ministry of Environment (2008);*
- *The Blue Mountains Engineering Standards (2018);*
- *The Town of The Blue Mountains Year End Water and Wastewater Capacity Assessment (2020)*
- *Town of the Blue Mountains Water & Wastewater Capacity Assessment (2020); and,*
- *Water Supply for Public Fire Protection, Fire Underwriters Survey (2020);*

Additional reports have been prepared in conjunction with this report in support of the proposed residential development, including:

- *24 Alfred Street Development Stormwater Management Report* prepared by Tatham Engineering (May, 2022); and
- *24 Alfred Street Development Traffic Impact Brief* prepared by Tatham Engineering (May, 2022).



2 Development Site

2.1 SITE LOCATION & DESCRIPTION

The site is legally described as Town Plot Park Part Lots 5 and N/E Alfred Street Plan 107 Part Lot 6, and is bounded by Alice Street West to the north, Bruce Street South to the east, Alfred Street West to the south and Elma Street South to the west. The subject property is zoned as R1-1 – *Residential One* and is not regulated by the Grey Sauble Conservation Authority (GSCA).

2.2 SURFACE CONDITIONS

A topographic survey of the subject property was completed by GM Blueplan Engineering Ltd. on June 5, 2018 and December 5, 2011. The high spot of the subject site (199.29m) is 126 m south-west of Alice Street West. The subject property generally slopes from the south-west to the north-east at an average gradient of 2.4% to a low point at the rear of 21 Alice Street West, where water ponds and infiltrates into the ground. 21 Alice Street slopes toward the rear yard low point at an average gradient of 0.5%. The remainder of the subject property generally slopes from the high point towards the west at an average gradient of 0.7%, ultimately discharging to the Elma Street storm system. Refer to the Pre-Development Drainage Plan (DP01) for details on existing drainage areas.

While adjacent to numerous residential units on all property lines, the 1.09 ha site is currently vacant, and is primarily grass covered with a sparse number of trees.

2.3 SUBSURFACE CONDITIONS

A geotechnical investigation, submitted under separate cover, was completed by Cambium Inc. dated November 19, 2021. Fieldwork was conducted on August 27, 2021, consisting of four exploratory sampled boreholes. The boreholes extended to a maximum depth of 5 meters below existing ground surface. Subsurface conditions are as follows:

- 100 mm of surficial topsoil;
- silty sand deposit with traces of clay extends to a depth of 0.8 m below surface at boreholes BH102-21 and BH103-21 (this layer extends 1.5 m below surface at boreholes BH101-21 and BH104-21); and
- a layer of silt extends beyond the termination depth of all boreholes ranging from 4.6 m to 6.1 m below grade.; the silt contains varying amounts of clay and trace sand and has a stiff to very hard consistency.



The geotechnical investigation established that all four borehole locations were dry upon drilling. Borehole BH102-21 was outfitted as a monitoring well and recorded a groundwater level 4 m below grade.

The soil has been classified as Brighton sand (Type A), as per the *Soil Survey of Grey County - Report No. 17 of the Ontario Soil Survey*, completed by the Ontario Department of Agriculture. This soil group has low runoff potential and high infiltration rates even when thoroughly wetted.

2.4 PROPOSED DEVELOPMENT

The proposed development will feature 9 single family detached homes and 8 semi-detached units fronting a 249 m long 7.5 m private road within a common element row, connecting Alice Street West and Alfred Street West, between Elma Street South and Bruce Street South. Lots will have approximately 20 m frontages and varying depths around 30 m to 34 m. The proposed development is shown on the Site Grading Plan (SG01).

The existing municipal infrastructure along Alice Street, including the storm, sanitary and watermain networks are being replaced as part of the Thornbury Road Infrastructure Project and is scheduled to start in 2023. The proposed sanitary and storm sewers servicing the proposed through-street will discharge into the future Alice Street West sanitary and storm sewer mains, while the proposed watermain will tap into both the Alice Street West and Alfred Street West watermains to create a loop.



3 Water Supply & Distribution

3.1 EXISTING INFRASTRUCTURE

The subject site is adjacent to an existing 150 mm watermain running east-west on the north side of Alfred Street West and Alice Street West, across from the proposed 24 Alfred Street Development.

The Town of The Blue Mountains Water Treatment Plant has a water supply capacity of 16,390 m³/day (including the 1,250 m³/day received from the Town of Collingwood), as per *The Town of The Blue Mountains 2020 Year End Water and Wastewater Capacity Assessment*. The report indicates that 2,345 m³/day is available (86% of rated capacity).

3.2 WATER DEMANDS ASSESSMENT

3.2.1 Water Supply Demands

Water supply demands for the proposed development have been calculated based on the Ministry of the Environment Conservation and Parks (MECP) guidelines and the Town of The Blue Mountains (TOBM) design standards as noted below:

Table 1: Water Supply Design Criteria

DESIGN CRITERIA		SOURCE
Residential Population	2.30 persons/unit	TOBM
Average Daily Demand Per Person	450 L/person/day	TOBM
Maximum Daily Demand Factor	9.2	MECP
Peak Hourly Demand Factor	13.8	MECP
Minimum Fire Flow	133 L/s	FUS
Allowable Pressure Ranges		
Maximum Day Minimum Pressure	350 kPa (50 psi)	TOBM
Peak Hour Minimum Pressure	275 kPa (40 psi)	TOBM
Maximum Day Plus Fire Suppression Minimum Pressure	140 kPa (20 psi)	TOBM



Note that peaking factors were interpolated from Table 3-3 of the *Design Guidelines for Drinking-Water Systems* (MOE 2008) based on the design population. Minimum fire flows were calculated based on Table 7 of the Fire Underwriters Survey *Water Supply For Public fire Protection (FUS 2020)*.

Water demands have been based on 17 units and are calculated as follows:

$$\begin{aligned}\text{Design Population (P)} &= 2.3 \text{ persons/unit} \times 17 \text{ units} \\ &= 39.1 \text{ persons}\end{aligned}$$

$$\begin{aligned}\text{Average day demand (ADD)} &= P \times \text{Average daily demand per person} \\ &= 39.1 \text{ persons} \times 450 \text{ L/person/day} \\ &= 17,595 \text{ L/day} \\ &= 17.6 \text{ m}^3/\text{day} \text{ (0.20 L/s)}\end{aligned}$$

$$\begin{aligned}\text{Peak Hour} &= \text{ADD} \times \text{Peak hourly factor} \\ &= 17.6 \text{ m}^3/\text{day} \times 13.8 \\ &= 242.8 \text{ m}^3/\text{day} \text{ (2.8 L/s)}\end{aligned}$$

$$\begin{aligned}\text{Maximum day demand (MDD)} &= \text{ADD} \times \text{Maximum daily factor} \\ &= 17.6 \text{ m}^3/\text{day} \times 9.2 \\ &= 161.9 \text{ m}^3/\text{day} \text{ (1.9 L/s)}\end{aligned}$$

$$\begin{aligned}\text{Maximum day plus fire flow} &= \text{MDD} + \text{Minimum fire flow} \\ &= 1.9 \text{ L/s} + 133 \text{ L/s} \\ &= 134.9 \text{ L/s}\end{aligned}$$

3.3 PROPOSED INFRASTRUCTURE

The proposed water strategy for the 24 Alfred Street development includes connecting to the replaced 150 mm diameter watermain on the north side of Alice Street West and the existing 150 mm diameter watermain on the north side of Alfred Street West. 258 m of proposed 150 mm diameter watermain will run underneath the internal road splitting the subject site. By connecting to both the Alfred Street and Alice Street watermains, it creates a loop to eliminate dead ends. The proposed units fronting the internal road will have new service connections extended from the 150 mm diameter watermain. See the Site Servicing Plan (SS01) for the proposed water system details.



The watermain was sized to accommodate both the maximum day demand with a minimum system pressure of 350 kPa and the minimum fire flow requirements with a residual pressure of 140 kPa. The proposed 150 mm diameter watermain provides 42.5 L/s of flow at 275 kPa, which is sufficient to meet the peak hour water demand of 2.8 L/s. Refer to Appendix B for supporting calculations.

3.3.1 Water Service Connections

Each townhouse will connect to the proposed 150 mm diameter watermain via 19 mm diameter copper type K water service connections with curb stop valves as per the Town of The Blue Mountains Engineering Standards.

Water meters will be installed internal to each individual unit to record water consumption. The proposed buildings will be equipped with backflow prevention devices in accordance with the Ontario Building Code and the Town's water by-law. The backflow prevention devices will also be installed internal to the building to allow for testing and maintenance as may be required.

3.3.2 Fire Protection

Fire hydrants external to the site do not provide sufficient coverage of the proposed development. Two fire hydrants located along the internal road fronting Lots 1 and 4/5 are proposed to provide the requisite fire flows for the development. See drawing SS01 – Site Servicing Drawing for further details pertaining to hydrant location.

Table 2: Proposed Fire Hydrant Flow Rates

HYDRANT	LOCATION DESCRIPTION	MDD + FIRE FLOW (L/S)	REQUIRED PRESSURE (KPA)	PROVIDED FIRE FLOW (L/S)
North	Fronting Lots 4 and 5	134.9	140	135.9
South	East of Lot 1	134.9	140	145.6

As shown in Table 4, the proposed north and south fire hydrants provides a minimum of 135.9 L/s and 145.6 L/s of flow to the internal fire hydrants at a residual pressure of 140 kPa, which is sufficient to meet the minimum required fire flow of 134.9 L/s. Refer to Appendix B for the supporting water service calculation.

3.3.3 Water Availability

As outlined above, the Town of The Blue Mountains drinking water treatment plant has a rated capacity of 16,390 m³/day, with 2,345 m³/day available. The drinking water treatment plant



could accommodate the 161.9 m³/day maximum day demand of the proposed 24 Alfred Street Development.

A consultant for the Town of The Blue Mountains operates a hydraulic model of their water distribution system. We request that the proposed development be added to their model and confirm that the above demand flows can be achieved within the applicable pressure ranges as outlined above.



4 Sanitary Sewage Collection & Conveyance

4.1 EXISTING INFRASTRUCTURE

An existing 200 mm diameter sanitary sewer is located south of the proposed property, flowing east to west under Alfred Street West. The Thornbury West Reconstruction Project currently in development will replace the existing sanitary sewer with a 200 mm diameter sewer under Alice Street West, where discharge west of SAN MH5 (including Park Lane) will flow from east to west. All properties discharging into the Alice Street West sanitary sewer east of SAN MH5 will flow from west to east, where it connects to a 300 mm diameter sanitary sewer that flows north under Bruce Street. SAN MH5 is located 77 m northwest of the Bruce Street and Alice Street West intersection. The ultimate discharge location is the Thornbury Wastewater Treatment Plant (WWTP).

Reviewing the Town of the Blue Mountains *Water & Wastewater Capacity Assessment* for 2020, the Thornbury Wastewater Treatment Plant (WWTP) the plant has a firm-built capacity of 3,580 m³/day. In 2020, the Thornbury WWTP influent flow was 3,115 m³/day, 87% of the rated capacity. The Town has applied for and acquired an Environmental Compliance Approval (ECA) for the construction of Phase 1A of the Thornbury WWTP upgrades, which will increase the average daily flow capacity of the WWTP to 5,330 m³/day. The Construction of the Proposed Works portion of the new ECA expires October 1, 2023. Phase 1B of the upgrade will increase the average daily flow capacity in the Thornbury WWTP to 7,080 m³/day and a peak daily flow capacity of 16,187 m³/day. The Town is able to reserve units based on the Phase 1A design.

Currently the Thornbury Wastewater Treatment Plant has allocated 3,854 m³/day and reserved another 352 m³/day. After the Phase 1A upgrade is complete, the plant will be operating at 79% of its average day flow rated capacity.

4.2 SEWAGE ASSESSMENT

Design Population (P)	= 2.3 persons/unit x 17 units
	= 39.1 persons
Infiltration (I)	= Infiltration Flow x Site Area
	= 0.23 L/ha/s x 1.09 ha
	= 0.25 L/s = 21,660 L/day = 21.7 m ³ /day
Average day flow (ADF)	= P x Average daily demand per person + I
	= 39.1 persons x 450 L/day + 21,660 L/day



$$= 17,595 \text{ L/day} + 21,660 \text{ L/day}$$

$$= 39,255 \text{ L/day}$$

$$= 39.3 \text{ m}^3/\text{day} = 0.5 \text{ L/s}$$

$$\text{Harmon's Peaking Factor (M)} = 1 + 14 \div (4 + \sqrt{P})$$

$$= 1 + 14 \div (4 + \sqrt{39.1})$$

$$= 2.37$$

$$\text{Maximum Day Flow} = (\text{ADF-I}) * M + I$$

$$= (39.3 \text{ m}^3/\text{day} - 21.7 \text{ m}^3/\text{day}) \times 2.37 + 21.7 \text{ m}^3/\text{day}$$

$$= 63.3 \text{ m}^3/\text{day} = 63,280 \text{ L/day} = 0.73 \text{ L/s}$$

4.3 PROPOSED INFRASTRUCTURE

Sanitary discharge from the proposed units fronting the internal road will drain to the Alice Street sanitary sewer via 175 m of 200 mm diameter PVC sanitary sewer that originates southwest of Lot 1. The proposed sanitary sewer will generally flow northeast towards Alice Street West where it will connect to the future 200 mm diameter sanitary sewer, 35 m northwest of SAN MH5, where it will flow west towards Elma Street South. An additional maintenance structure will be required to tie into the existing sanitary sewer. The connection point to the trunk sewer was investigated and it was confirmed that the existing sanitary sewer is at sufficient depth for a sanitary service connection to the proposed buildings.

The proposed sanitary sewer system can be seen on the Site Servicing Plan (SS01). The sanitary design sheet can be found in Appendix A.

4.3.1 Sanitary Service Connections

Each unit will connect to the proposed 200 mm diameter sanitary sewer via 125 mm diameter PVC sanitary service as per the Town of Collingwood Development Standards.

4.3.2 Downstream Sanitary Sewer Capacity

The existing sanitary sewer network that will collect sewage from the subject site, flowing from Alice Street to Elma Street, and Elma Street to Arthur Street, is being replaced as part of the Thornbury Road Infrastructure Project. This project is expected to proceed prior to the 24 Alfred Street Development and is scheduled to start in 2023. These segments of the future sanitary sewer were assessed as part of the Thornbury Road Infrastructure Project and was determined that the future sanitary sewer is at 17.8% of full flow capacity. With the addition of the sewage



from the proposed 24 Alfred Street Development, the future sanitary sewer is at 21.4% of full flow capacity, providing ample capacity for sewage from the proposed development.

4.3.3 Wastewater Treatment Plant Capacity

As noted above, after phase 1A upgrade, the Thornbury WWTP will have an average day flow capacity of 5,330 m³/day, with 1,124 m³/day of the average day flow unallocated. The proposed development average day flow of 39.3 m³/day could be allocated by the Thornbury WWTP after phase 1A is complete. There was no indication in the 2020 *Water and Wastewater Capacity Assessment* what the current Peak Daily Flow and capacity are for the Thornbury WWTP, however the 2019 report indicates that 6,696 m³/day of a 7,196 m³/day capacity is being used (surplus of 473 m³/day). Once upgraded, phase 1B Peak Flow Capacity will be 16,187 m³/day. The proposed development will contribute 63.3 m³/day, 0.4% of the future peak flow capacity of the plant.

Therefore, the Thornbury WWTP can accommodate the increased sanitary flows from the 24 Alfred Street Development.



5 Stormwater Management

A separate Stormwater Management (SWM) Report has been prepared by Tatham Engineering to address drainage and stormwater management requirements for the development. A summary of the SWM servicing strategy is as follows:

- Stormwater management quantity control will be provided by an underground storage system in the north-east corner of the proposed site within the designated SWM block. Stormwater will be directed by an internal storm sewer network to the underground storage system that will attenuate major peak flows (up to and including the 100-year storm event) from the site to the 5-year design capacity of the Alice Street West storm sewer network.
- In the event of inlet blockage, emergency overland flow routes will flow towards the internal road, which will convey peak flows to a low point 10m south of Alice Street West. The maximum ponding depth will not exceed 250 mm before spilling onto Alice Street West.
- A Stormceptor EFO6 located downstream of the underground system will provide a minimum of 80% total solids removal and will treat 90% of the surface runoff generated from its contributing drainage area.

The Stormwater Management Report should be read in conjunction with this report.



6 Transportation

A Traffic Impact Brief has been completed by Tatham Engineering under separate cover. A summary of the conclusions and recommendations are as follows.

- Given the limited traffic volume to be generated by the development of the site and in considering the traffic volumes on the road system, such will not have any significant operational impacts on the operations of the local road system. The operational assessment of the site access points indicates that these intersections will experience excellent levels of service and minimal traffic delays for exiting traffic. Therefore, no operational improvements are required to support the development.
- The proposed locations of the site access points were also reviewed to ensure the provision of adequate spacing between adjacent intersections. In consideration of the road classifications, projected traffic volumes and the Transportation Association of Canada intersection spacing guidelines, the proposed locations are considered appropriate.
- The available sight lines on both Alice Street and Alfred Street to/from the east and west of the site access points are considered appropriate for a design speed of 60 km/h. Vehicles manoeuvring to and from the site can do so in a safe and efficient manner. As such, no further improvements are required to address sight line constraints.
- A turning analysis verifies that the proposed roadway can accommodate emergency vehicles (i.e. fire truck).

The Traffic Impact Brief should be read in conjunction with this report.



7 Utilities

7.1 ELECTRICAL SERVICES

Electrical services fronting the proposed site are available along Alice Street West and Alfred Street West. Tatham Engineering will be reviewing the proposed development from an electrical servicing standpoint and will confirm if external plant upgrades are required to service the site following submission of an electrical distribution plan.

7.2 GAS SERVICES

Union Gas was contacted about their existing gas mains in the area and their ability to service the proposed development. Union gas have a high-pressure gas main adjacent to the proposed development, on the south side of Alice Street West, and another high-pressure gas main on the north side of Alfred Street West. Union Gas to confirm that these mains will provide sufficient capacity for the site.

7.3 TELEPHONE & INTERNET SERVICES

Bell has been contacted regarding available services in the area. Bell has confirmed the site can be serviced with fibre optic cable located on the north side of Alice Street West.

Rogers has been contacted regarding available services in the area.

7.4 POSTAL SERVICES AND DELIVERY

Canada Post has confirmed that a community mailbox on a concrete pad that is supplied by the developer is required for postal services.



8 Summary

As outlined above, existing infrastructure surrounding the subject property can adequately service the development for sanitary sewage, potable water, hydro, natural gas, and telecommunications. Additionally, a Stormwater Management Plan submitted under separate cover confirms that applicable runoff, quantity, quality and erosion targets will be met. A Traffic Impact Study submitted under a separate cover confirms that the proposed development will not adversely affect the existing surrounding road network. A summary of the servicing strategy is as follows:

- Potable water will be provided by connecting into the existing 150 mm diameter watermain on the north side of Alfred Street West with a proposed 150 mm PVC watermain that extends into the subject site underneath the road corridor. The system will be looped by connecting the proposed watermain to a future 150 mm watermain on the north side of Alice Street West.
- Sanitary flows from the proposed development will drain to the existing 200 mm diameter sanitary sewer along Alice Street West, north of the proposed site and 35 m northwest of SAN MH5. An additional maintenance structure will be required to tie into the existing sanitary sewer.
- Stormwater management quantity control will be provided by an underground storage system in the north-east corner of the proposed site. Stormwater will discharge into the Alice Street West storm sewer system.
- Stormwater management quality control will be provided by a Stormceptor EFO6 to provide at least 80% total solids removal and treat 90% of the surface runoff generated from its contributing drainage area.
- Electrical services fronting the proposed site are available along Alice Street West and Alfred Street West. Tatham Engineering will review electrical servicing and confirm if external plant upgrades are required to service the site. Capacity of the existing high pressure gas mains north and south of the development will require confirmation. Bell has confirmed the site can be serviced with fibre optic cable north of the site.

Additional details related to the various servicing components will be provided at the detailed design stage. Detailed drawings will be completed for approval by the Town and relevant regulatory agencies to clear the conditions of Draft Plan Approval and allow for registration of the Plan of Subdivision and the associated Subdivision Agreement.



Appendix A: Sanitary Design Sheets

Project Information

121108

Drawing Reference

May 27-22

Prepared By

May 27-22

Reviewed By

May 27-22

Municipality

Town of The Blue Mountains

Population Density

Low

Infiltration

0.23

Flow

(L/cap/day)

Manning's Coefficient

Value

Engineer Stamp

[illegible]

Appendix B: Water Supply Calculations



Project: 24 Alfred Street
File No.: 121108
Date: May 2022
Design: KG
Checked: DC
Revision: 2

WATERMAIN

Calculation of Water Flow Rates for Different Pipe Sizes
(Hazen Williams Formula - S.I. units)

Pipe Material: PVC

Hazen Williams Coefficient, **C** = 150

Pressure drop over the pipe length, DP = Average Day Min. Pressure - Peak Hour Min. Pressure = 75 kN/m²

Pipe Length (m)	Water Flow Rate (m ³ /hr)								
	Pipe Diameter (mm)								
	20	25	40	50	65	75	100	130	150
258	0.8	1.4	4.7	8.5	17.0	24.7	52.7	105.1	153.1

Flow rate provided by 150 mm dia. water service = 153.1 m³/hr
 = **42.53 L/s**

Flow rate required (from peak flow water supply calculations)

Average Daily Demand = 17595 L/d

Peak Hour Factor = 13.8

Peak Hour Demand = **2.81 L/s**

CHECK: Q_{req} = 2.8 L/s < Q_{pro} = 42.5 L/s **Acceptable**

Hazen Williams Equation as used in this spreadsheet:

$$Q = (3.763 \times 10^{-6}) C D^{2.63} (DP/L)^{0.54}$$

where Q is the water flow rate in m³/hr

D is the pipe diameter in mm

L is the pipe length in m

DP is the pressure difference across pipe length L in kN/m²



Project: 24 Albert Street
File No.: 121108
Date: May 2022
Design: KG
Checked: DC
Revision: 1

FIRE FLOW - WATERMAIN

Calculation of Water Flow Rates for Different Pipe Sizes
(Hazen Williams Formula - S.I. units)

Pipe Material: PVC

Hazen Williams Coefficient, **C** = 150

Pressure drop over the pipe length, DP = Max. Day Min. Pressure - Fire Sup. Min. Pressure = 210 kN/m²

Hydrant Location	Pipe Length (m)	Water Flow Rate (L/s)								
		Pipe Diameter (mm)								
		25	40	50	75	100	130	150	200	250
North	84	1.2	4.2	7.6	22.0	46.8	93.3	135.9	289.7	520.9
South	74	1.3	4.5	8.1	23.5	50.1	99.9	145.6	310.2	557.9

Minimum Required Fire Flow (from Section 3.2.1 Fire Protection)

North Hydrant: $Q_{req,N} = 134.9$ L/s < $Q_{pro,N} = 135.9$ L/s **Acceptable**

South Hydrant: $Q_{req,W} = 134.9$ L/s < $Q_{pro,W} = 145.6$ L/s **Acceptable**

Hazen Williams Equation as used in this spreadsheet:

$$Q = (3.763 \times 10^{-6}) C D^{2.63} (DP/L)^{0.54}$$



where Q is the water flow rate in m³/hr

D is the pipe diameter in mm

L is the pipe length in m

DP is the pressure difference across pipe length L in kN/m²

Engineering Drawings

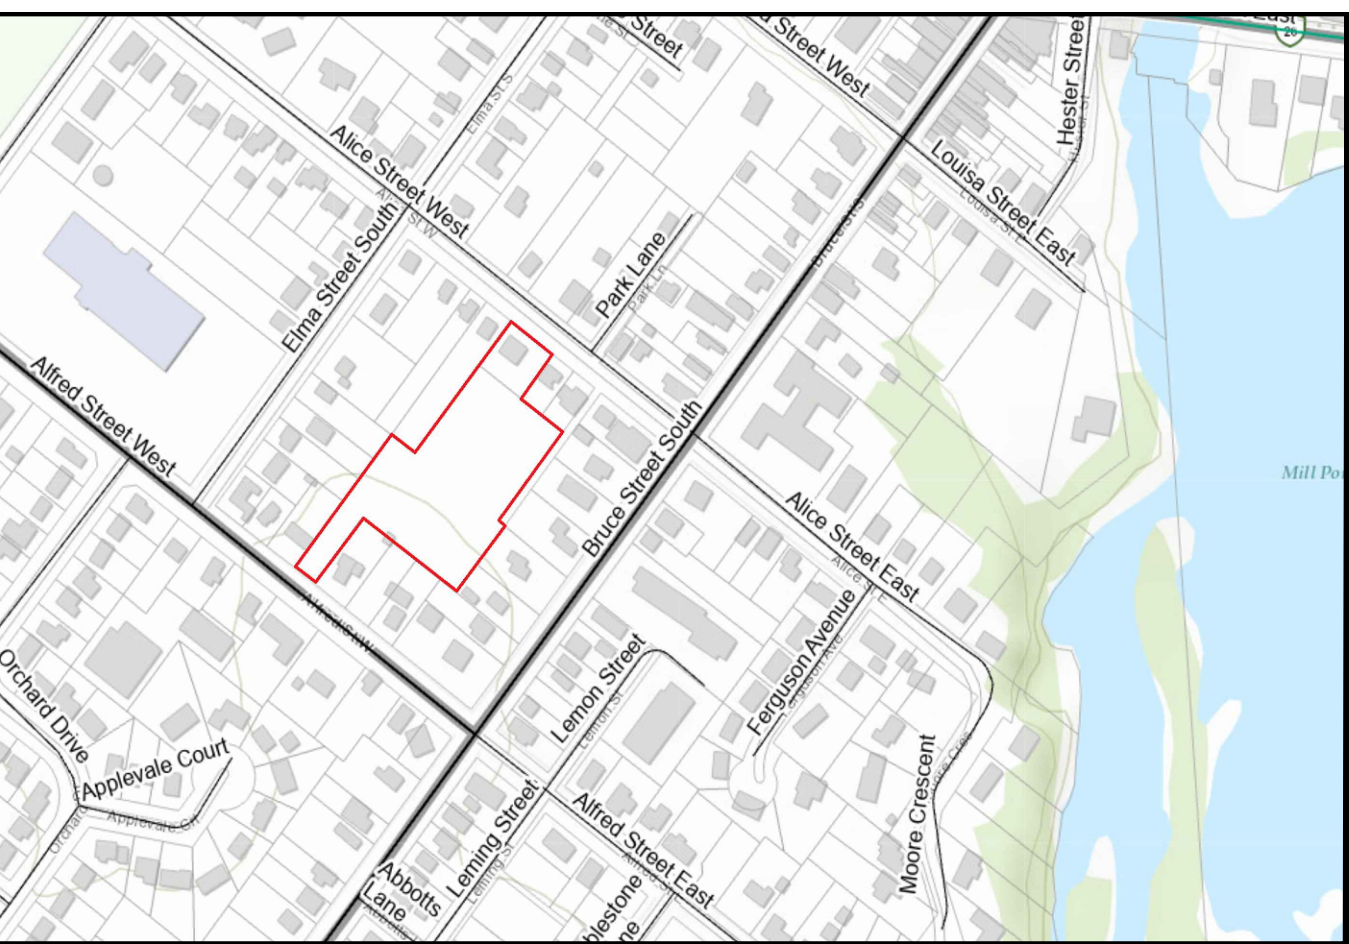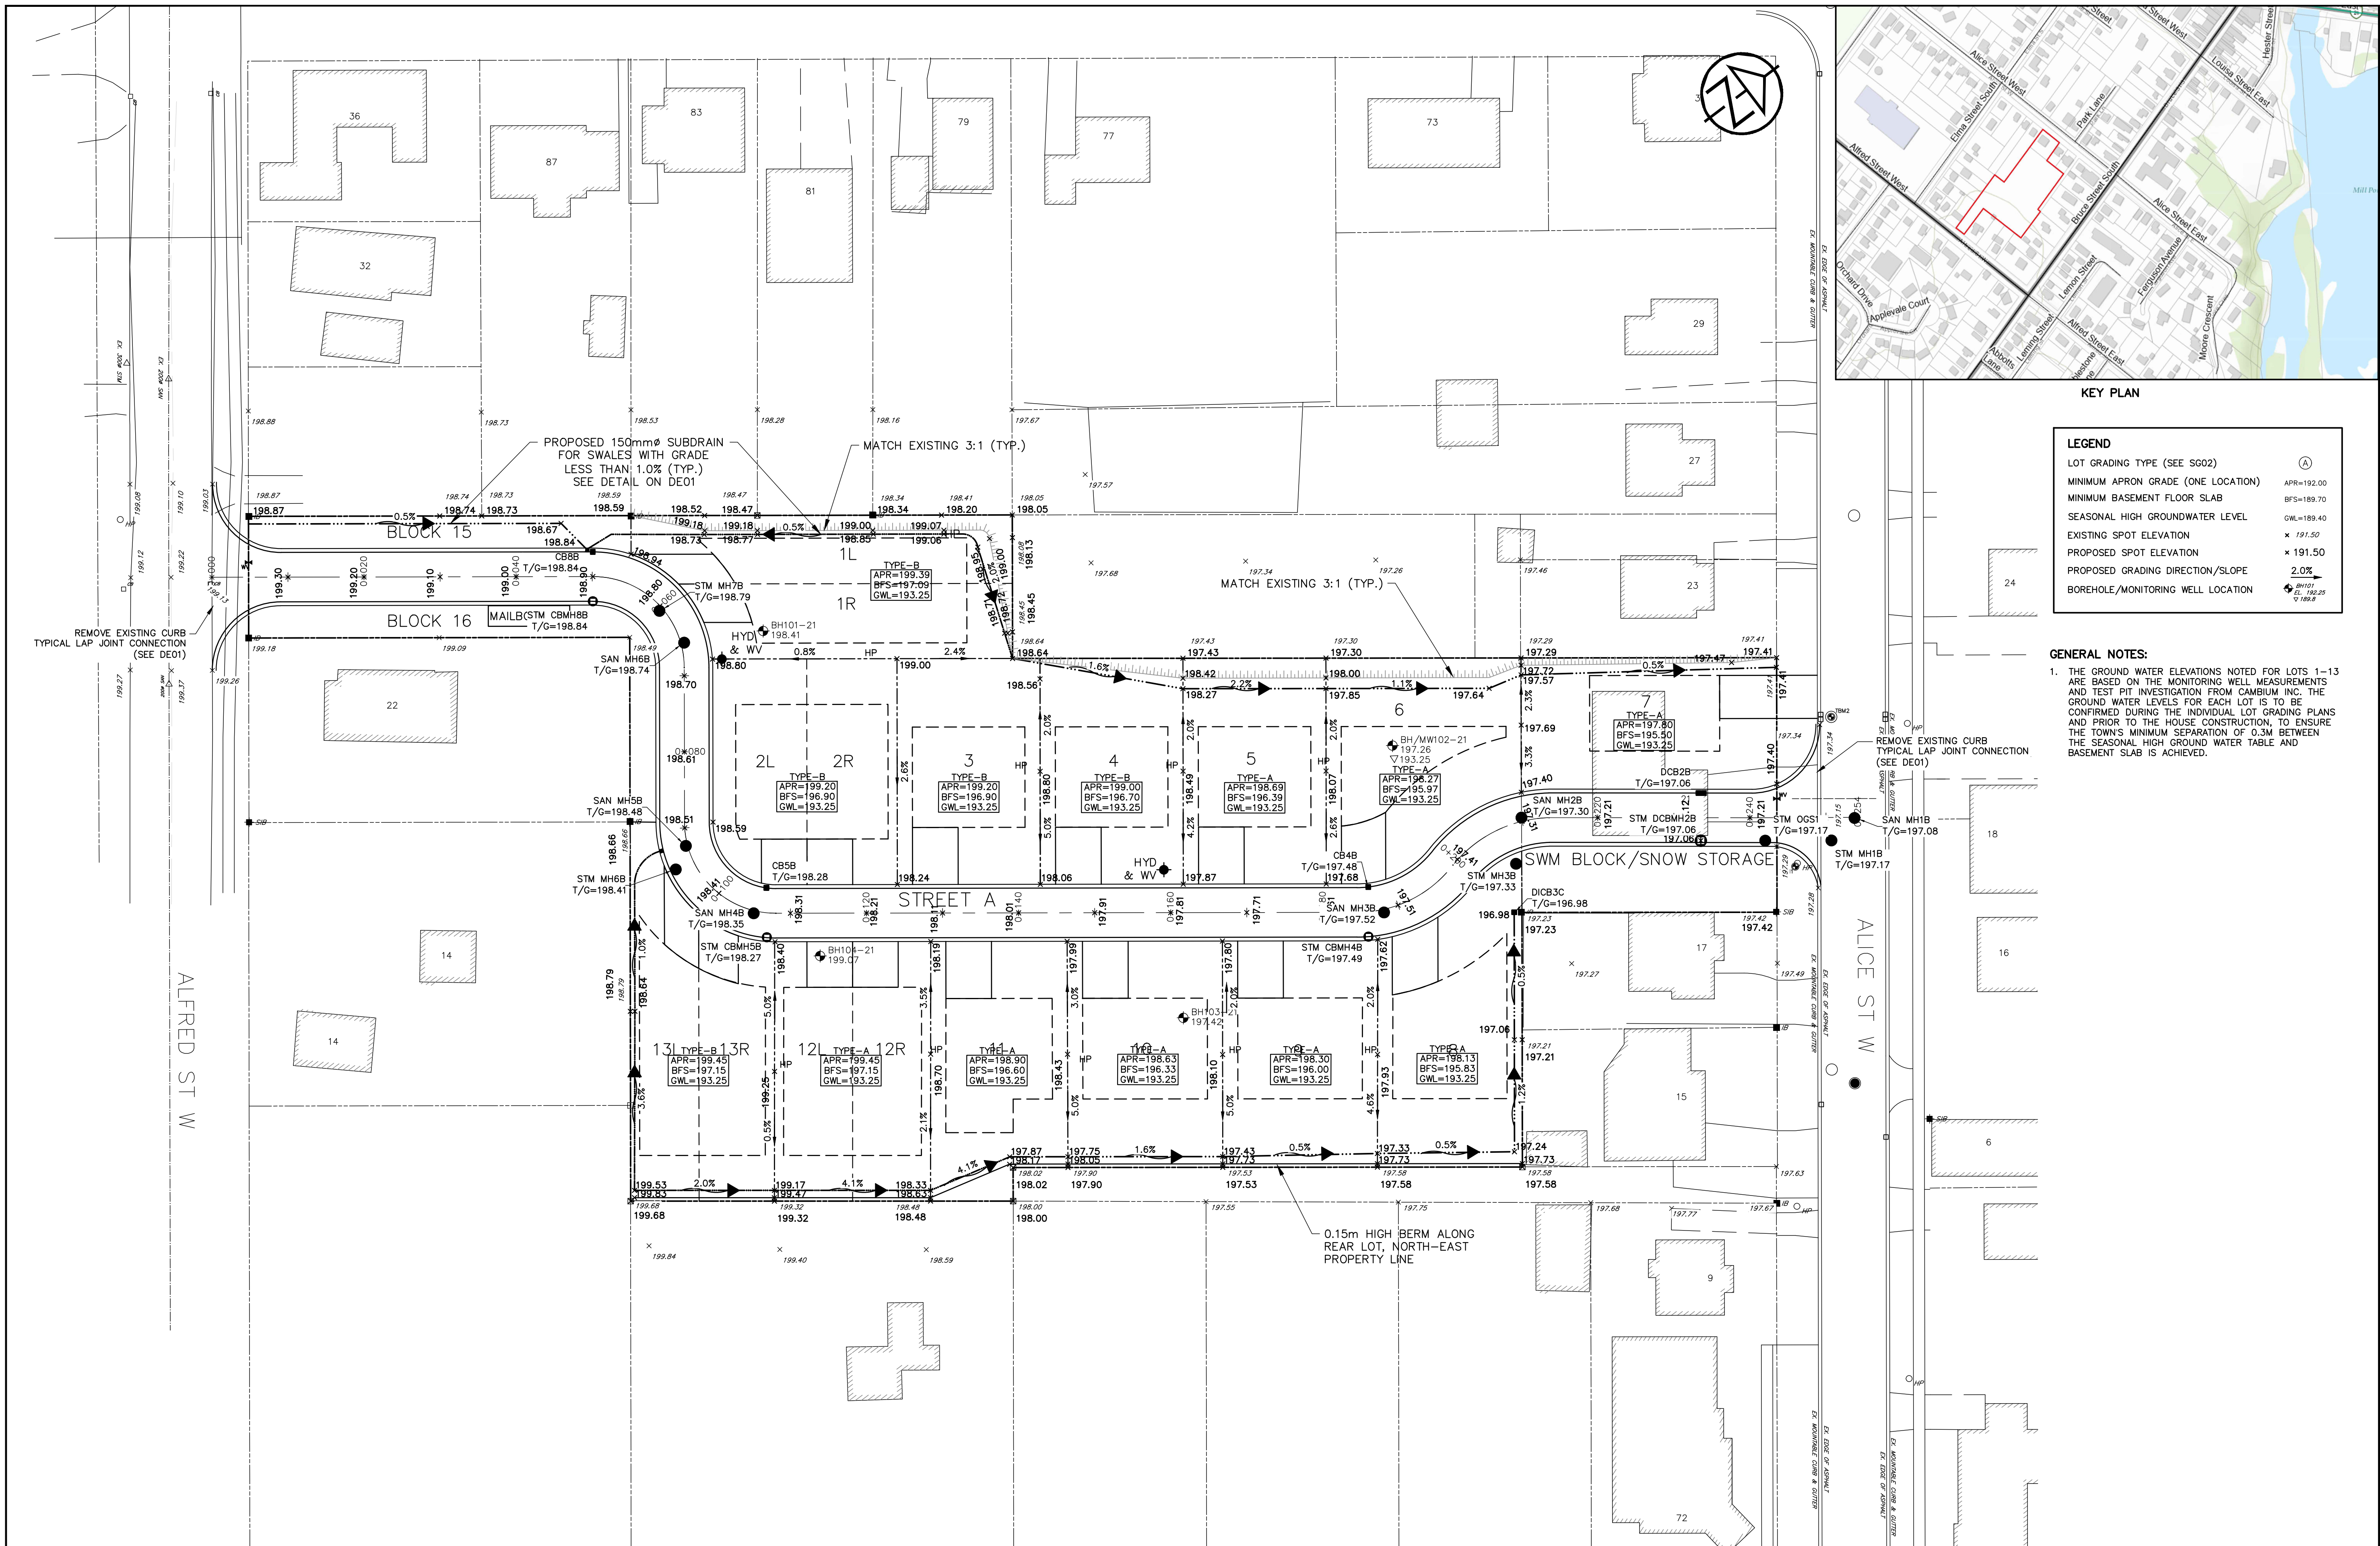



KEY PLAN

LEGEND	
LOT GRADING TYPE (SEE SG02)	(A)
MINIMUM APRON GRADE (ONE LOCATION)	APR=192.00
MINIMUM BASEMENT FLOOR SLAB	BFS=189.70
SEASONAL HIGH GROUNDWATER LEVEL	GWL=189.40
EXISTING SPOT ELEVATION	x 191.50
PROPOSED SPOT ELEVATION	x 191.50
PROPOSED GRADING DIRECTION/SLOPE	2.0%
BOREHOLE/MONITORING WELL LOCATION	BH101 G. 192.25 198.8


GENERAL NOTES:

1. THE GROUND WATER ELEVATIONS NOTED FOR LOTS 1-13 ARE BASED ON THE MONITORING WELL MEASUREMENTS AND TEST PIT INVESTIGATION FROM CAMBLUM INC. THE GROUND WATER LEVELS FOR EACH LOT IS TO BE CONFIRMED DURING THE INDIVIDUAL LOT GRADING PLANS AND PRIOR TO THE HOUSE CONSTRUCTION, TO ENSURE THE TOWN'S MINIMUM SEPARATION OF 0.3M BETWEEN THE SEASONAL HIGH GROUND WATER TABLE AND BASEMENT SLAB IS ACHIEVED.

DISCLAIMER AND COPYRIGHT CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED. TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.	BENCHMARKS TBM1 – ELEVATION 197.19 BASE OF HP ON ALICE ST W TBM2 – ELEVATION 196.96 TOP OF STM MH6 LID ON ALICE ST W	NOTES LEGAL SURVEY INFORMATION AND LOT DIMENSIONS SHOWN ON THIS PLAN ARE TAKEN FROM A SURVEY PLAN PREPARED BY ZUBEK, EMO, PATTEN & THOMSEN LIMITED, DATED APRIL 3, 2012, WHICH MAY NOT BE FINAL AND ARE NOT GUARANTEED. THE FINAL REGISTERED PLAN OF SUBDIVISION SHALL BE REFERRED TO FOR CONFIRMATION OF THE DATA. TOPOGRAPHIC INFORMATION SHOWN ON THIS PLAN FROM SURVEY PREPARED BY GM BLUEPLAN ENGINEERING LIMITED DATED JUNE 5, 2018 AND DECEMBER 5, 2011.	No. 1.	REVISION DESCRIPTION 1ST SUBMISSION	DATE 2022-02-09	ENGINEER STAMP	24 ALFRED STREET TOWN OF THE BLUE MOUNTAINS		DESIGN: AM FILE: 121108 DWG: SG01
			2.	REVISED AS PER DRC COMMENTS	2022-05-27				
SITE GRADING PLAN DRAWN: AM DATE: FEB 2022 CHECK: DC SCALE: 1:400									

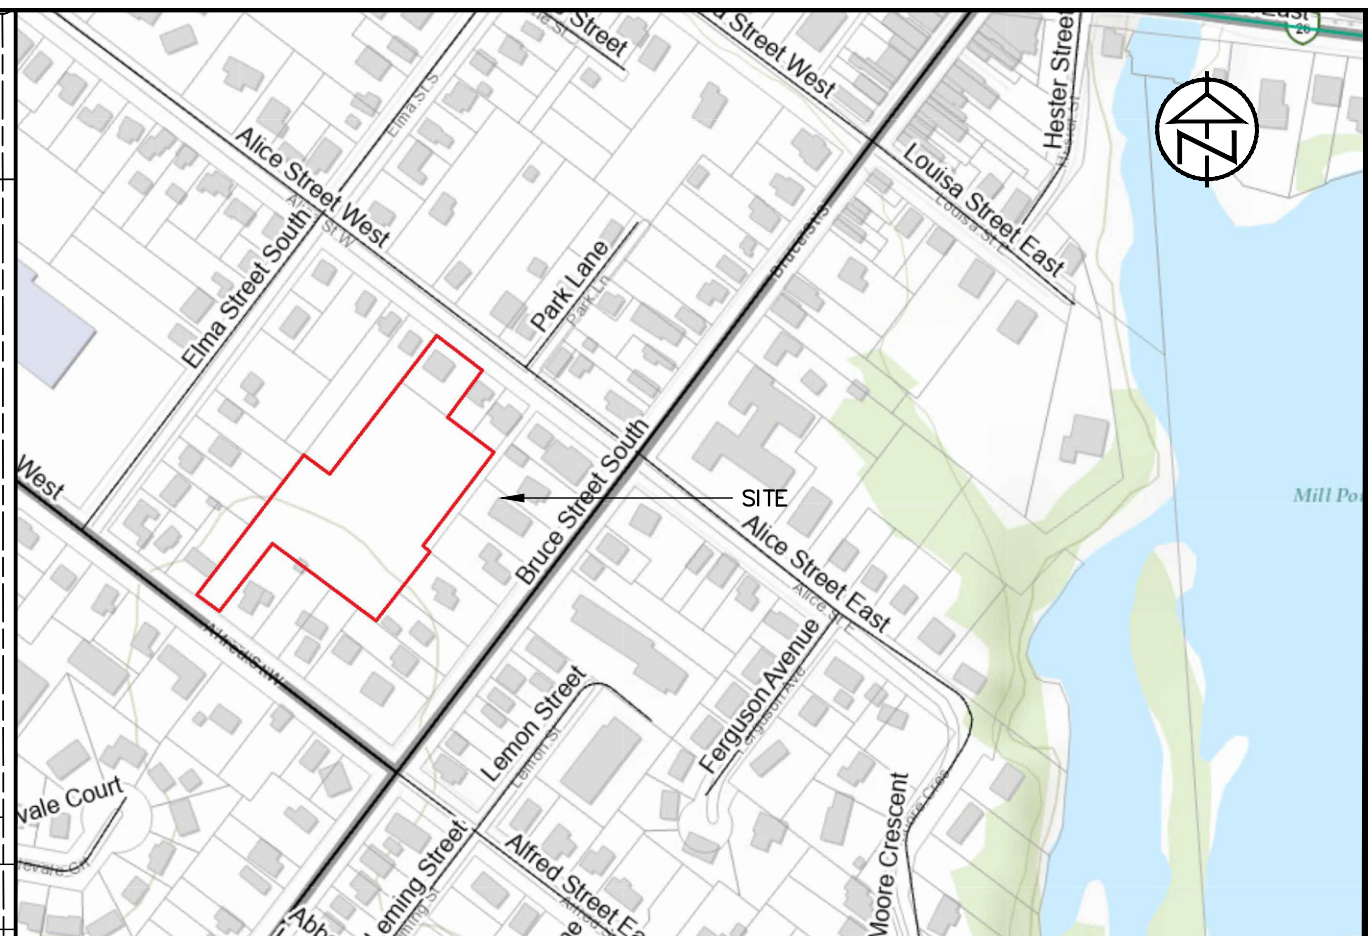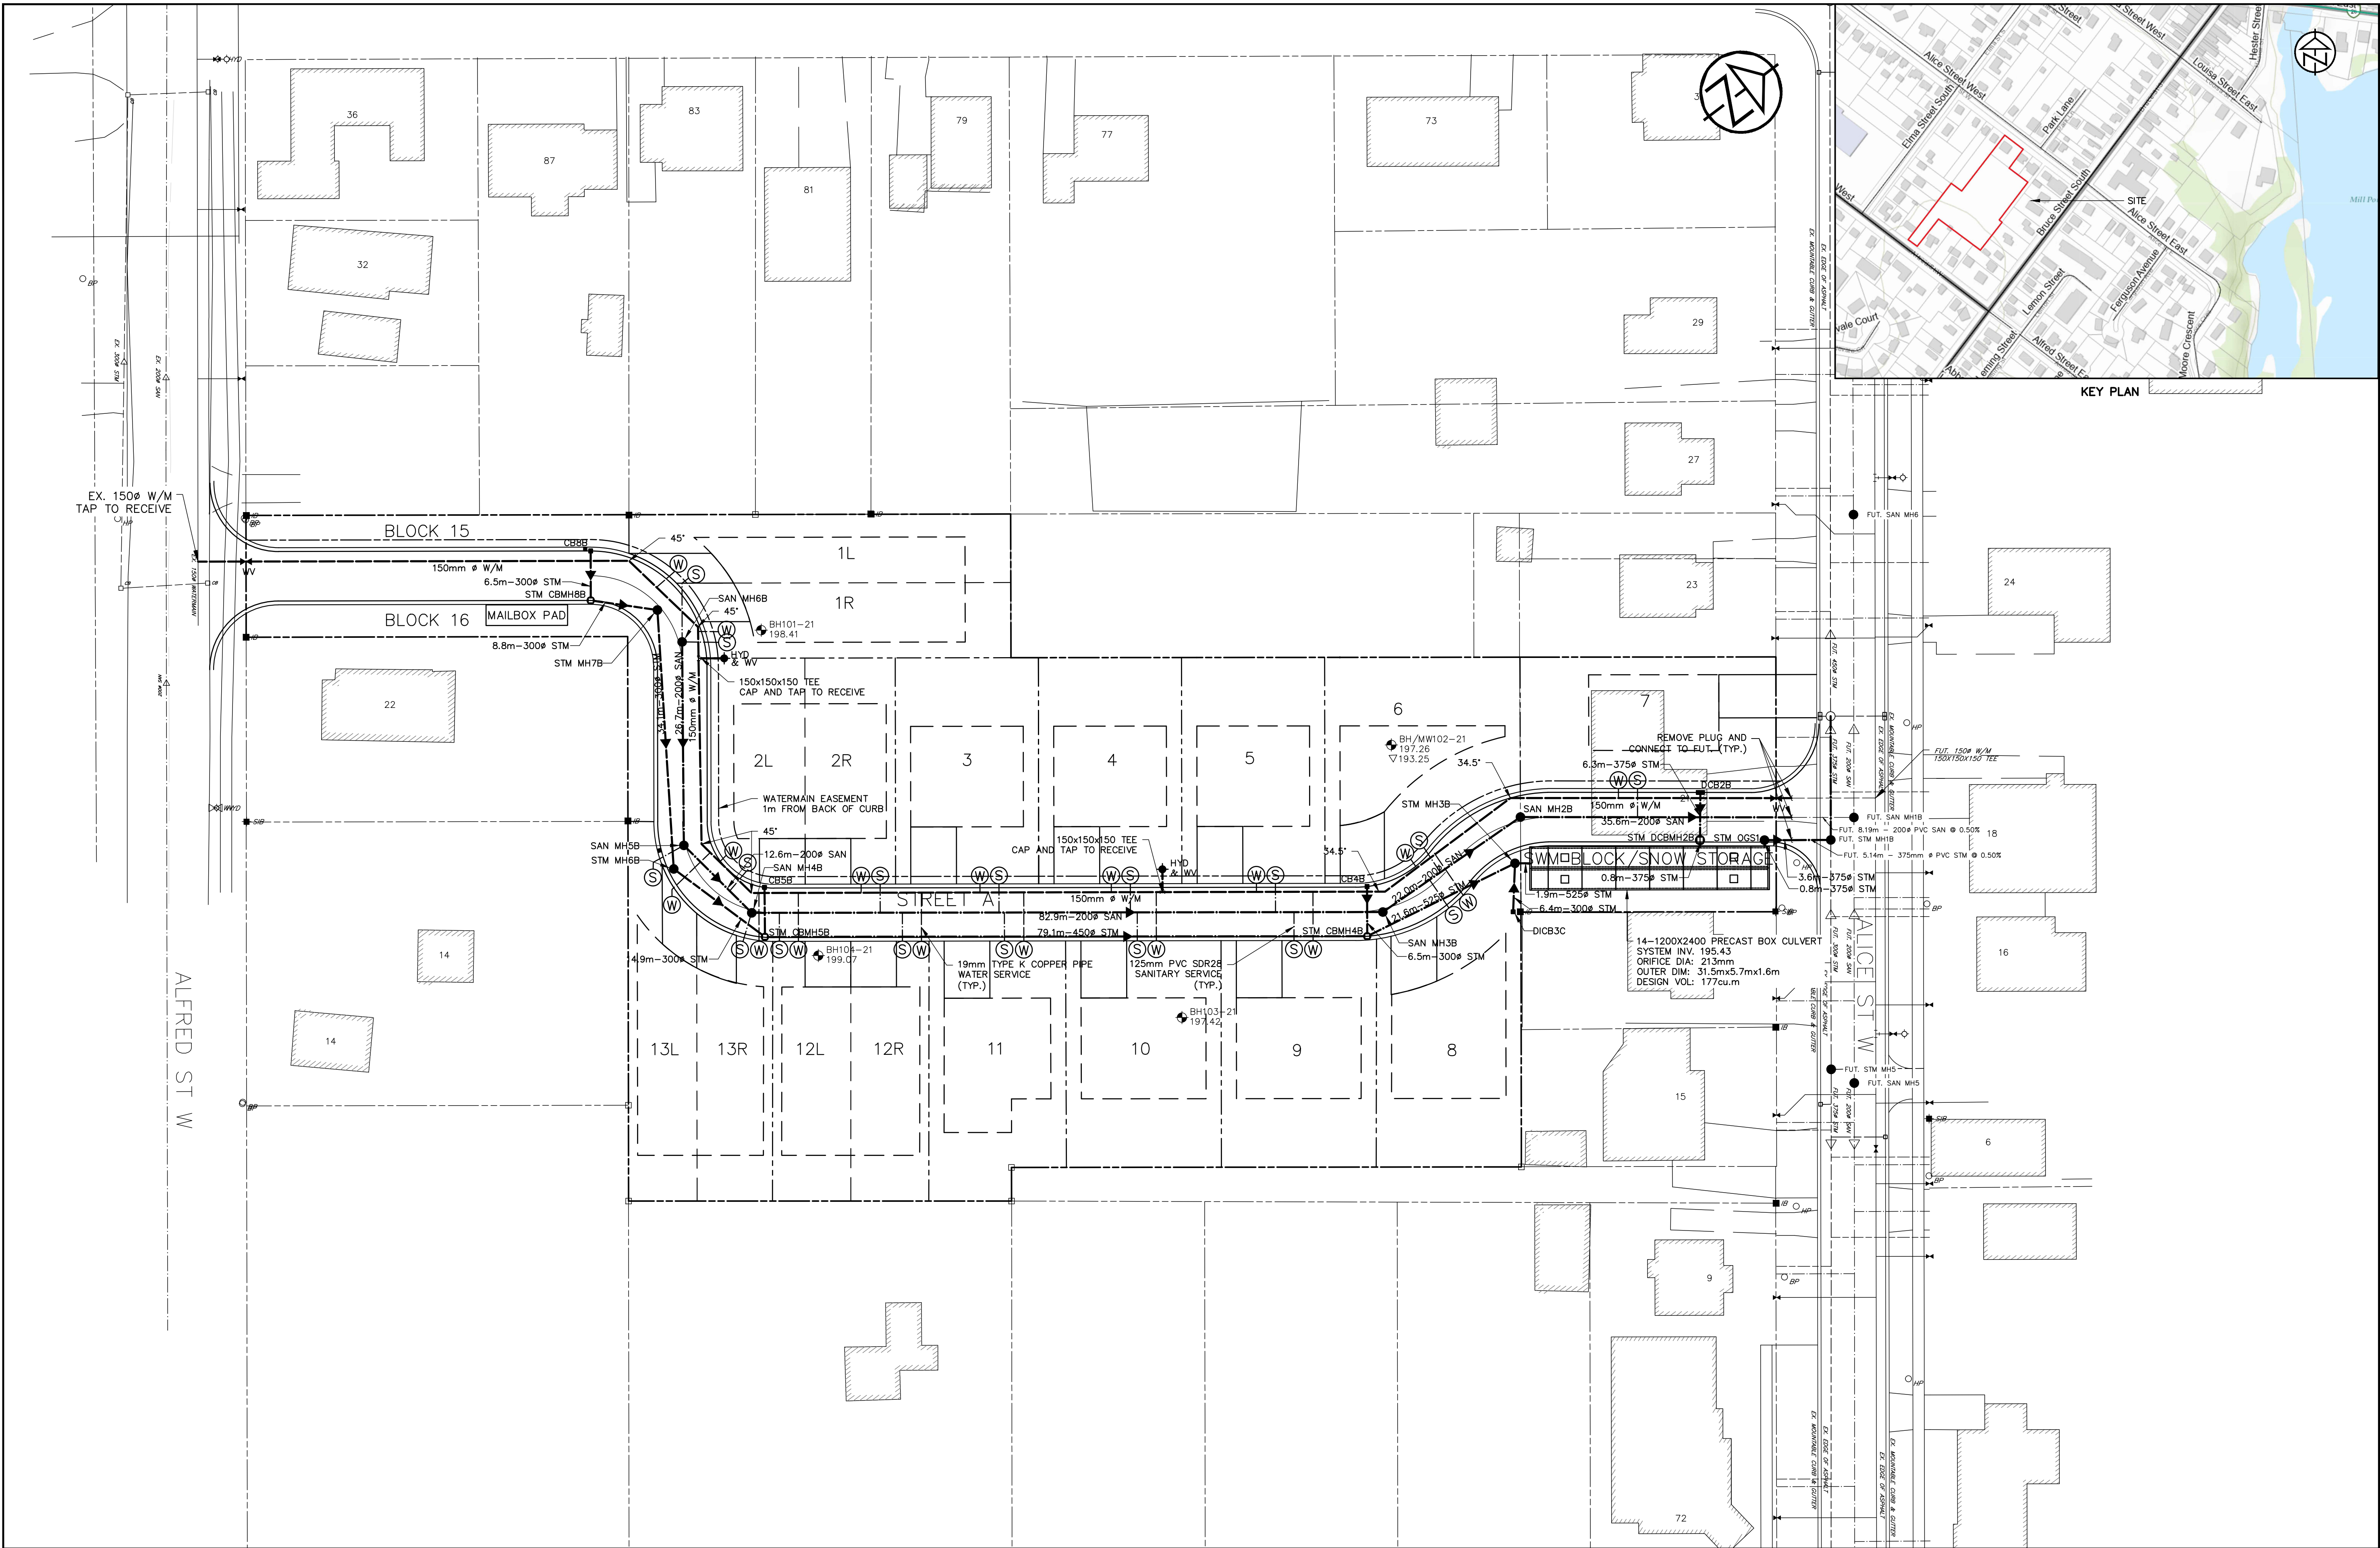


DISCLAIMER AND COPYRIGHT CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED. TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.	BENCHMARKS TBM1 – ELEVATION 197.30 BASE OF SIB ON WEST SIDE OF ALICE ST W TBM2 – ELEVATION 197.28 TOP OF LID OF MHS15 ON ALICE ST W	NOTES LEGAL SURVEY INFORMATION AND LOT DIMENSIONS SHOWN ON THIS PLAN ARE TAKEN FROM A SURVEY PLAN PREPARED BY ZUBEK, EMO, PATTEN & THOMSEN LIMITED, DATED APRIL 3, 2012, WHICH MAY NOT BE FINAL AND ARE NOT GUARANTEED. THE FINAL REGISTERED PLAN OF SUBDIVISION SHALL BE REFERRED TO FOR CONFIRMATION OF THE DATA. TOPOGRAPHIC INFORMATION SHOWN ON THIS PLAN FROM SURVEY PREPARED BY GM BLUEPLAN ENGINEERING LIMITED DATED JUNE 5, 2018 AND DECEMBER 5, 2011.	<table><tr><th>No.</th><th>REVISION DESCRIPTION</th><th>DATE</th></tr><tr><td>1.</td><td>1ST SUBMISSION</td><td>2022-02-09</td></tr><tr><td>2.</td><td>REVISED AS PER DRC COMMENTS</td><td>2022-05-27</td></tr><tr><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td></tr></table>	No.	REVISION DESCRIPTION	DATE	1.	1ST SUBMISSION	2022-02-09	2.	REVISED AS PER DRC COMMENTS	2022-05-27										ENGINEER STAMP	24 ALFRED STREET TOWN OF THE BLUE MOUNTAINS	
			No.	REVISION DESCRIPTION	DATE																			
			1.	1ST SUBMISSION	2022-02-09																			
			2.	REVISED AS PER DRC COMMENTS	2022-05-27																			
SITE SERVICING PLAN		DESIGN: KG	FILE: 121108	DWG: SS01																				
		DRAWN: KG	DATE: FEB 2022																					
		CHECK: DC	SCALE: 1:400																					

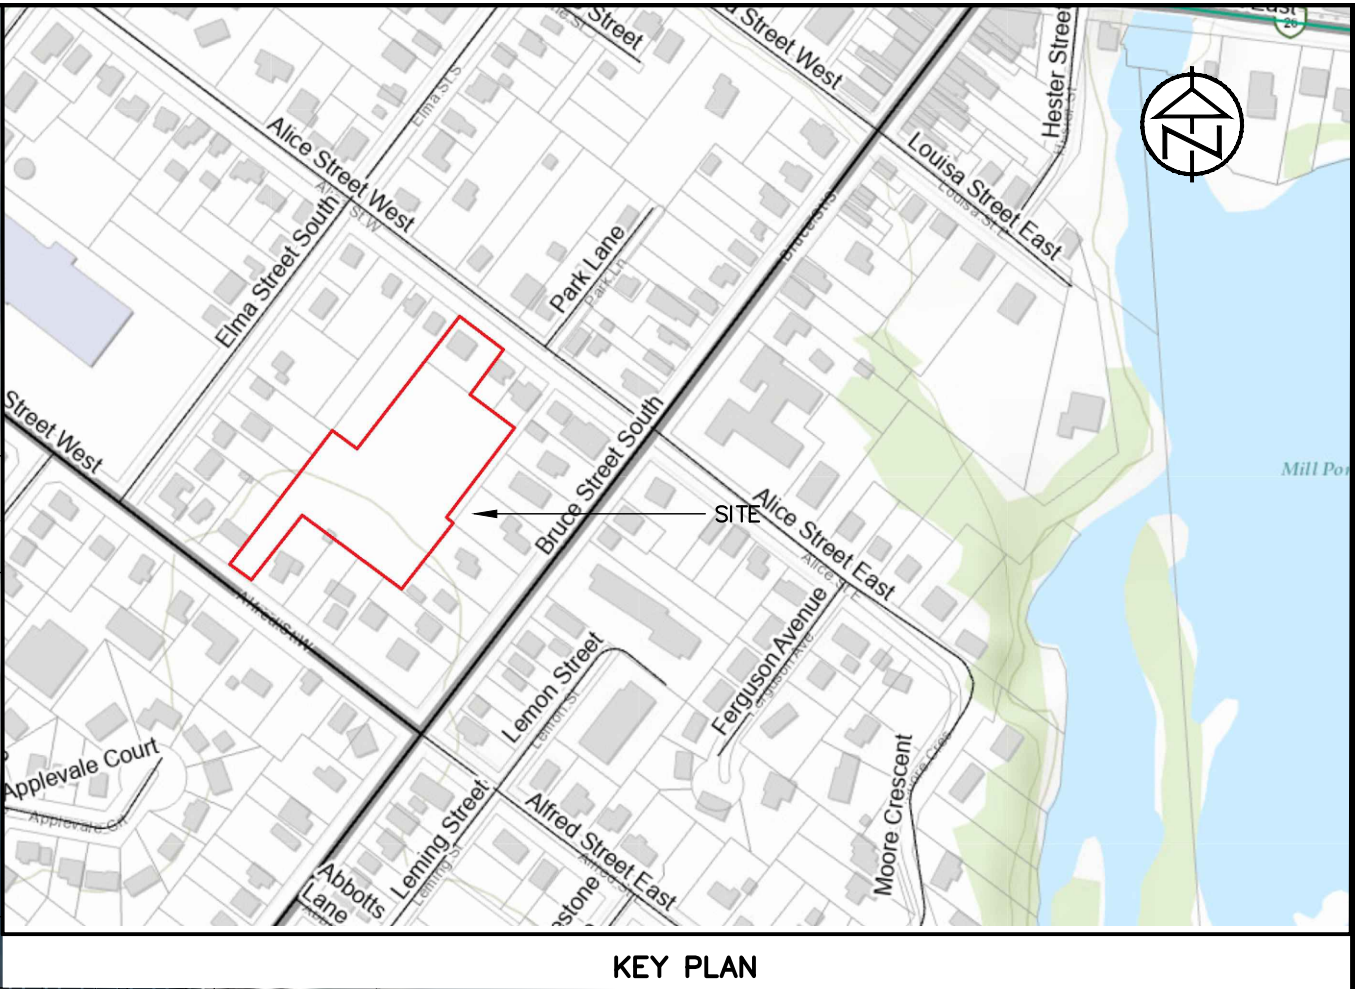


LEGEND

- AREA BOUNDARY
- AREA IDENTIFICATION NUMBER
- AREA IN HECTARES
- RUNOFF COEFFICIENT/PERCENT IMPERVIOUS
- EXISTING MAJOR OVERLAND FLOW DIRECTION

DISCLAIMER AND COPYRIGHT CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED. TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.	BENCHMARKS TBM1 – ELEVATION 197.30 BASE OF SIB ON WEST SIDE OF ALICE ST W TBM2 – ELEVATION 197.28 TOP OF LID OF MHS15 ON ALICE ST W	NOTES LEGAL SURVEY INFORMATION AND LOT DIMENSIONS SHOWN ON THIS PLAN ARE TAKEN FROM A SURVEY PLAN PREPARED BY ZUBEK, EMO, PATTEN & THOMSEN LIMITED, DATED APRIL 3, 2012, WHICH MAY NOT BE FINAL AND ARE NOT GUARANTEED. THE FINAL REGISTERED PLAN OF SUBDIVISION SHALL BE REFERRED TO FOR CONFIRMATION OF THE DATA. TOPOGRAPHIC INFORMATION SHOWN ON THIS PLAN FROM SURVEY PREPARED BY GM BLUEPLAN ENGINEERING LIMITED DATED JUNE 5, 2018 AND DECEMBER 5, 2011.	No.	REVISION DESCRIPTION	DATE	ENGINEER STAMP 	24 ALFRED STREET TOWN OF THE BLUE MOUNTAINS	
			1.	1ST SUBMISSION	2022-02-09			
			2.	REVISED AS PER DRC COMMENTS	2022-05-27			
DP01	PRE-DEVELOPMENT DRAINAGE PLAN	DESIGN: KG	FILE: 121108	DWG:				
		DRAWN: KG	DATE: FEB 2022	DP01				
		CHECK: DC	SCALE: 1:400					

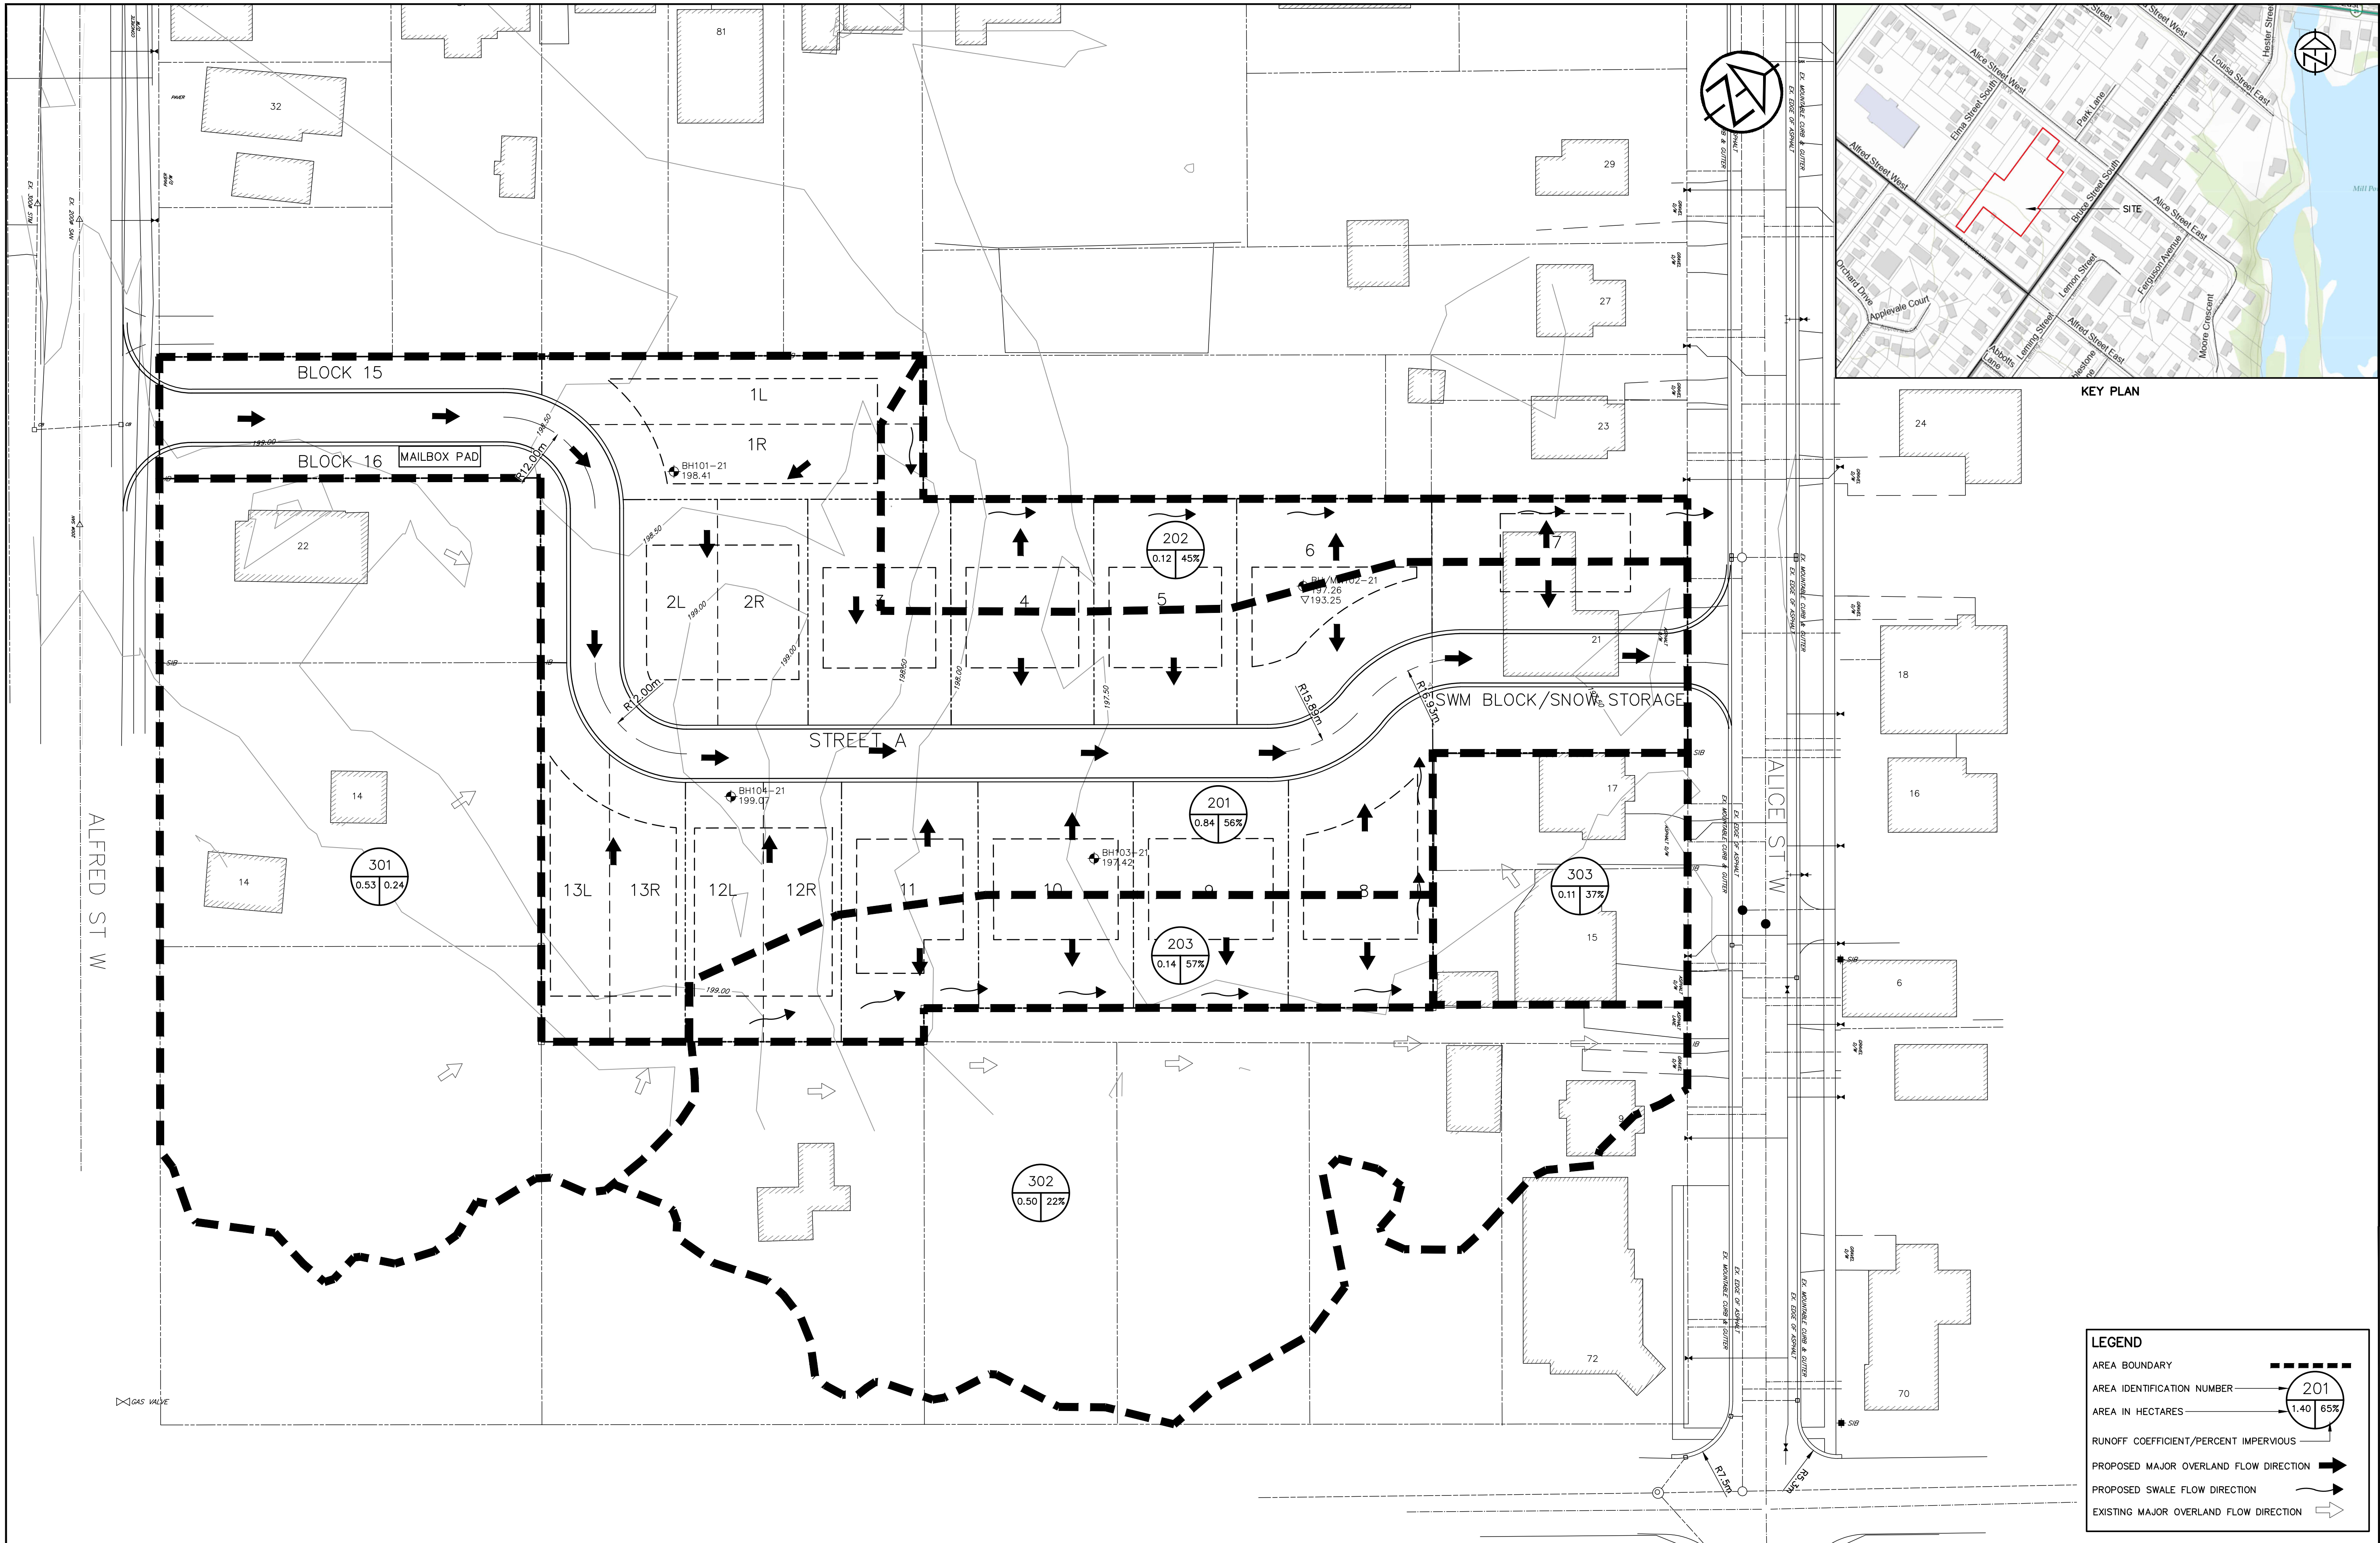

DISCLAIMER AND COPYRIGHT CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED. TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.	BENCHMARKS TBM1 – ELEVATION 197.30 BASE OF SIB ON WEST SIDE OF ALICE ST W TBM2 – ELEVATION 197.28 TOP OF LID OF MHS15 ON ALICE ST W	NOTES LEGAL SURVEY INFORMATION AND LOT DIMENSIONS SHOWN ON THIS PLAN ARE TAKEN FROM A SURVEY PLAN PREPARED BY ZUBEK, EMO, PATTEN & THOMSEN LIMITED, DATED APRIL 3, 2012 WHICH MAY NOT BE FINAL AND ARE NOT GUARANTEED. THE FINAL REGISTERED PLAN OF SUBDIVISION SHALL BE REFERRED TO FOR CONFIRMATION OF THE DATA. TOPOGRAPHIC INFORMATION SHOWN ON THIS PLAN FROM SURVEY PREPARED BY GM BLUEPLAN ENGINEERING LIMITED DATED JUNE 5, 2018 AND DECEMBER 5, 2011.	<table><thead><tr><th>No.</th><th>REVISION DESCRIPTION</th><th>DATE</th></tr></thead><tbody><tr><td>1.</td><td>1ST SUBMISSION</td><td>2022-02-09</td></tr><tr><td>2.</td><td>REVISED AS PER DRC COMMENTS</td><td>2022-05-27</td></tr><tr><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td></tr></tbody></table>	No.	REVISION DESCRIPTION	DATE	1.	1ST SUBMISSION	2022-02-09	2.	REVISED AS PER DRC COMMENTS	2022-05-27										ENGINEER STAMP 	24 ALFRED STREET TOWN OF THE BLUE MOUNTAINS	POST-DEVELOPMENT DRAINAGE PLAN	<table><tr><td>DESIGN: KG</td><td>FILE: 121108</td><td>DWG:</td></tr><tr><td>DRAWN: KG</td><td>DATE: FEB 2022</td><td rowspan="2">DP02</td></tr><tr><td>CHECK: DC</td><td>SCALE: 1:400</td></tr></table>	DESIGN: KG	FILE: 121108	DWG:	DRAWN: KG	DATE: FEB 2022	DP02	CHECK: DC	SCALE: 1:400
No.	REVISION DESCRIPTION	DATE																															
1.	1ST SUBMISSION	2022-02-09																															
2.	REVISED AS PER DRC COMMENTS	2022-05-27																															
DESIGN: KG	FILE: 121108	DWG:																															
DRAWN: KG	DATE: FEB 2022	DP02																															
CHECK: DC	SCALE: 1:400																																

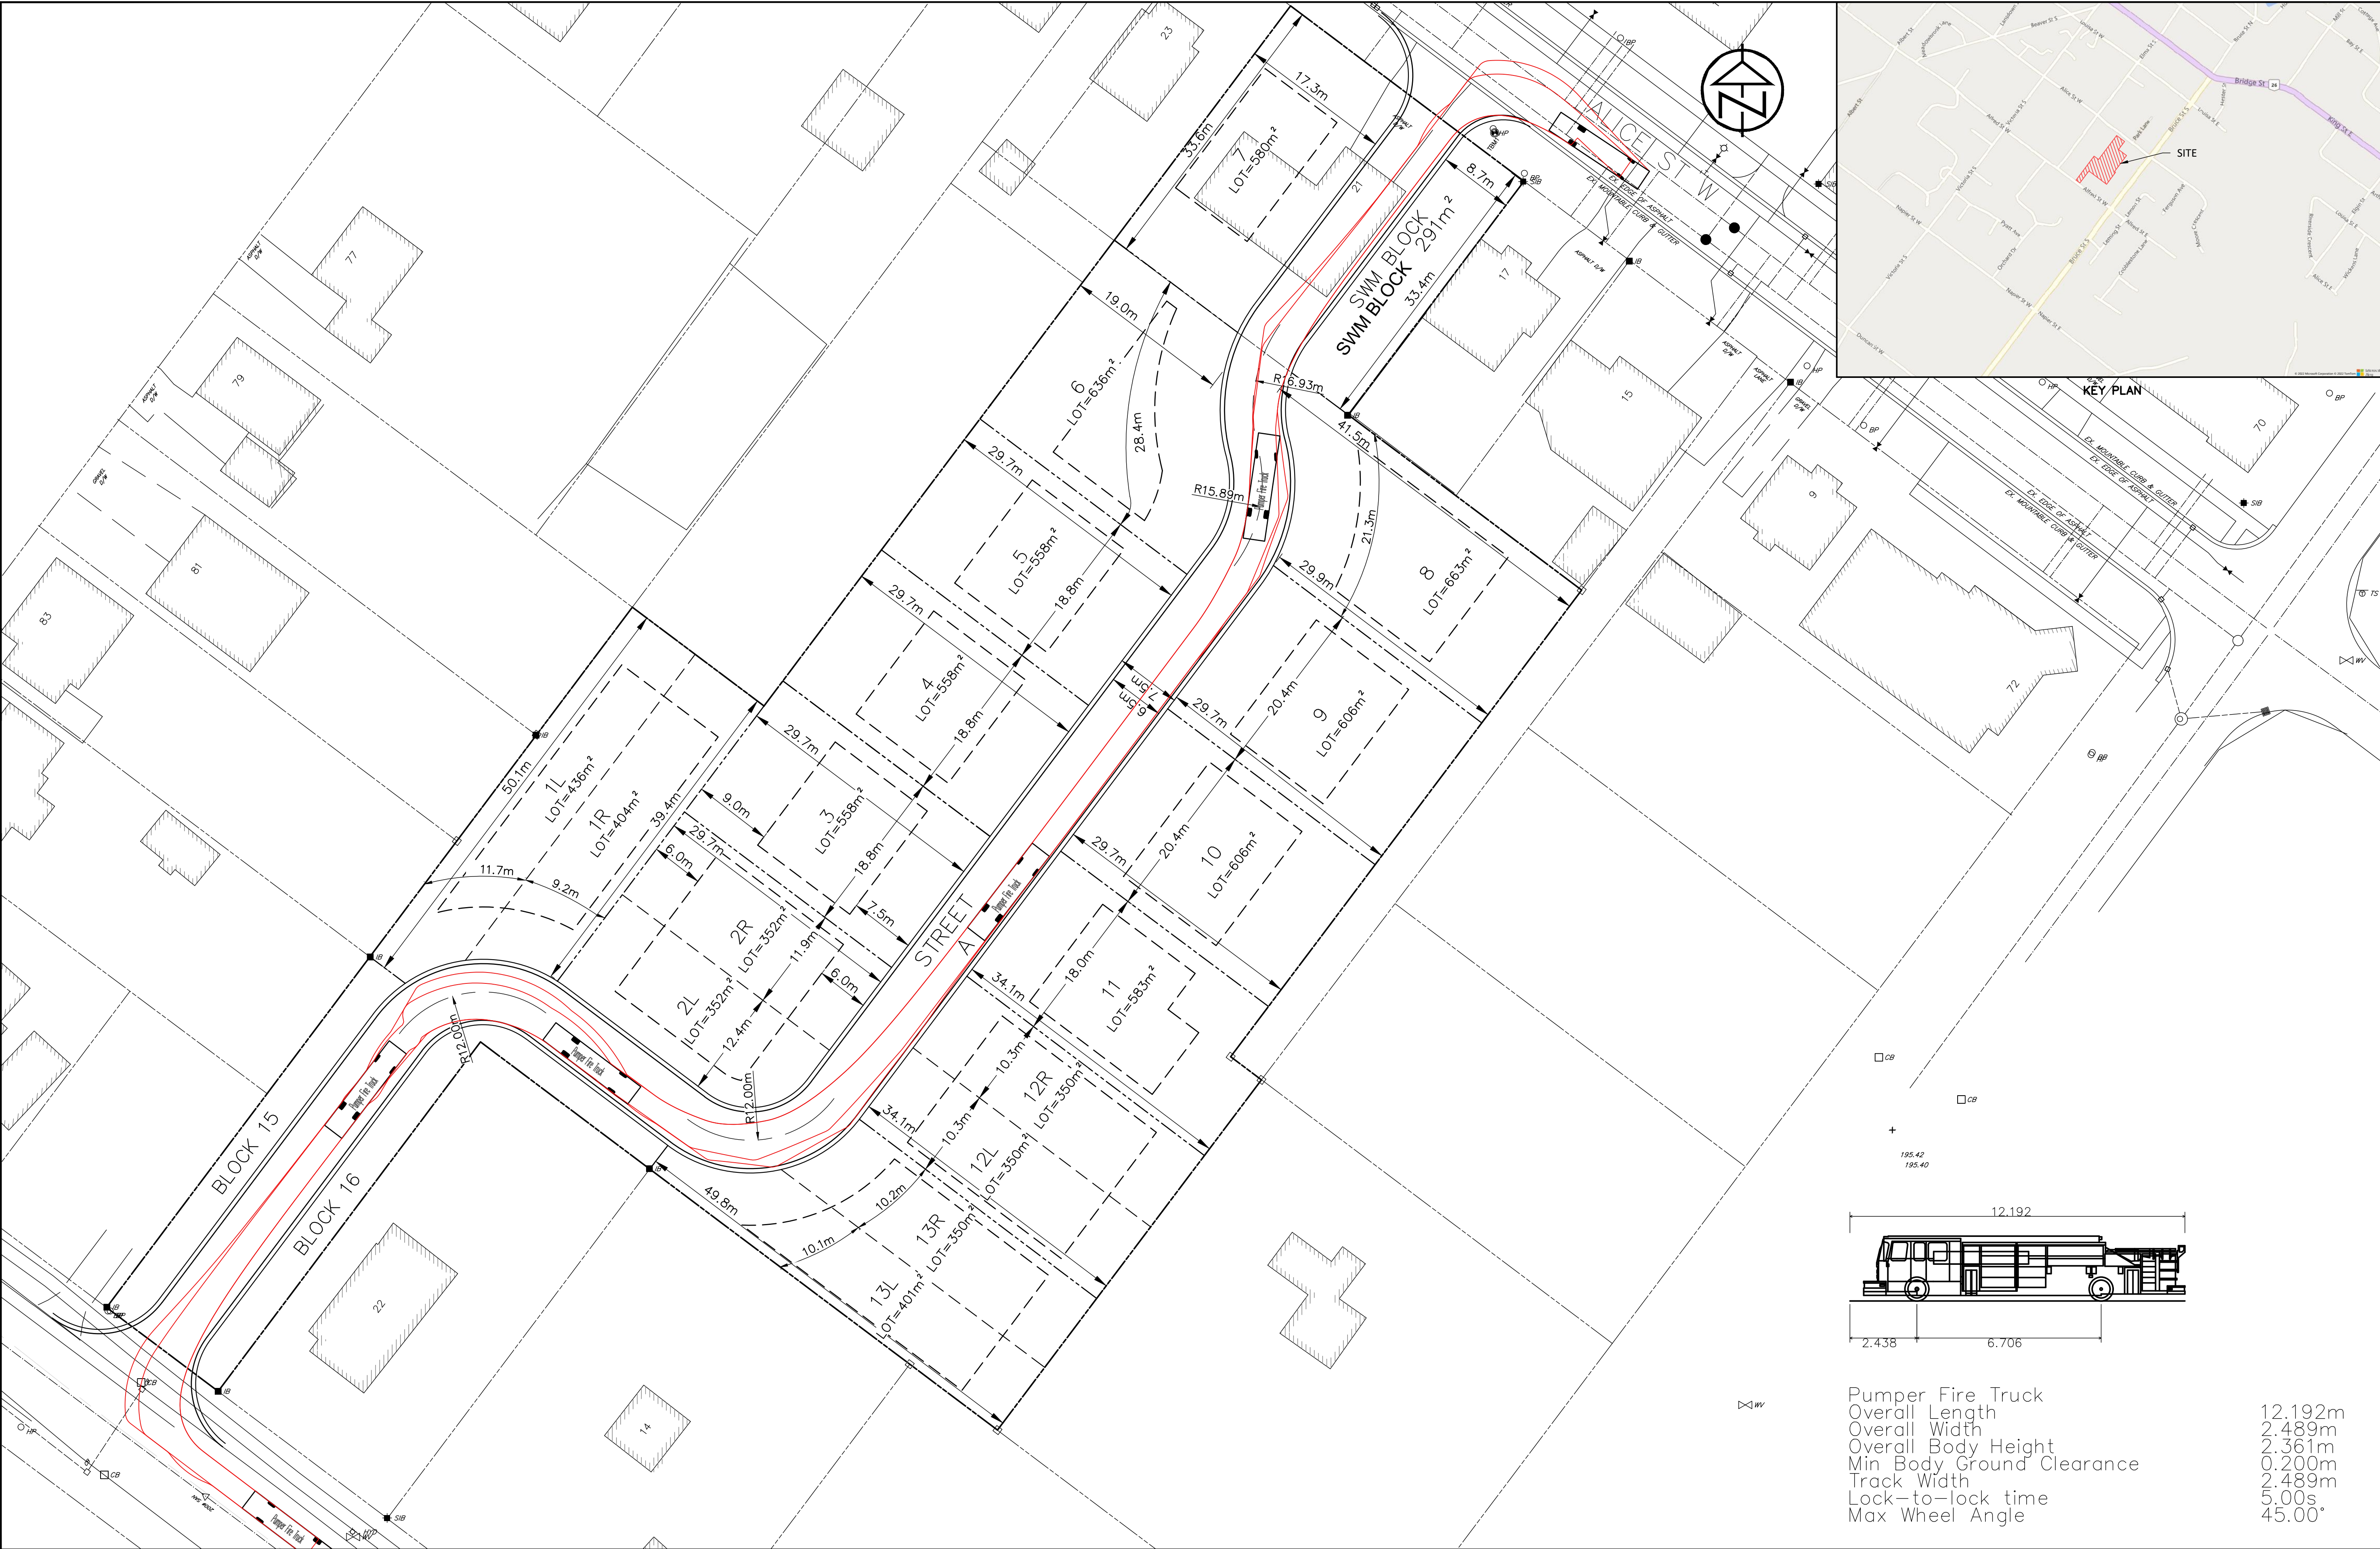

DISCLAIMER AND COPYRIGHT CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED. TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.	BENCHMARKS TBM1 – ELEVATION 197.30 BASE OF SIB ON WEST SIDE OF ALICE ST W TBM2 – ELEVATION 197.28 TOP OF LID OF MHS15 ON ALICE ST W	NOTES LEGAL SURVEY INFORMATION AND LOT DIMENSIONS SHOWN ON THIS PLAN ARE TAKEN FROM A SURVEY PLAN PREPARED BY ZUBEK, EMO, PATTEN & THOMSEN LIMITED, DATED APRIL 3, 2012, WHICH MAY NOT BE FINAL AND ARE NOT GUARANTEED. THE FINAL REGISTERED PLAN OF SUBDIVISION SHALL BE REFERRED TO FOR CONFIRMATION OF THE DATA. TOPOGRAPHIC INFORMATION SHOWN ON THIS PLAN FROM SURVEY PREPARED BY GM BLUEPLAN ENGINEERING LIMITED DATED JUNE 5, 2018 AND DECEMBER 5, 2011.	No.		REVISION DESCRIPTION	DATE	ENGINEER STAMP	24 ALFRED STREET TOWN OF THE BLUE MOUNTAINS							
			1.		1ST SUBMISSION	2022-04-14									
											TURNING ANALYSIS		DESIGN: KG	FILE: 121108	DWG: DWG-#
										DRAWN: KH			DATE: FEB 2022		
										CHECK: DC			SCALE: 1:350		