


**SECTION**

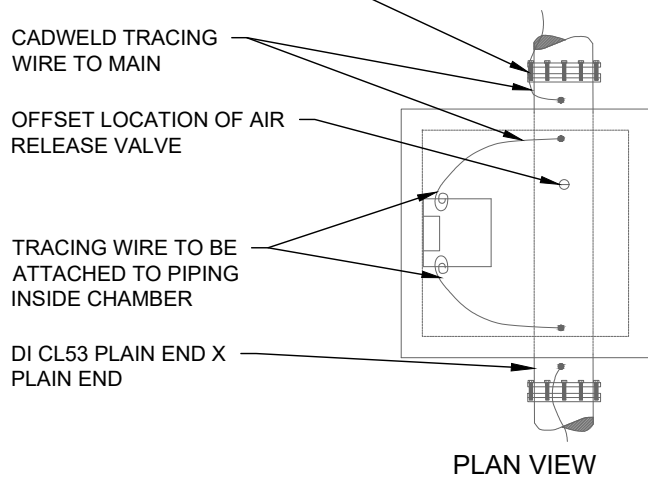

**PLAN VIEW**

**NOTES**

1. AIR RELEASE VALVE & PIPING SHALL BE 25mm DIAMETER FOR WATERMAINS UP TO & INCLUDING 300mm, AND 50mm DIAMETER FOR WATERMAINS LARGER THAN 300mm.
2. PIPING AND FITTINGS SHALL BE THREADED COPPER OR BRASS.
3. REINFORCED PRECAST CONCRETE BE IN ACCORDANCE WITH OPSS 407 & 1351.
4. BACKFILL WITH SELECT SUBGRADE MATERIAL IN ACCORDANCE WITH OPSS 1010 COMPACTED TO 95% SPD.
5. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.



**Town Of The Blue Mountains Standard Drawings**

**AIR AND VACUUM RELEASE DETAIL**

Date

JAN 2023

Scale

N.T.S.

TOTBM STD.

4.7.3