PANTONE CAPITAL INC.

Lot 31 Clark St. Site Plan

DRAWING INDEX

EXISTING CONDITIONS AND REMOVAL PLAN

GRADING AND SERVICING PLAN (1 OF 3)

GRADING AND SERVICING PLAN (2 OF 3) GRADING AND SERVICING PLAN (3 OF 3)

POST DEVELOPMENT DRAINAGE AREA PLAN

STORMWATER MANAGEMENT FACILITY PLAN STORMWATER MANAGEMENT FACILITY PROFILE

EROSION AND SEDIMENT CONTROL PLAN (1 OF 3)

EROSION AND SEDIMENT CONTROL PLAN (2 OF 3)

EROSION AND SEDIMENT CONTROL PLAN (3 OF 3)

PLAN AND PROFILE


EXTERNAL EROSION AND SEDIMENT CONTROL PLAN

CLARK STREET

GREY ROAD 2

STANDARD DETAILS


STANDARD DETAILS STANDARD DETAILS

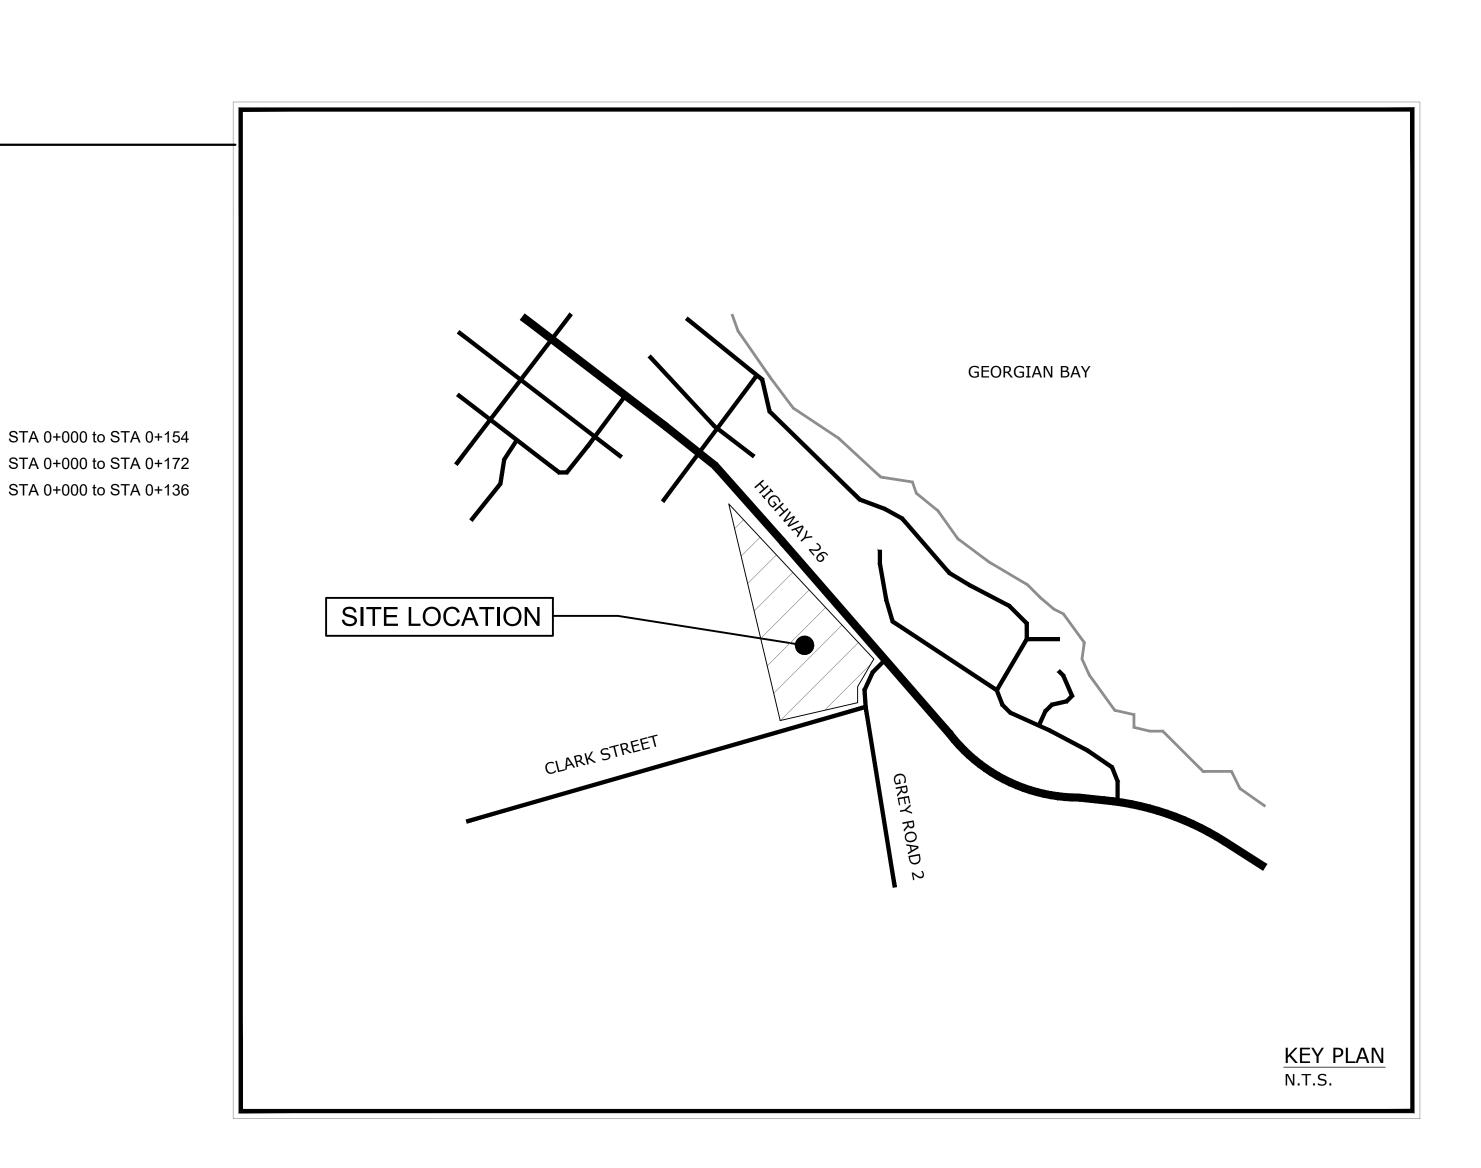


PANTONE CAPITAL INC.


Project No. 2021-185

REVISED FOR APPROVALS - 24/11/14

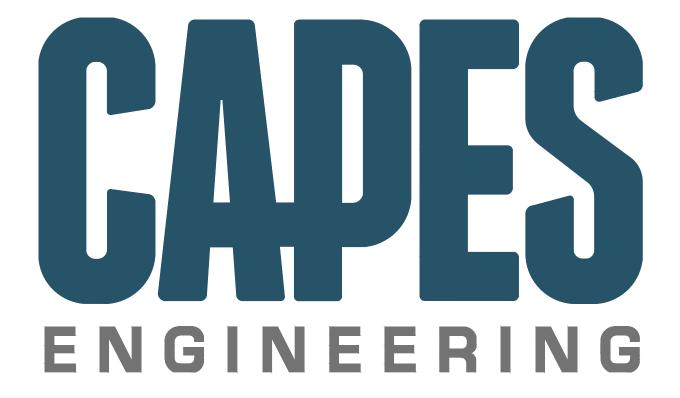



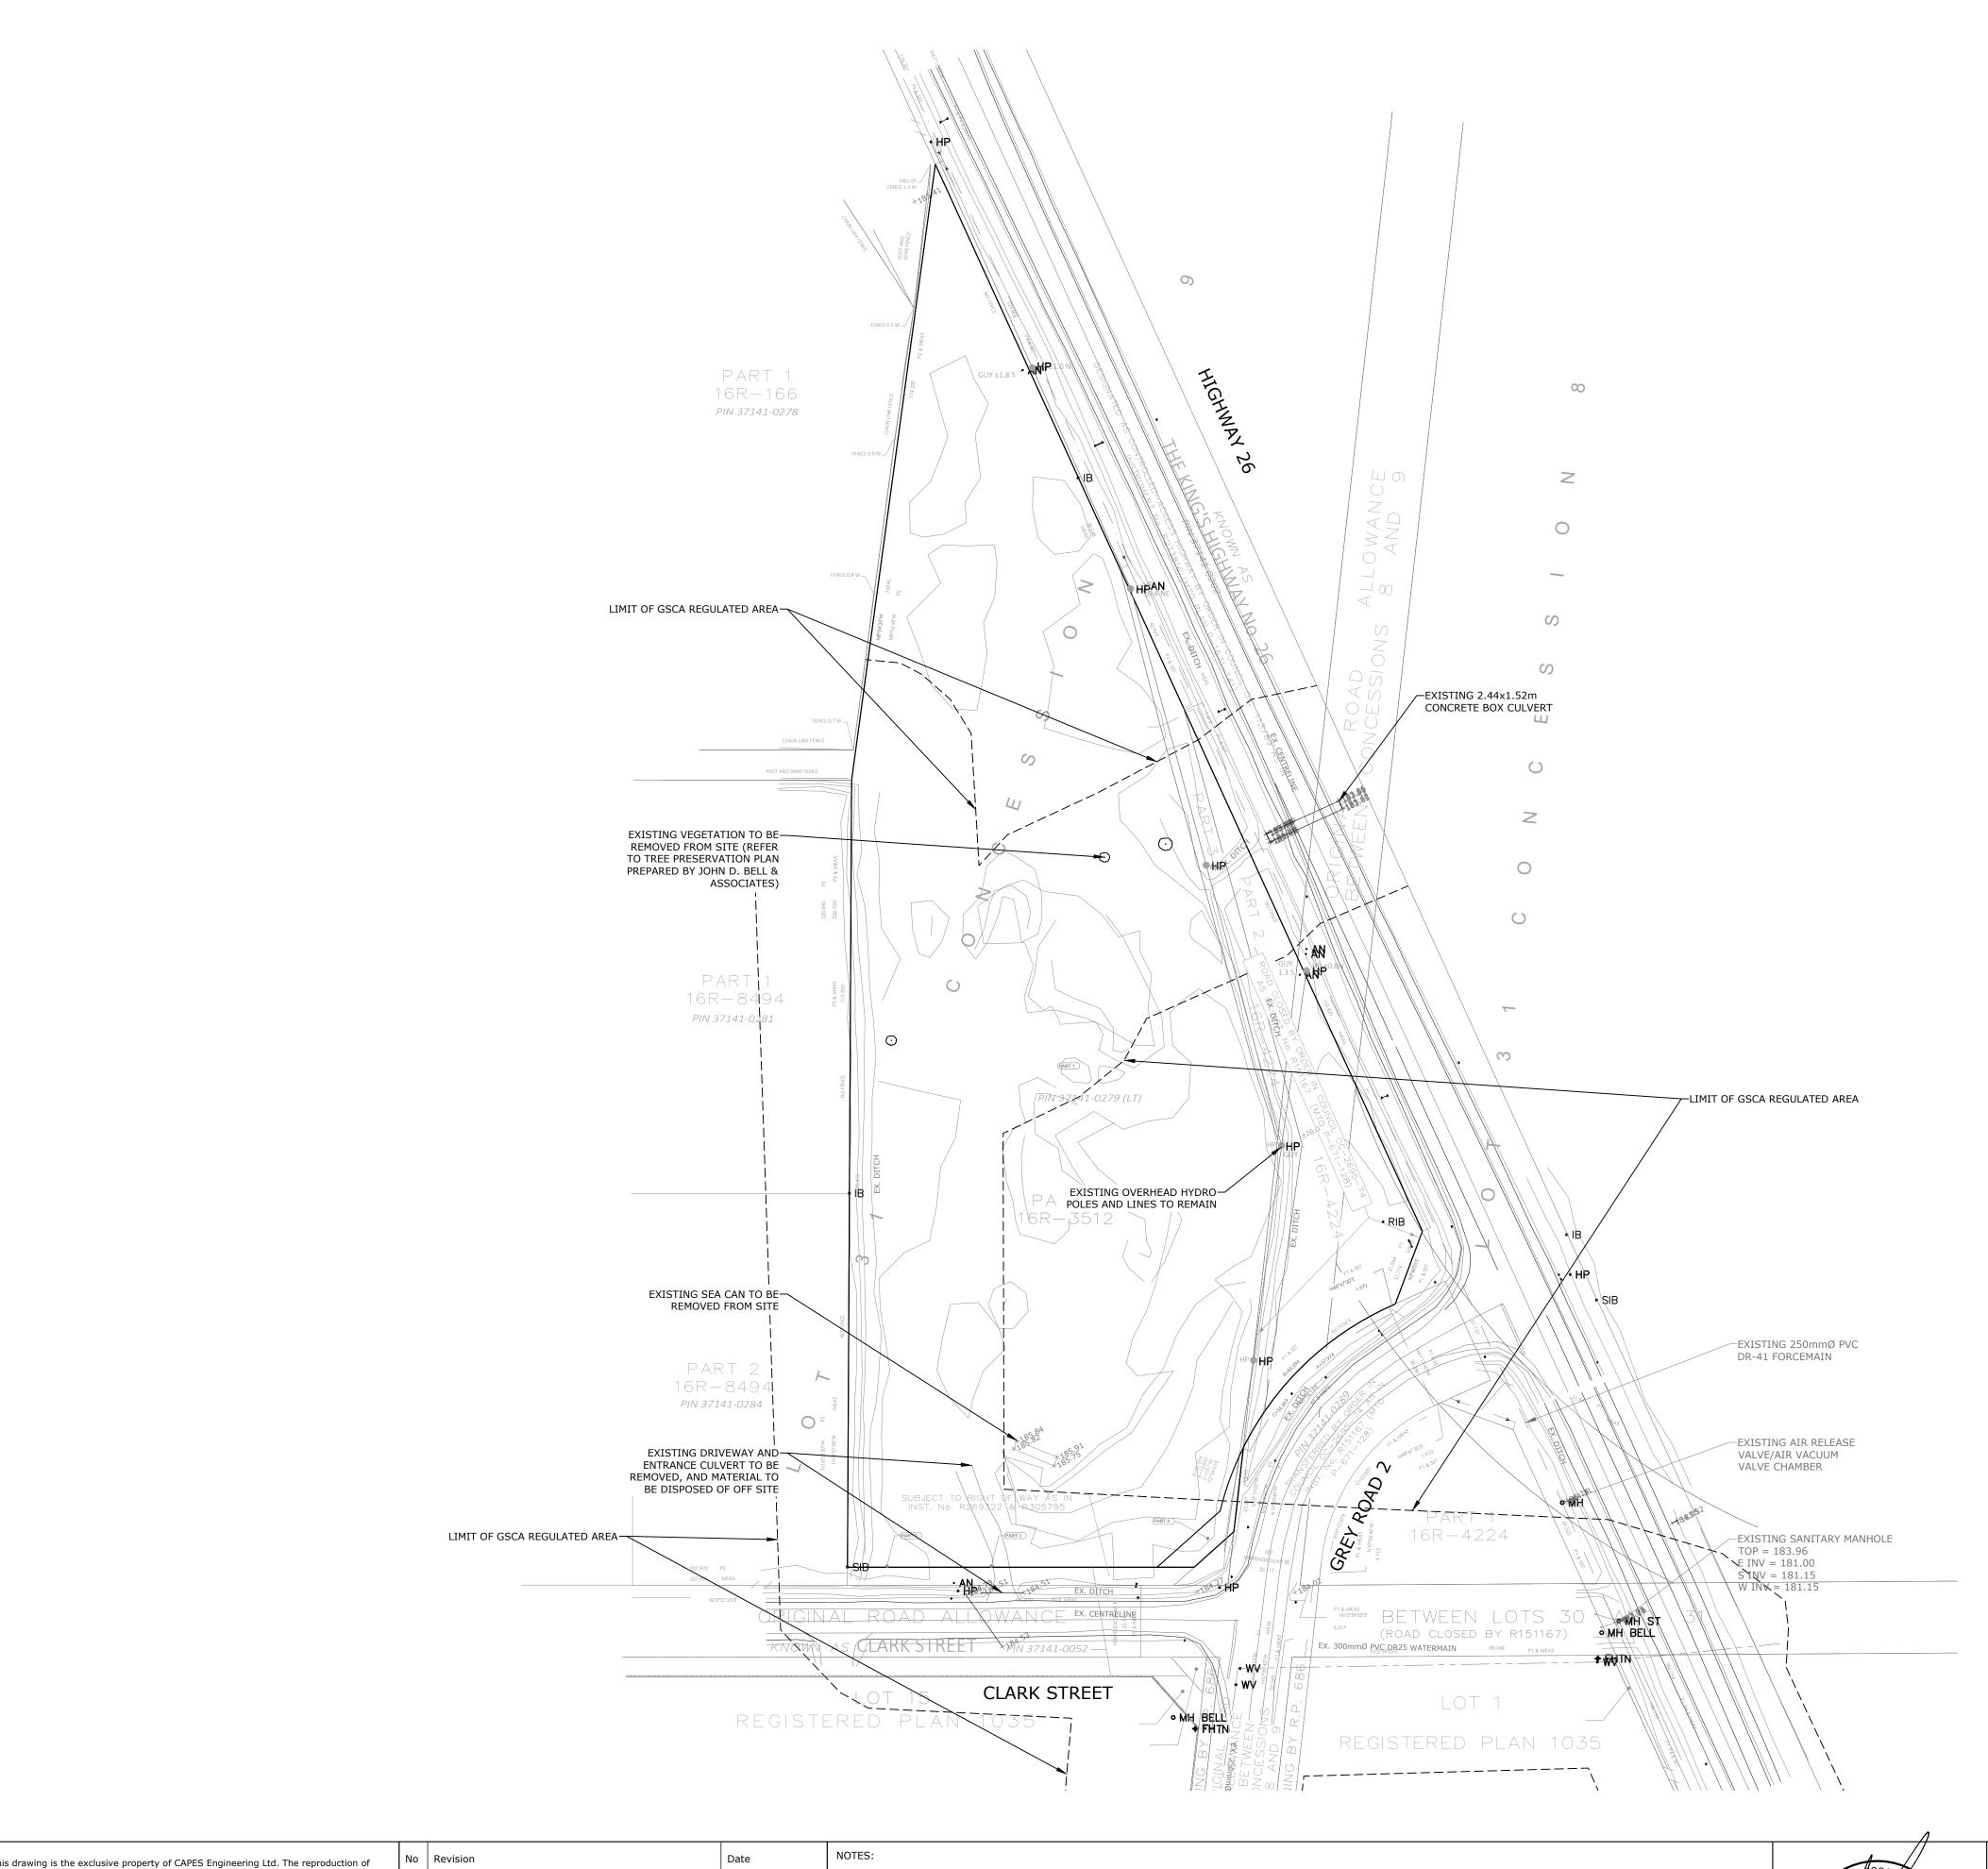

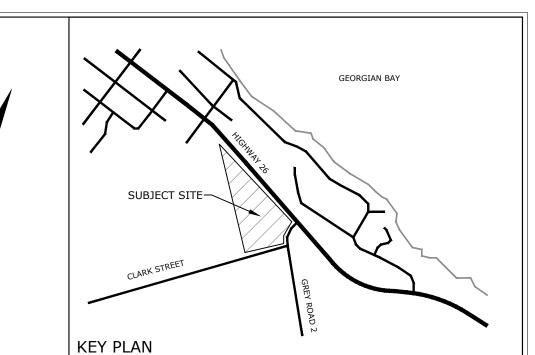

This drawing is the exclusive property of CAPES Engineering Ltd. The reproduction of any part without express written consent of this Corporation is strictly prohibited.
 The contractor shall verify all dimensions, levels, and datums on site and report any

discrepancies or omissions to CAPES Engineering Ltd. prior to construction.


3. This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.

No	Revision	Date
1	ISSUED FOR APPROVALS	22/12/08
2	REVISED FOR APPROVALS	23/12/07
3	REVISED FOR APPROVALS	24/06/28
4	REVISED FOR APPROVALS	24/11/14

TOPOGRAPHIC SURVEY PREPARED BY SMC GEOMATICS, ELEVATIONS SHOWN ARE GEODETIC

BENCHMARK: NAIL IN HYDRO POLE AT SOUTH END OF SUBJECT SITE, ELEVATION 185.392

BOUNDARY CONDITIONS SHOWN INTERPRETED FROM PLAN PREPARED BY VAN HARTEN SURVEYING INC., AND SHOWN APPROXIMATELY HEREIN. THIS IS NOT A PLAN OF SURVEY, AND CANNOT BE USED TO DEFINE SITE BOUNDARY CONDITIONS



PANTONE CAPITAL INC.


Lot 31 Clark St. Site Plan


EXISTING CONDITIONS AND REMOVAL PLAN


CAPES


355310 BLUE MOUNTAINS - EUPHRASIA TOWNLINE
CLARKSBURG, ON NOH 1JO
WWW.CAPESENGINEERING.COM


Designed		Checked		Date	Drawing No.
K. GRIFFIN		C. CAPES		22/08/09	
Project No.				Rev No.	
2021-185				4	
Scale	0	20	40	60m	-

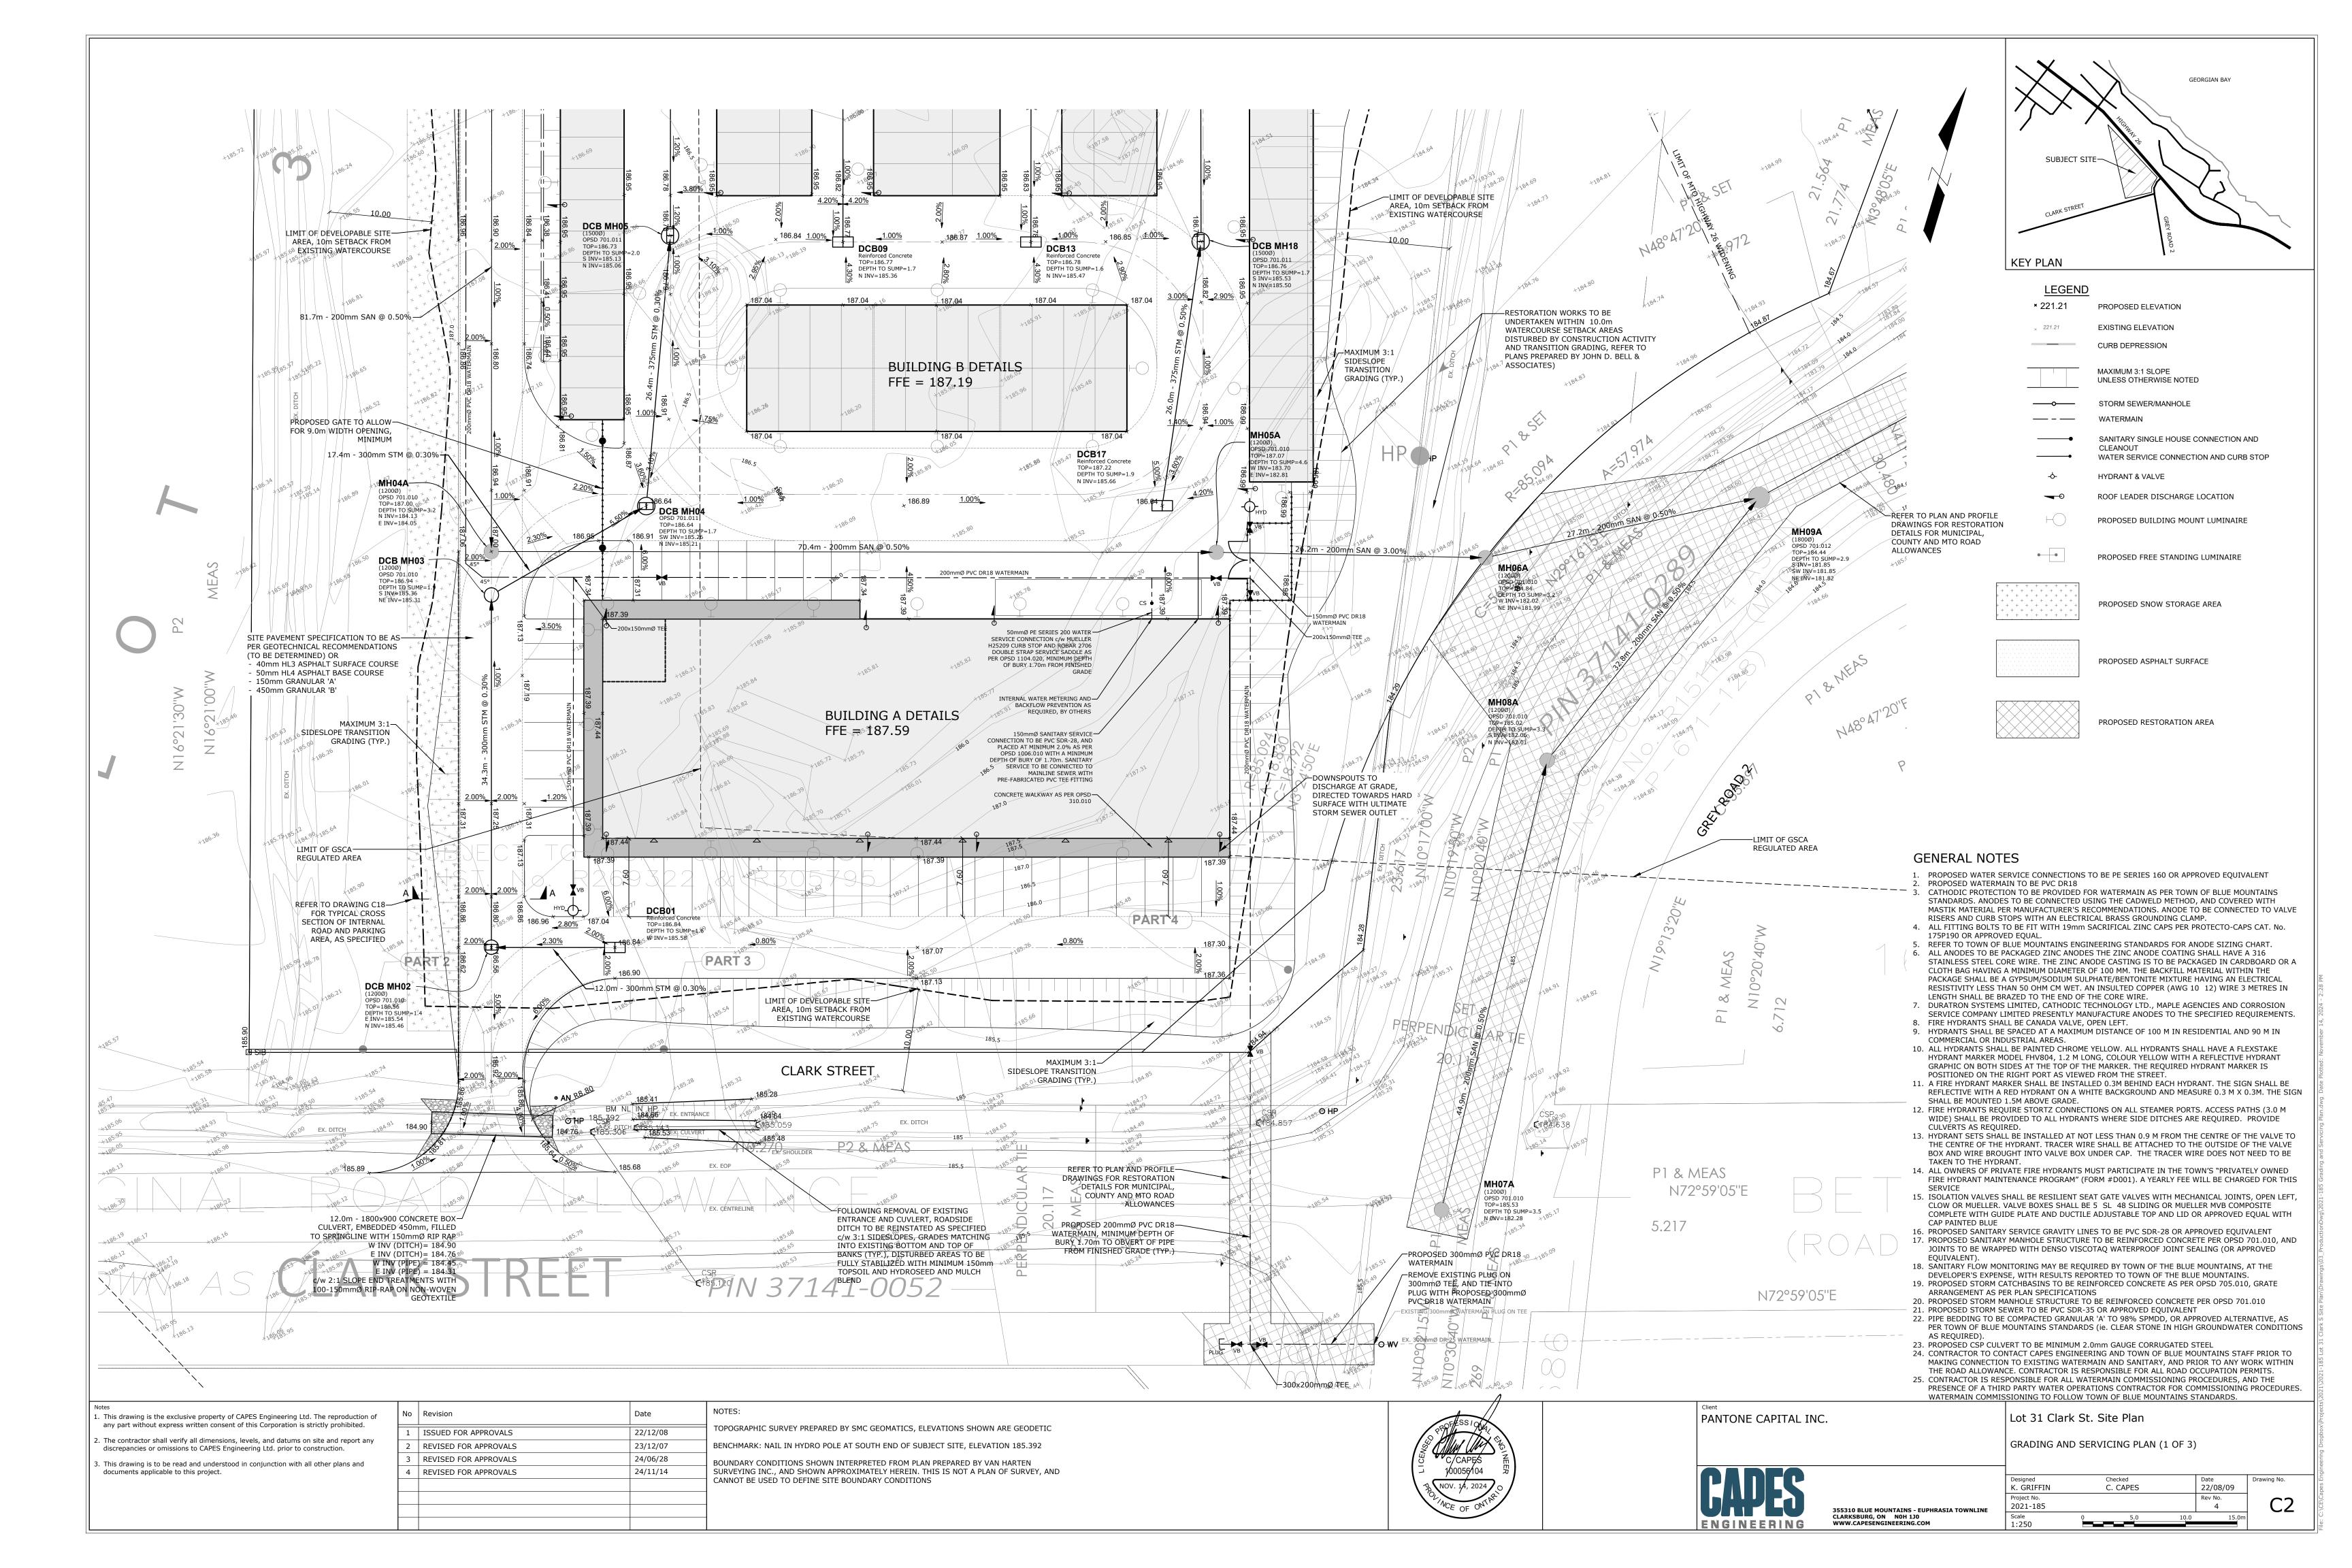

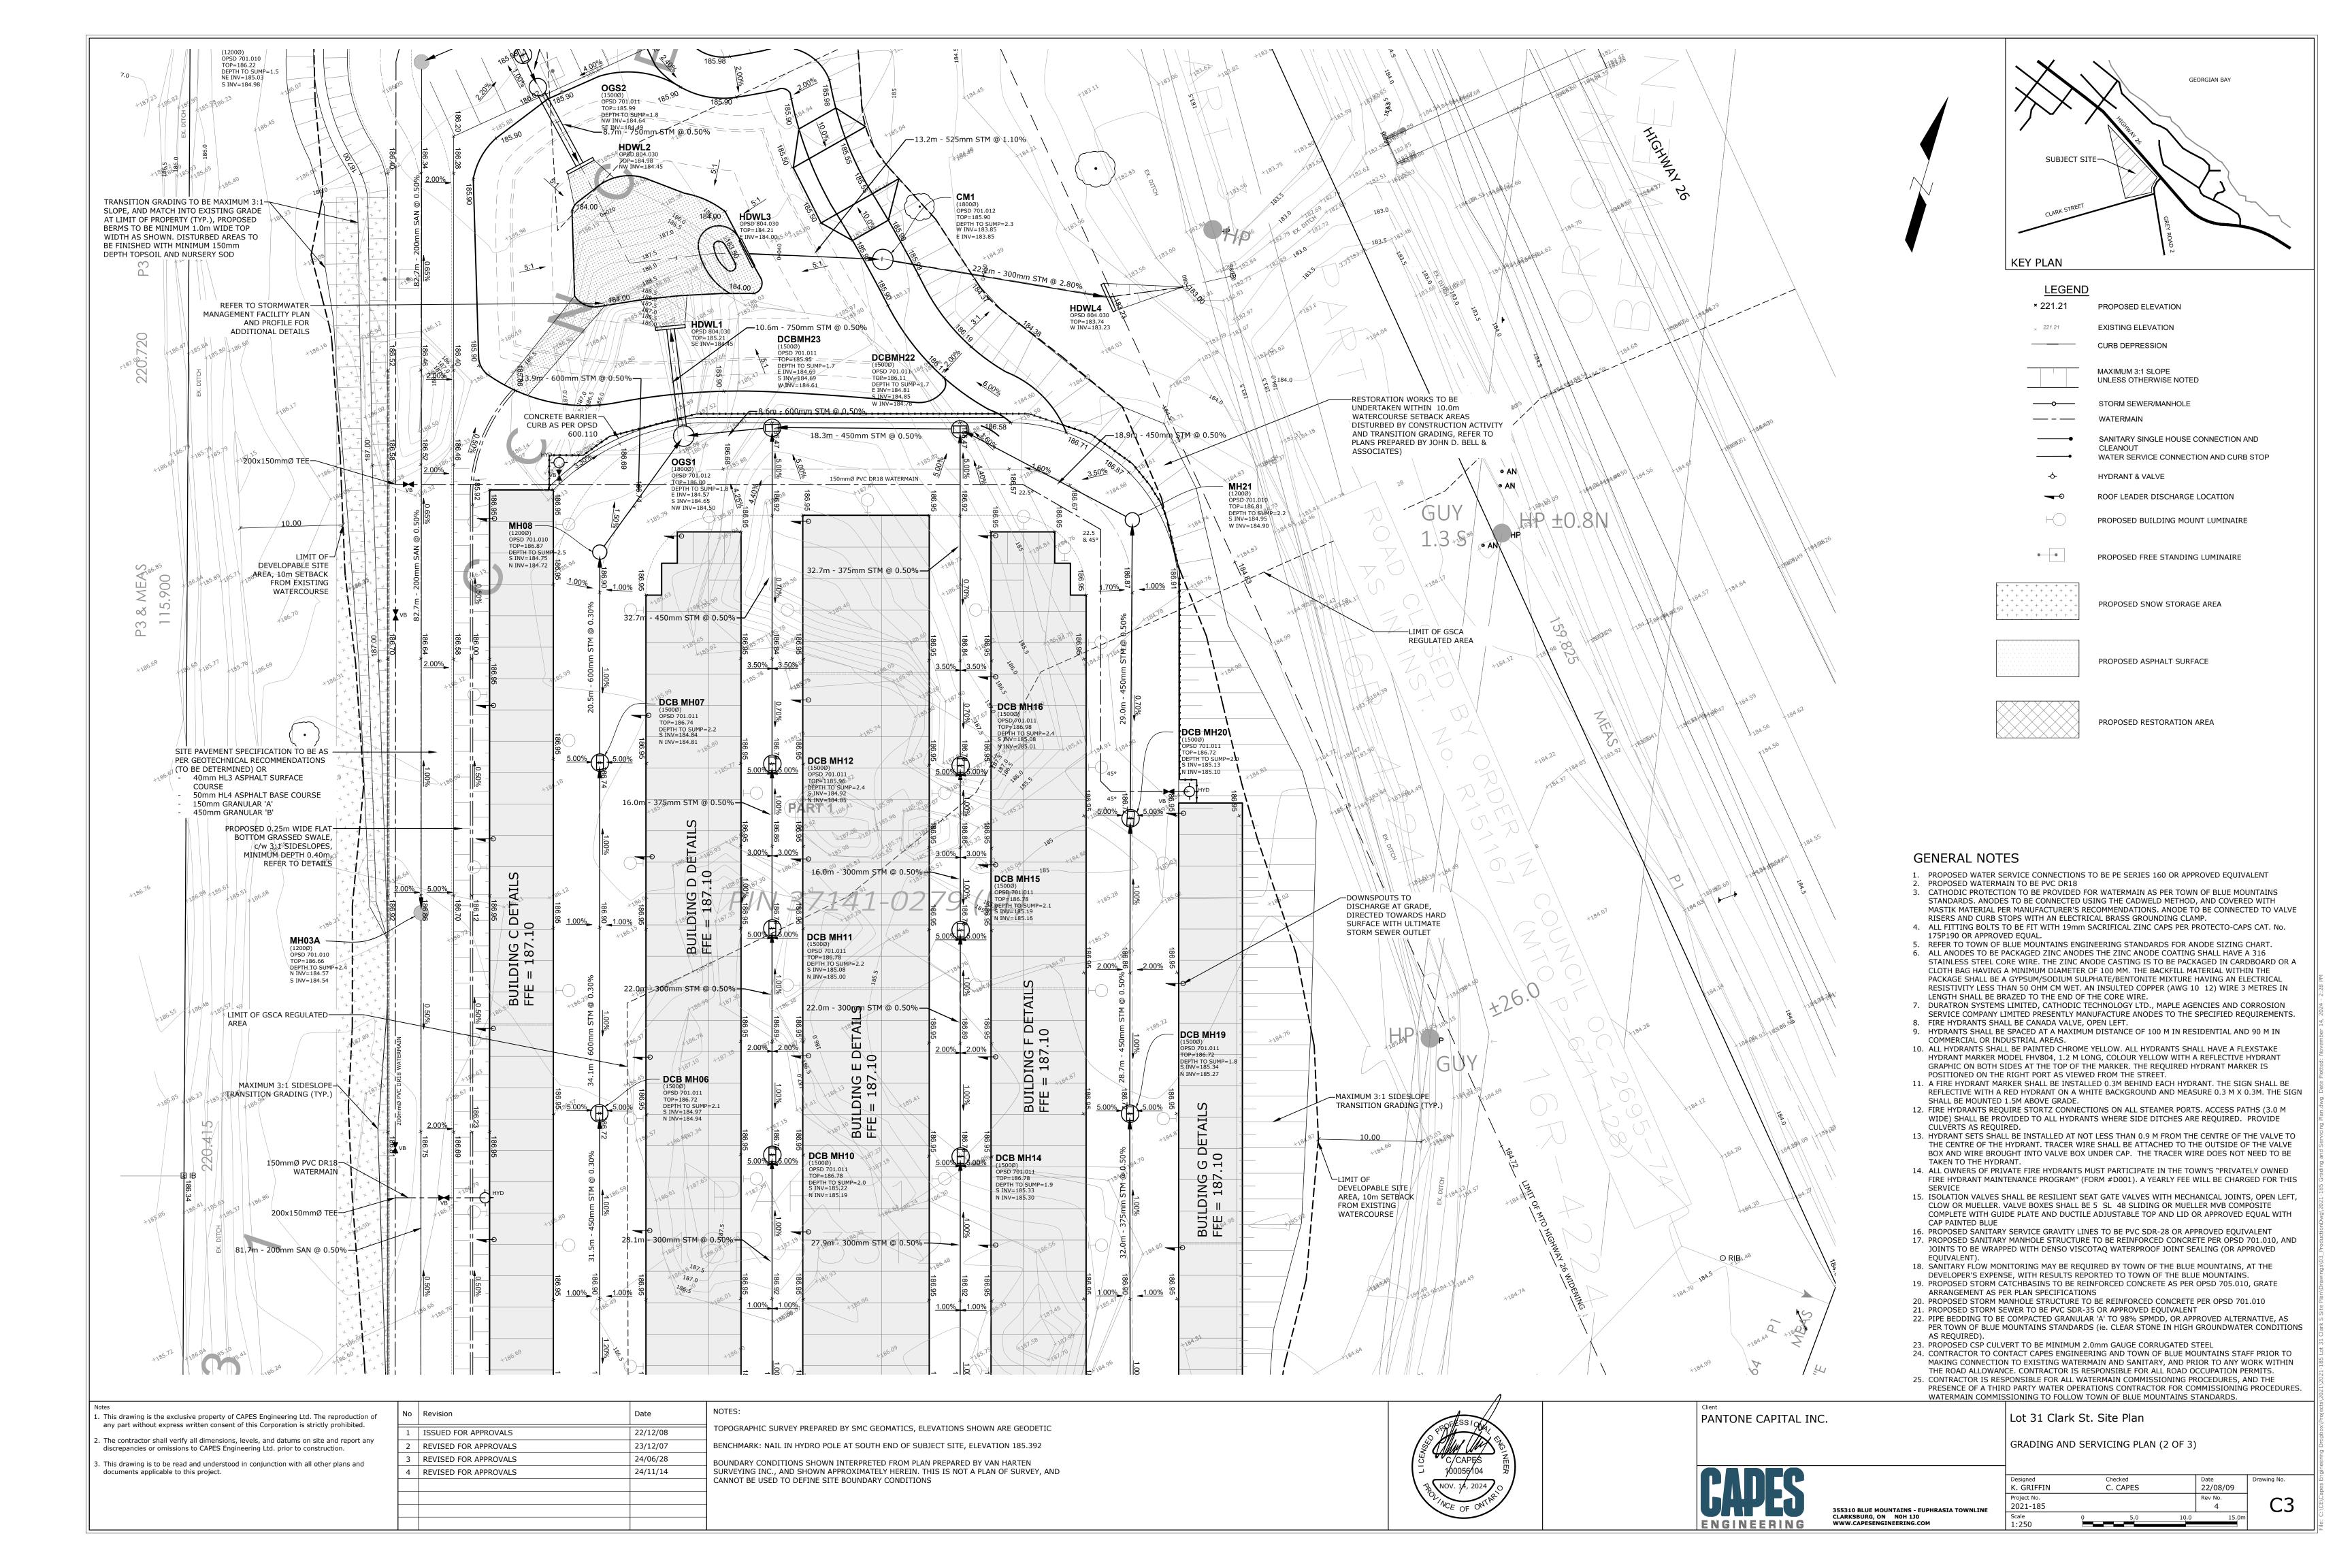

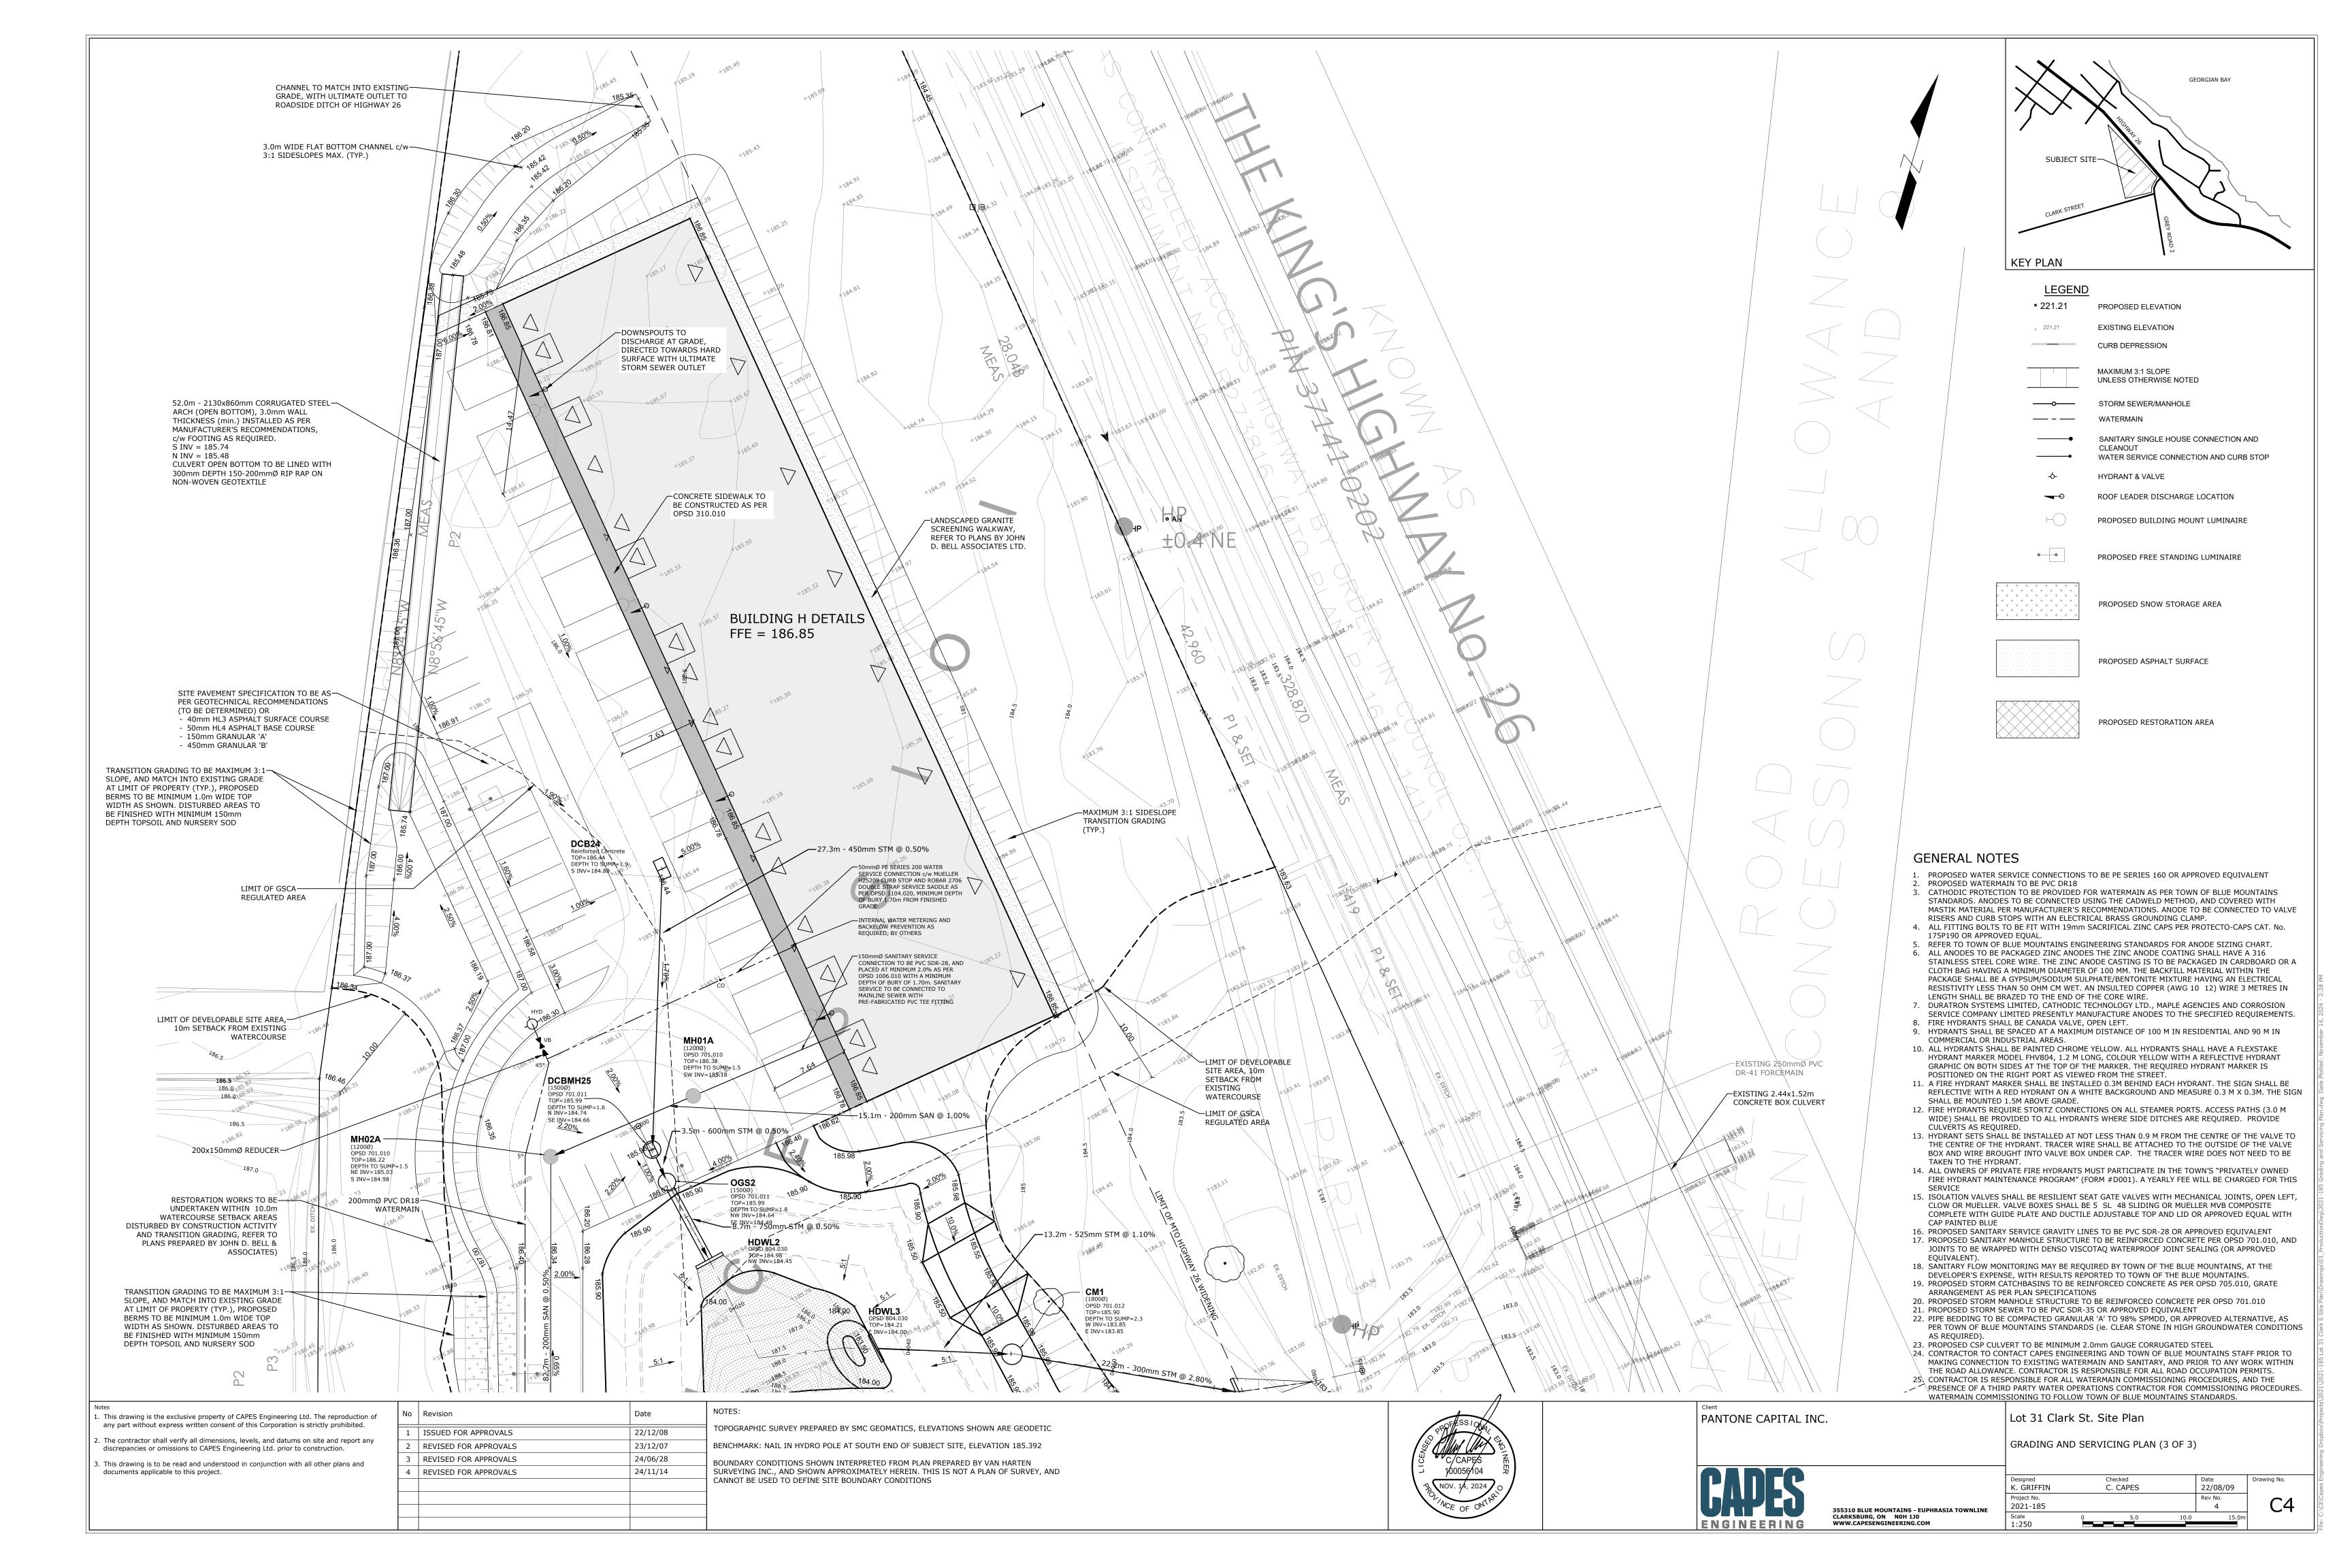

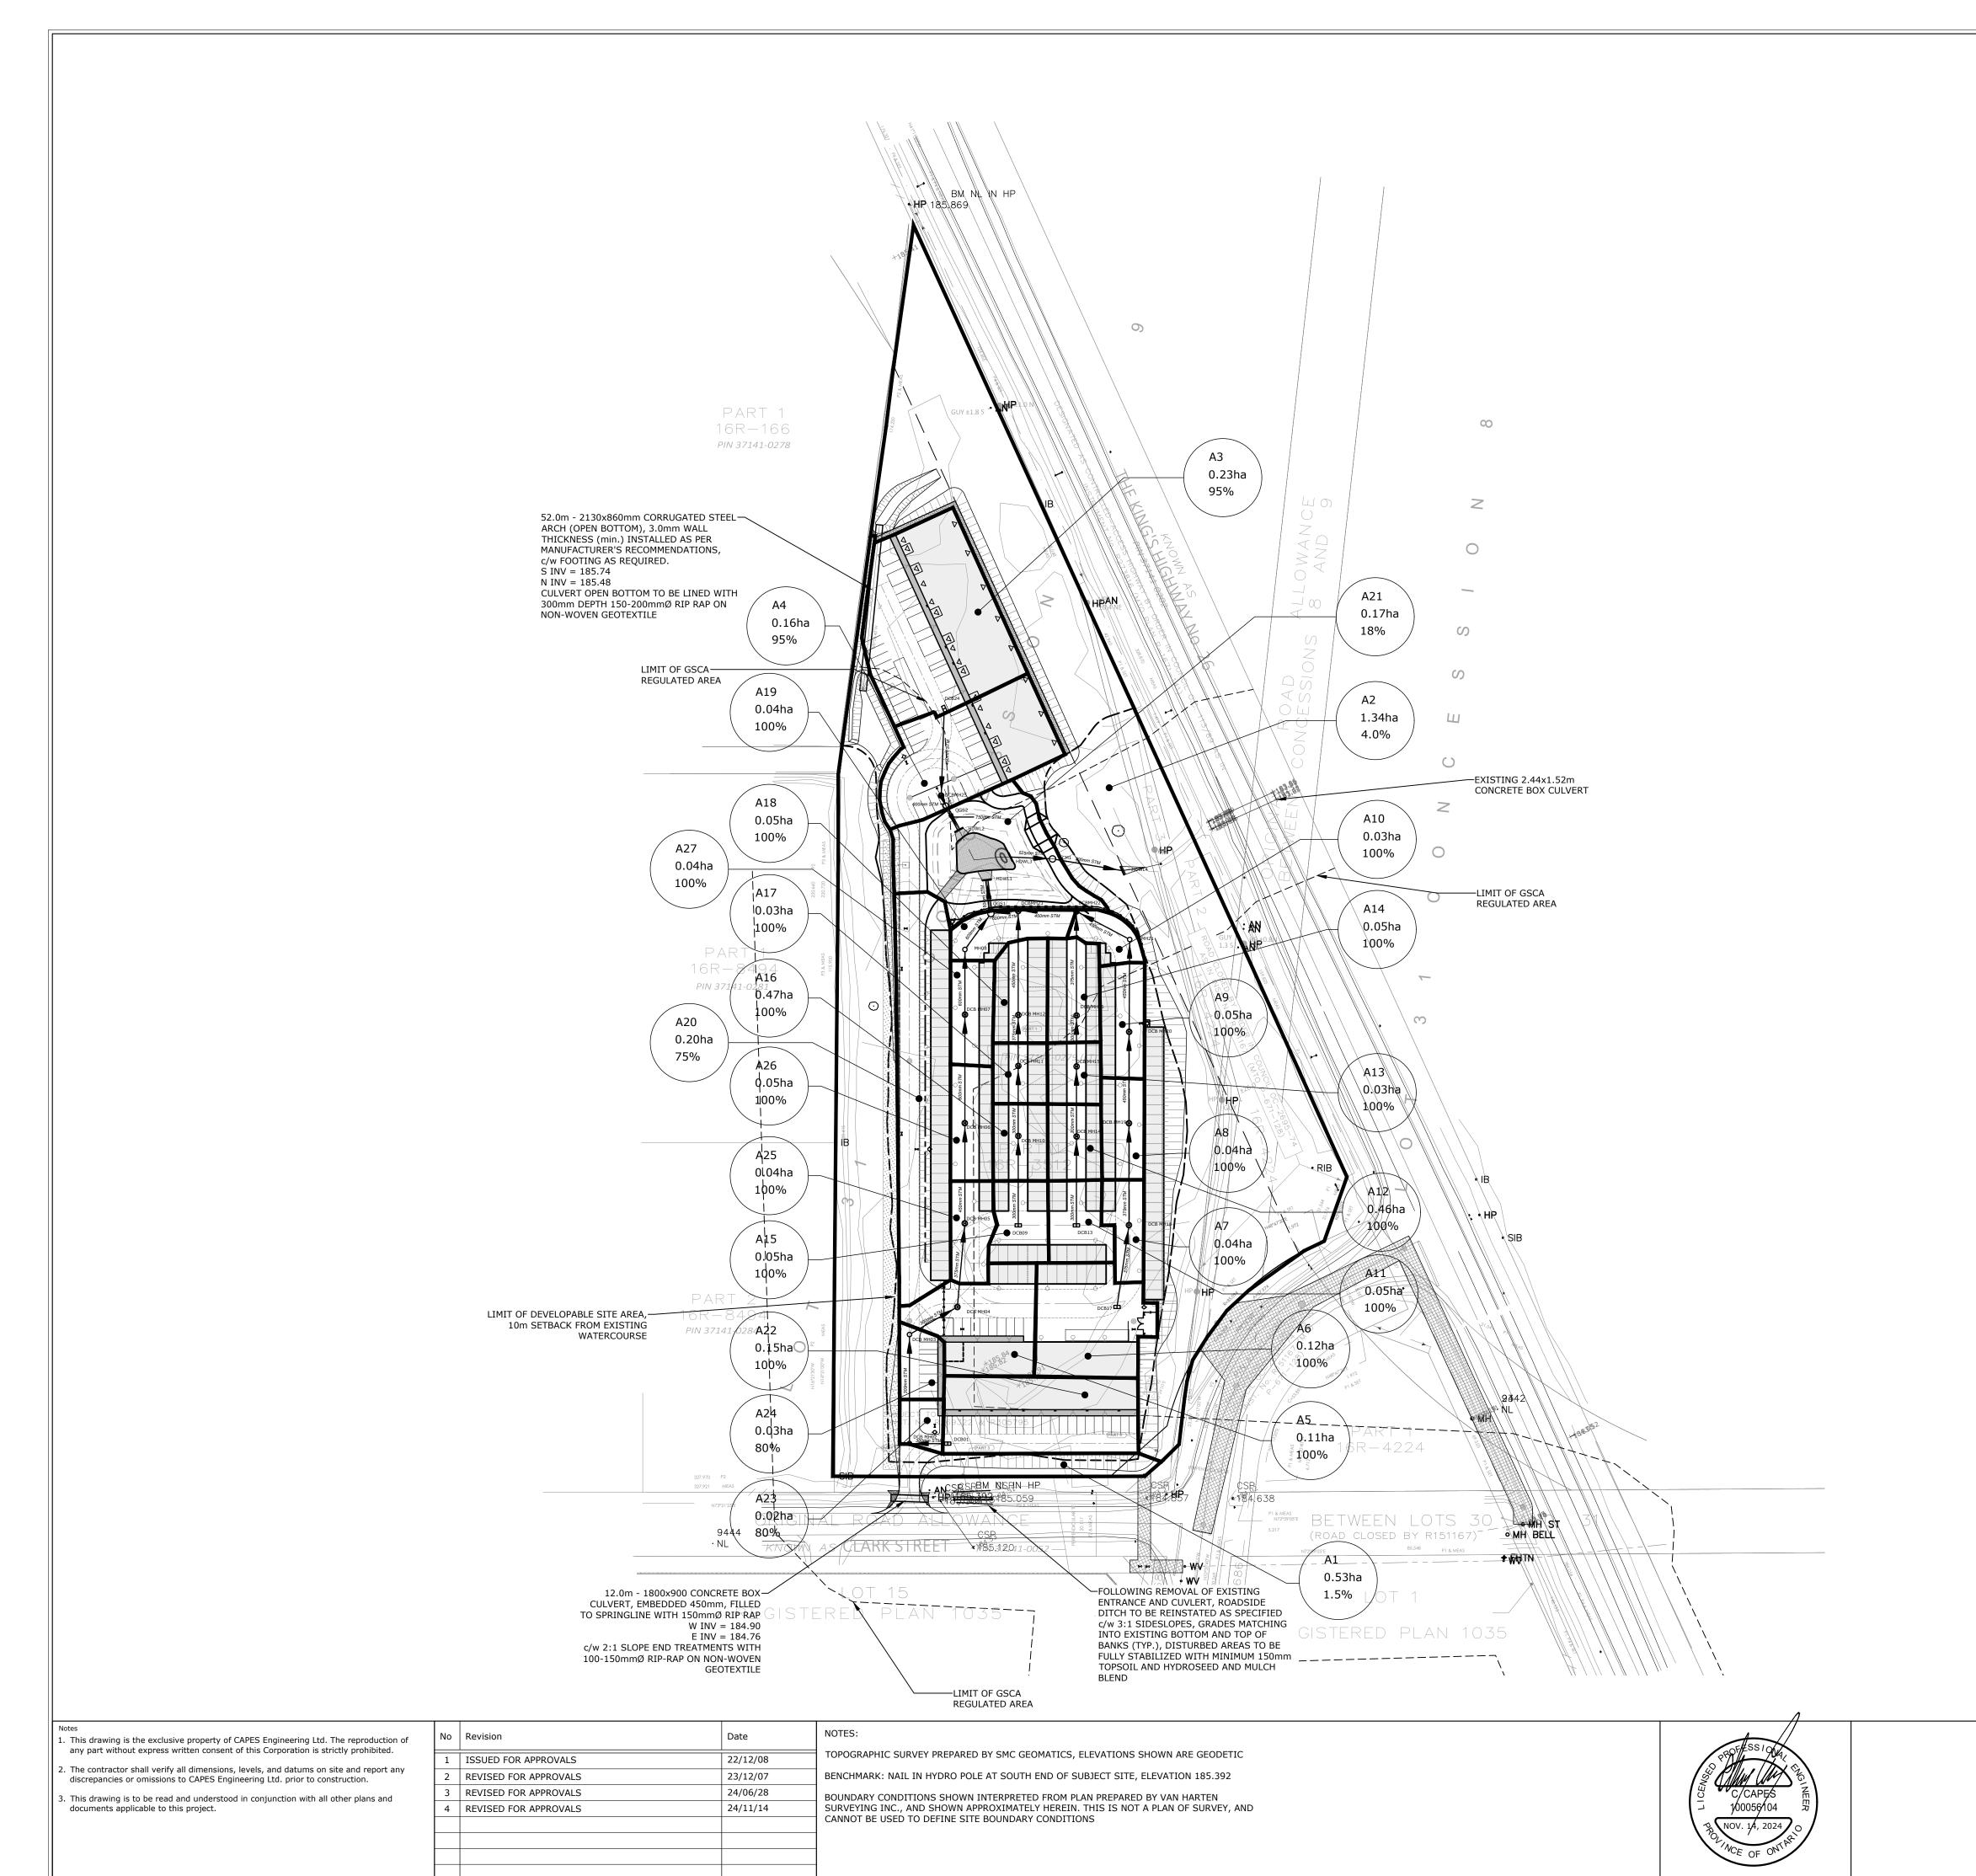

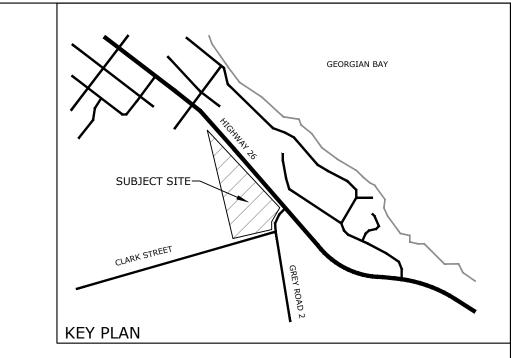

LEGEND

DRAINAGE AREA ID

0.68ha — DRAINAGE AREA, HECTARES
100% — % IMPERVIOUS

DRAINAGE AREA BOUNDARY


PANTONE CAPITAL INC.


Lot 31 Clark St. Site Plan

POST DEVELOPMENT DRAINAGE AREA PLAN



355310 BLUE MOUNTAINS - EUPHRASIA TOWNLINE CLARKSBURG, ON NOH 1J0 WWW.CAPESENGINEERING.COM

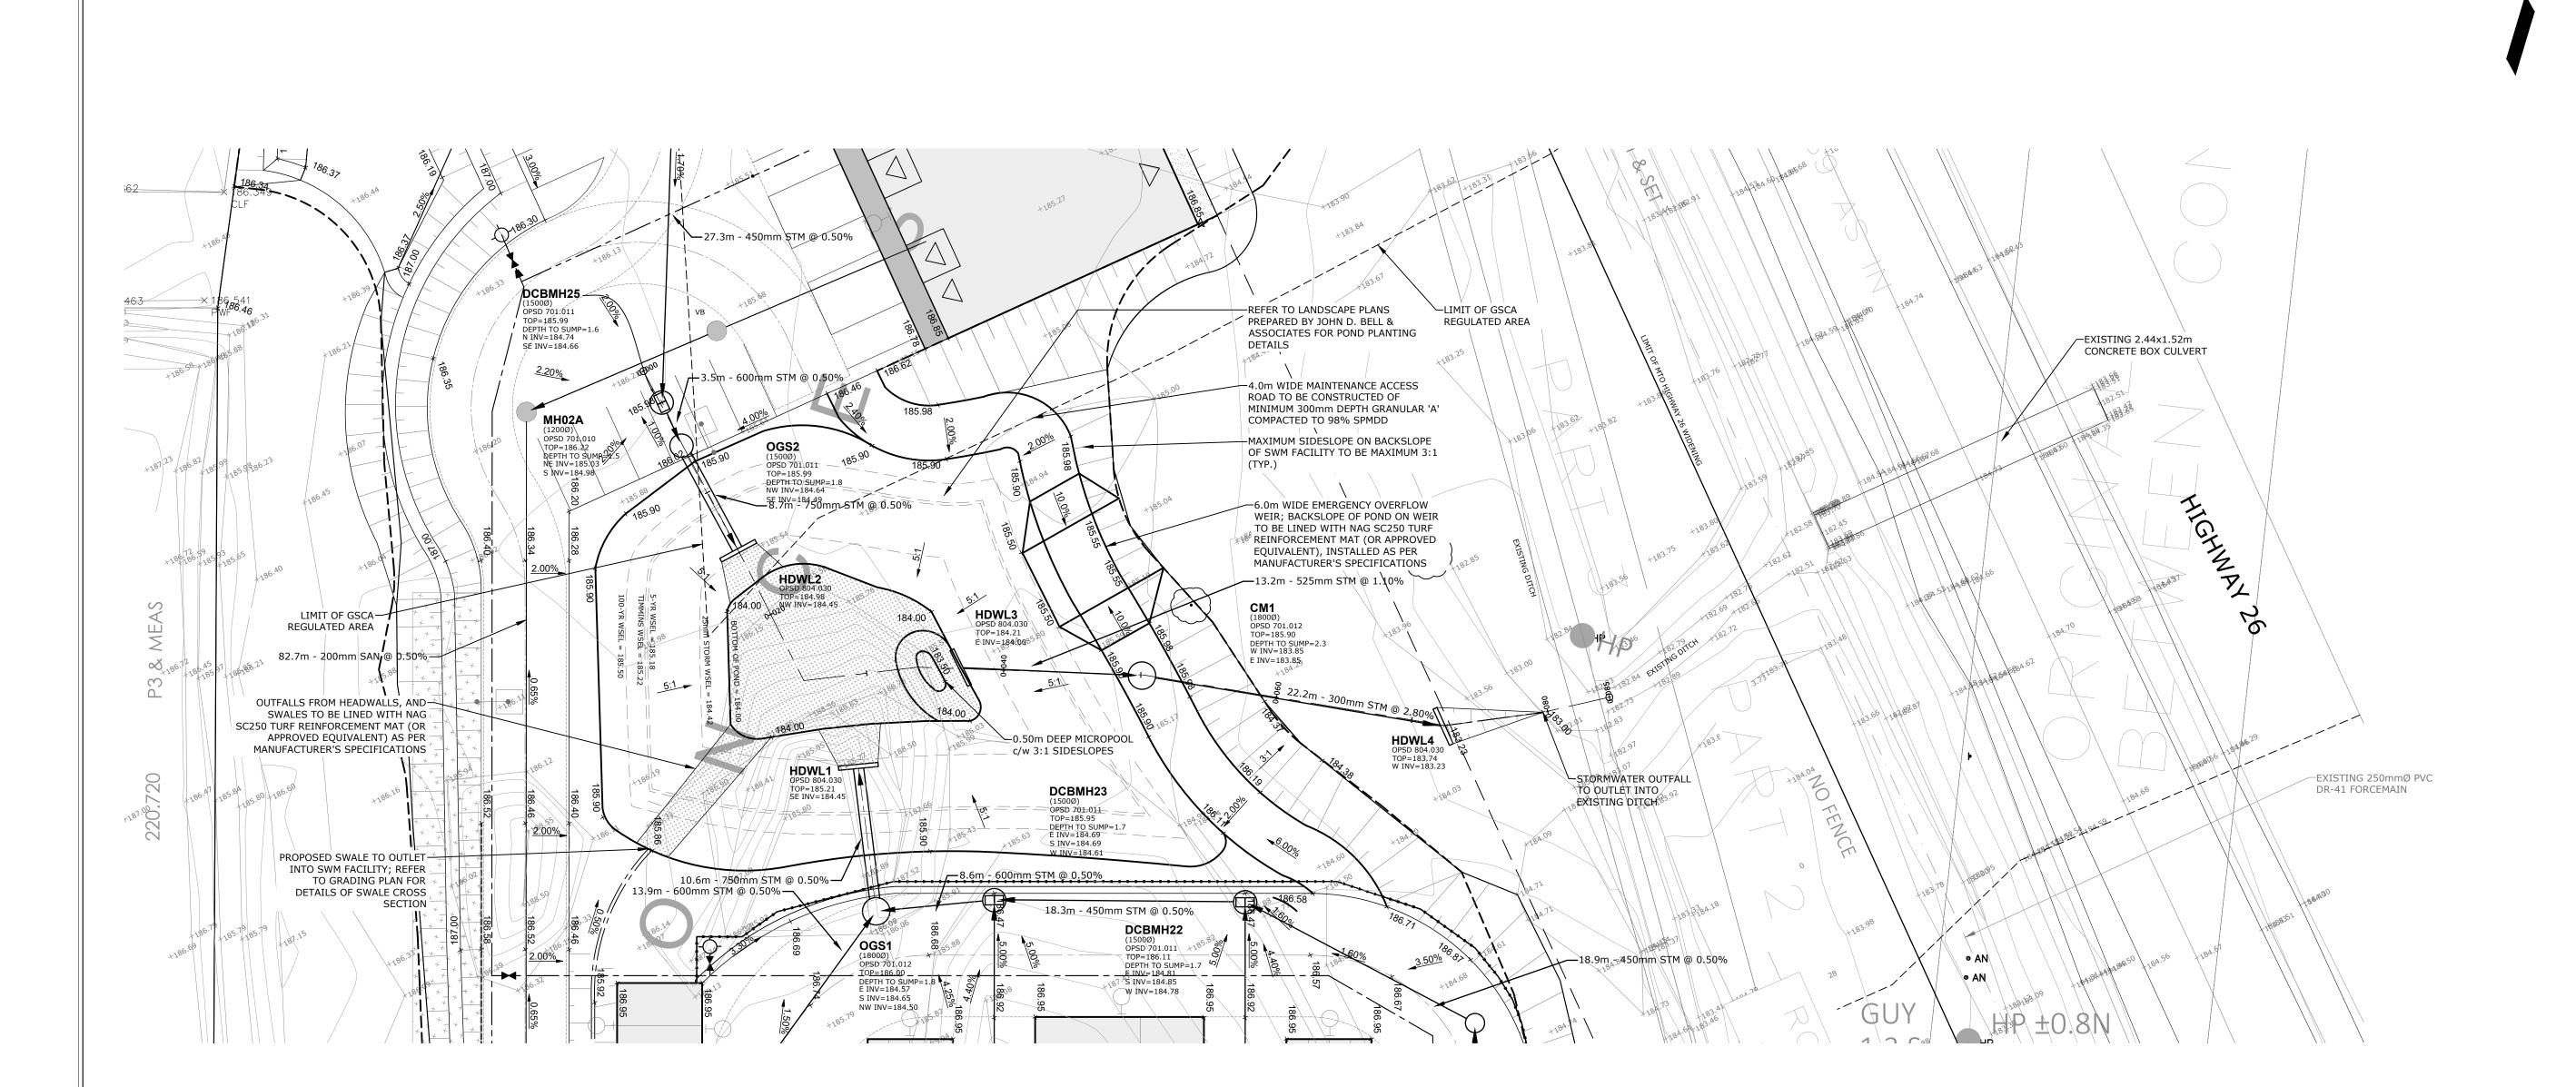

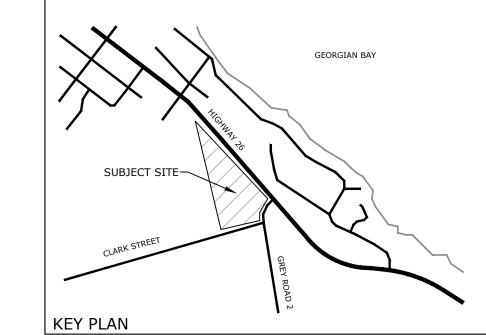

KET PLAIN	
LEGEND	
× 221.21	PROPOSED ELEVATION
× 221.21	EXISTING ELEVATION
	CURB DEPRESSION
	MAXIMUM 3:1 SLOPE UNLESS OTHERWISE NOTED
	STORM SEWER/MANHOLE
	WATERMAIN
	SANITARY SINGLE HOUSE CONNECTION AND CLEANOUT
	WATER SERVICE CONNECTION AND CURB STOP

- HYDRANT & VALVE

This drawing is the exclusive property of CAPES Engineering Ltd. The reproduction of any part without express written consent of this Corporation is strictly prohibited.
 The contractor shall verify all dimensions, levels, and datums on site and report any

discrepancies or omissions to CAPES Engineering Ltd. prior to construction.

3. This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.


f	No	Revision	Date
	1	ISSUED FOR APPROVALS	22/12/08
	2	REVISED FOR APPROVALS	23/12/07
	3	REVISED FOR APPROVALS	24/06/28
	4	REVISED FOR APPROVALS	24/11/14

NOTES:

TOPOGRAPHIC SURVEY PREPARED BY SMC GEOMATICS, ELEVATIONS SHOWN ARE GEODETIC

BENCHMARK: NAIL IN HYDRO POLE AT SOUTH END OF SUBJECT SITE, ELEVATION 185.392

BOUNDARY CONDITIONS SHOWN INTERPRETED FROM PLAN PREPARED BY VAN HARTEN SURVEYING INC., AND SHOWN APPROXIMATELY HEREIN. THIS IS NOT A PLAN OF SURVEY, AND CANNOT BE USED TO DEFINE SITE BOUNDARY CONDITIONS



PANTONE CAPITAL INC.


Lot 31 Clark St. Site Plan
STORMWATER MANAGEMENT FACILITY PLAN





Designed K. GRIFFIN		Checked C. CAPES		Date 22/08/09
Project No.				Rev No.
2021-185				4
Scale	0	5.0	10.0	15.0
1:250				


C6


Drawing No.

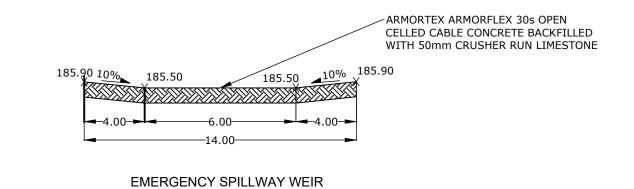



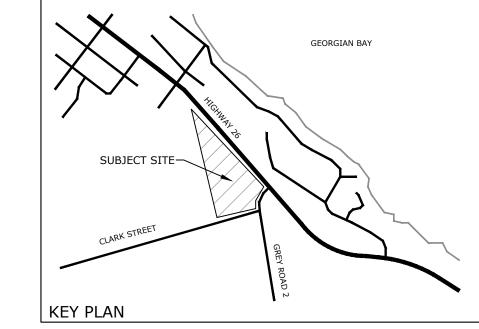

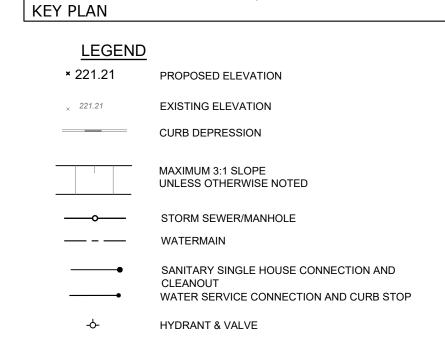

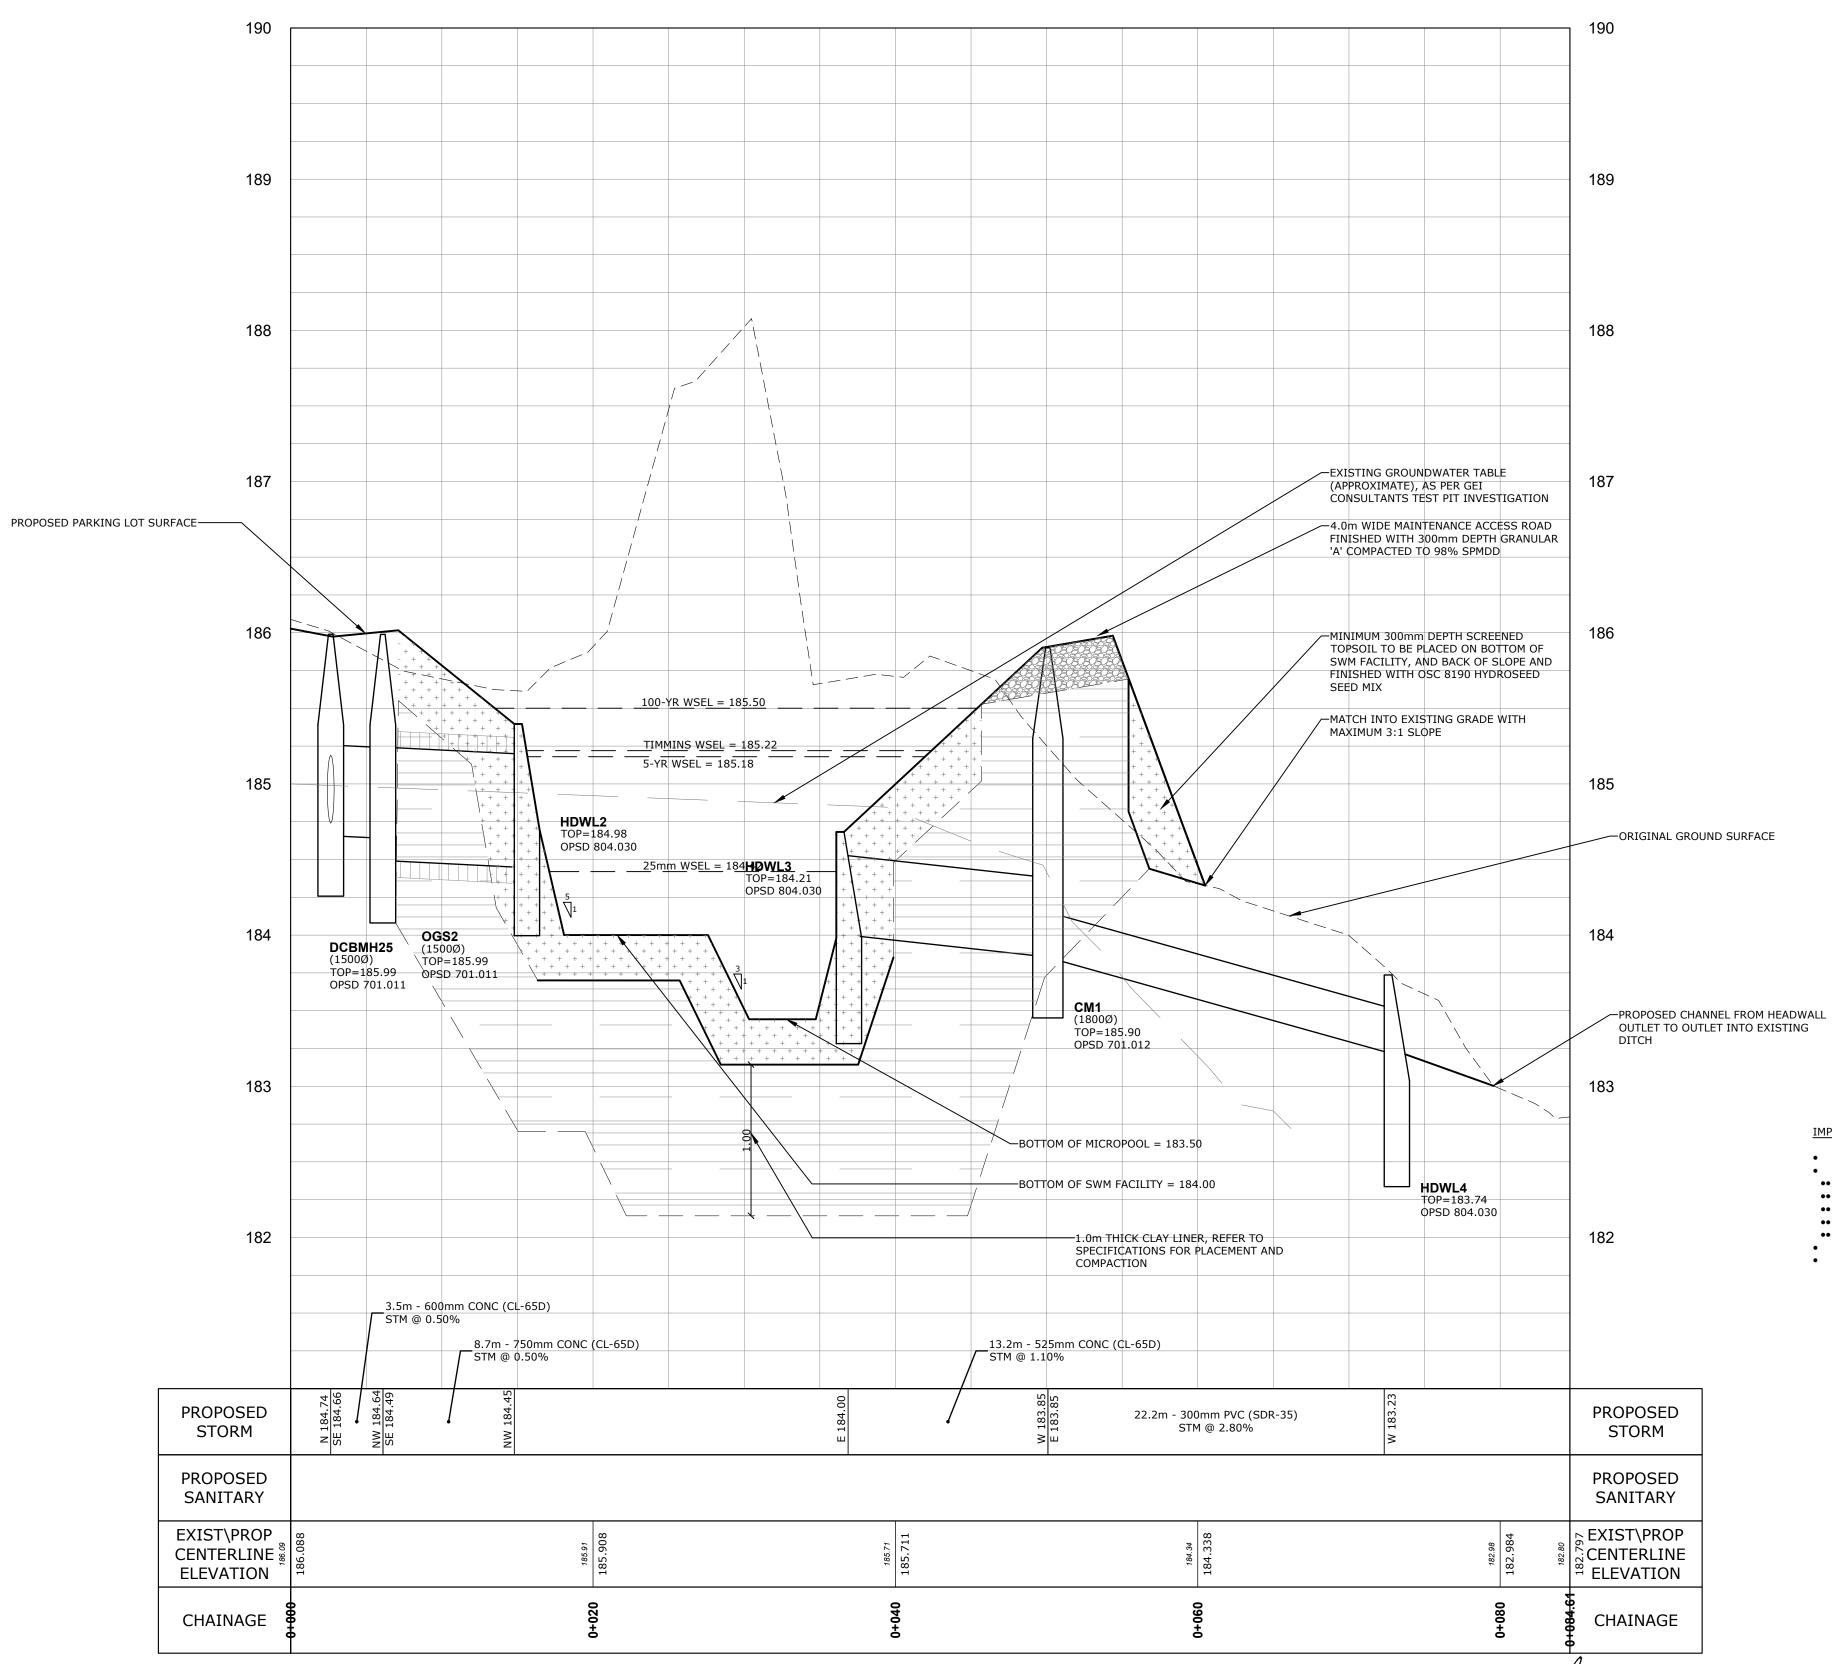


IMPORTED CLAY LINER DESIGN NOTES

- MATERIAL USED FOR POND LINER TO HAVE BULK PERMEABILITY ON THE ORDER OF 10-9 m/s OR LOWER GRAIN SIZE DISTRIBUTION OF THE CLAY LINER MUST CONFORM TO:
- NO PARTICLE GREATER THAN 100mm DIMENSION
 NOT GREATER THAN 15% OF THE MATERIAL LARFER THE 4.75mm (No. 4 SIEVE)
- MINIMUM 35% OF THE MATERIAL FINER THAN 0.075mm (ie. PASSING No. 200 SIEVE)
- MINIMUM 15% FINER THAN 0.002mm (CLAY SIZE)
- NOT GREATER THAN 5% ORGANIC CONTENT, NO VISIBLE ROOTS OR TOPSOIL
 LINER MATERIAL TO BE PLACED AT WATER CONTENT 2 TO 3 PERCENT WET OF THE OPTIMUM MOISTURE CONTENT
- LINER TO BE CONSTRUCTED IN LIFTS NOT EXCEEDING 150mm THICK, AND BE COMPACTED TO A MINIMUM 95% SPMDD UNDER FULL TIME INSPECTION OF A GEOTECHNICAL ENGINEER.

	I. This drawing is the exclusive property of CAPES Engineering Ltd. The reproduction of any part without express written consent of this Corporation is strictly prohibited.		Revision	Date
		1	ISSUED FOR APPROVALS	22/12/08
	The contractor shall verify all dimensions, levels, and datums on site and report any discrepancies or omissions to CAPES Engineering Ltd. prior to construction.	2	REVISED FOR APPROVALS	23/12/07
3. This dra	3. This drawing is to be read and understood in conjunction with all other plans and	3	REVISED FOR APPROVALS	24/06/28
	documents applicable to this project.	4	REVISED FOR APPROVALS	24/11/14
		I		

NOTES: TOPOGRAPHIC SURVEY PREPARED BY SMC GEOMATICS, ELEVATIONS SHOWN ARE GEODETIC BENCHMARK: NAIL IN HYDRO POLE AT SOUTH END OF SUBJECT SITE, ELEVATION 185.392 BOUNDARY CONDITIONS SHOWN INTERPRETED FROM PLAN PREPARED BY VAN HARTEN SURVEYING INC., AND SHOWN APPROXIMATELY HEREIN. THIS IS NOT A PLAN OF SURVEY, AND

CANNOT BE USED TO DEFINE SITE BOUNDARY CONDITIONS



PANTONE CAPITAL INC.


Lot 31 Clark St. Site Plan


STORMWATER MANAGEMENT FACILITY PROFILE





355310 BLUE MOUNTAINS - EUPHRASIA TOWNLINE CLARKSBURG, ON NOH 1J0 WWW.CAPESENGINEERING.COM


Drawing No. K. GRIFFIN C. CAPES 22/08/09 2021-185 H 1:250 V 1:25

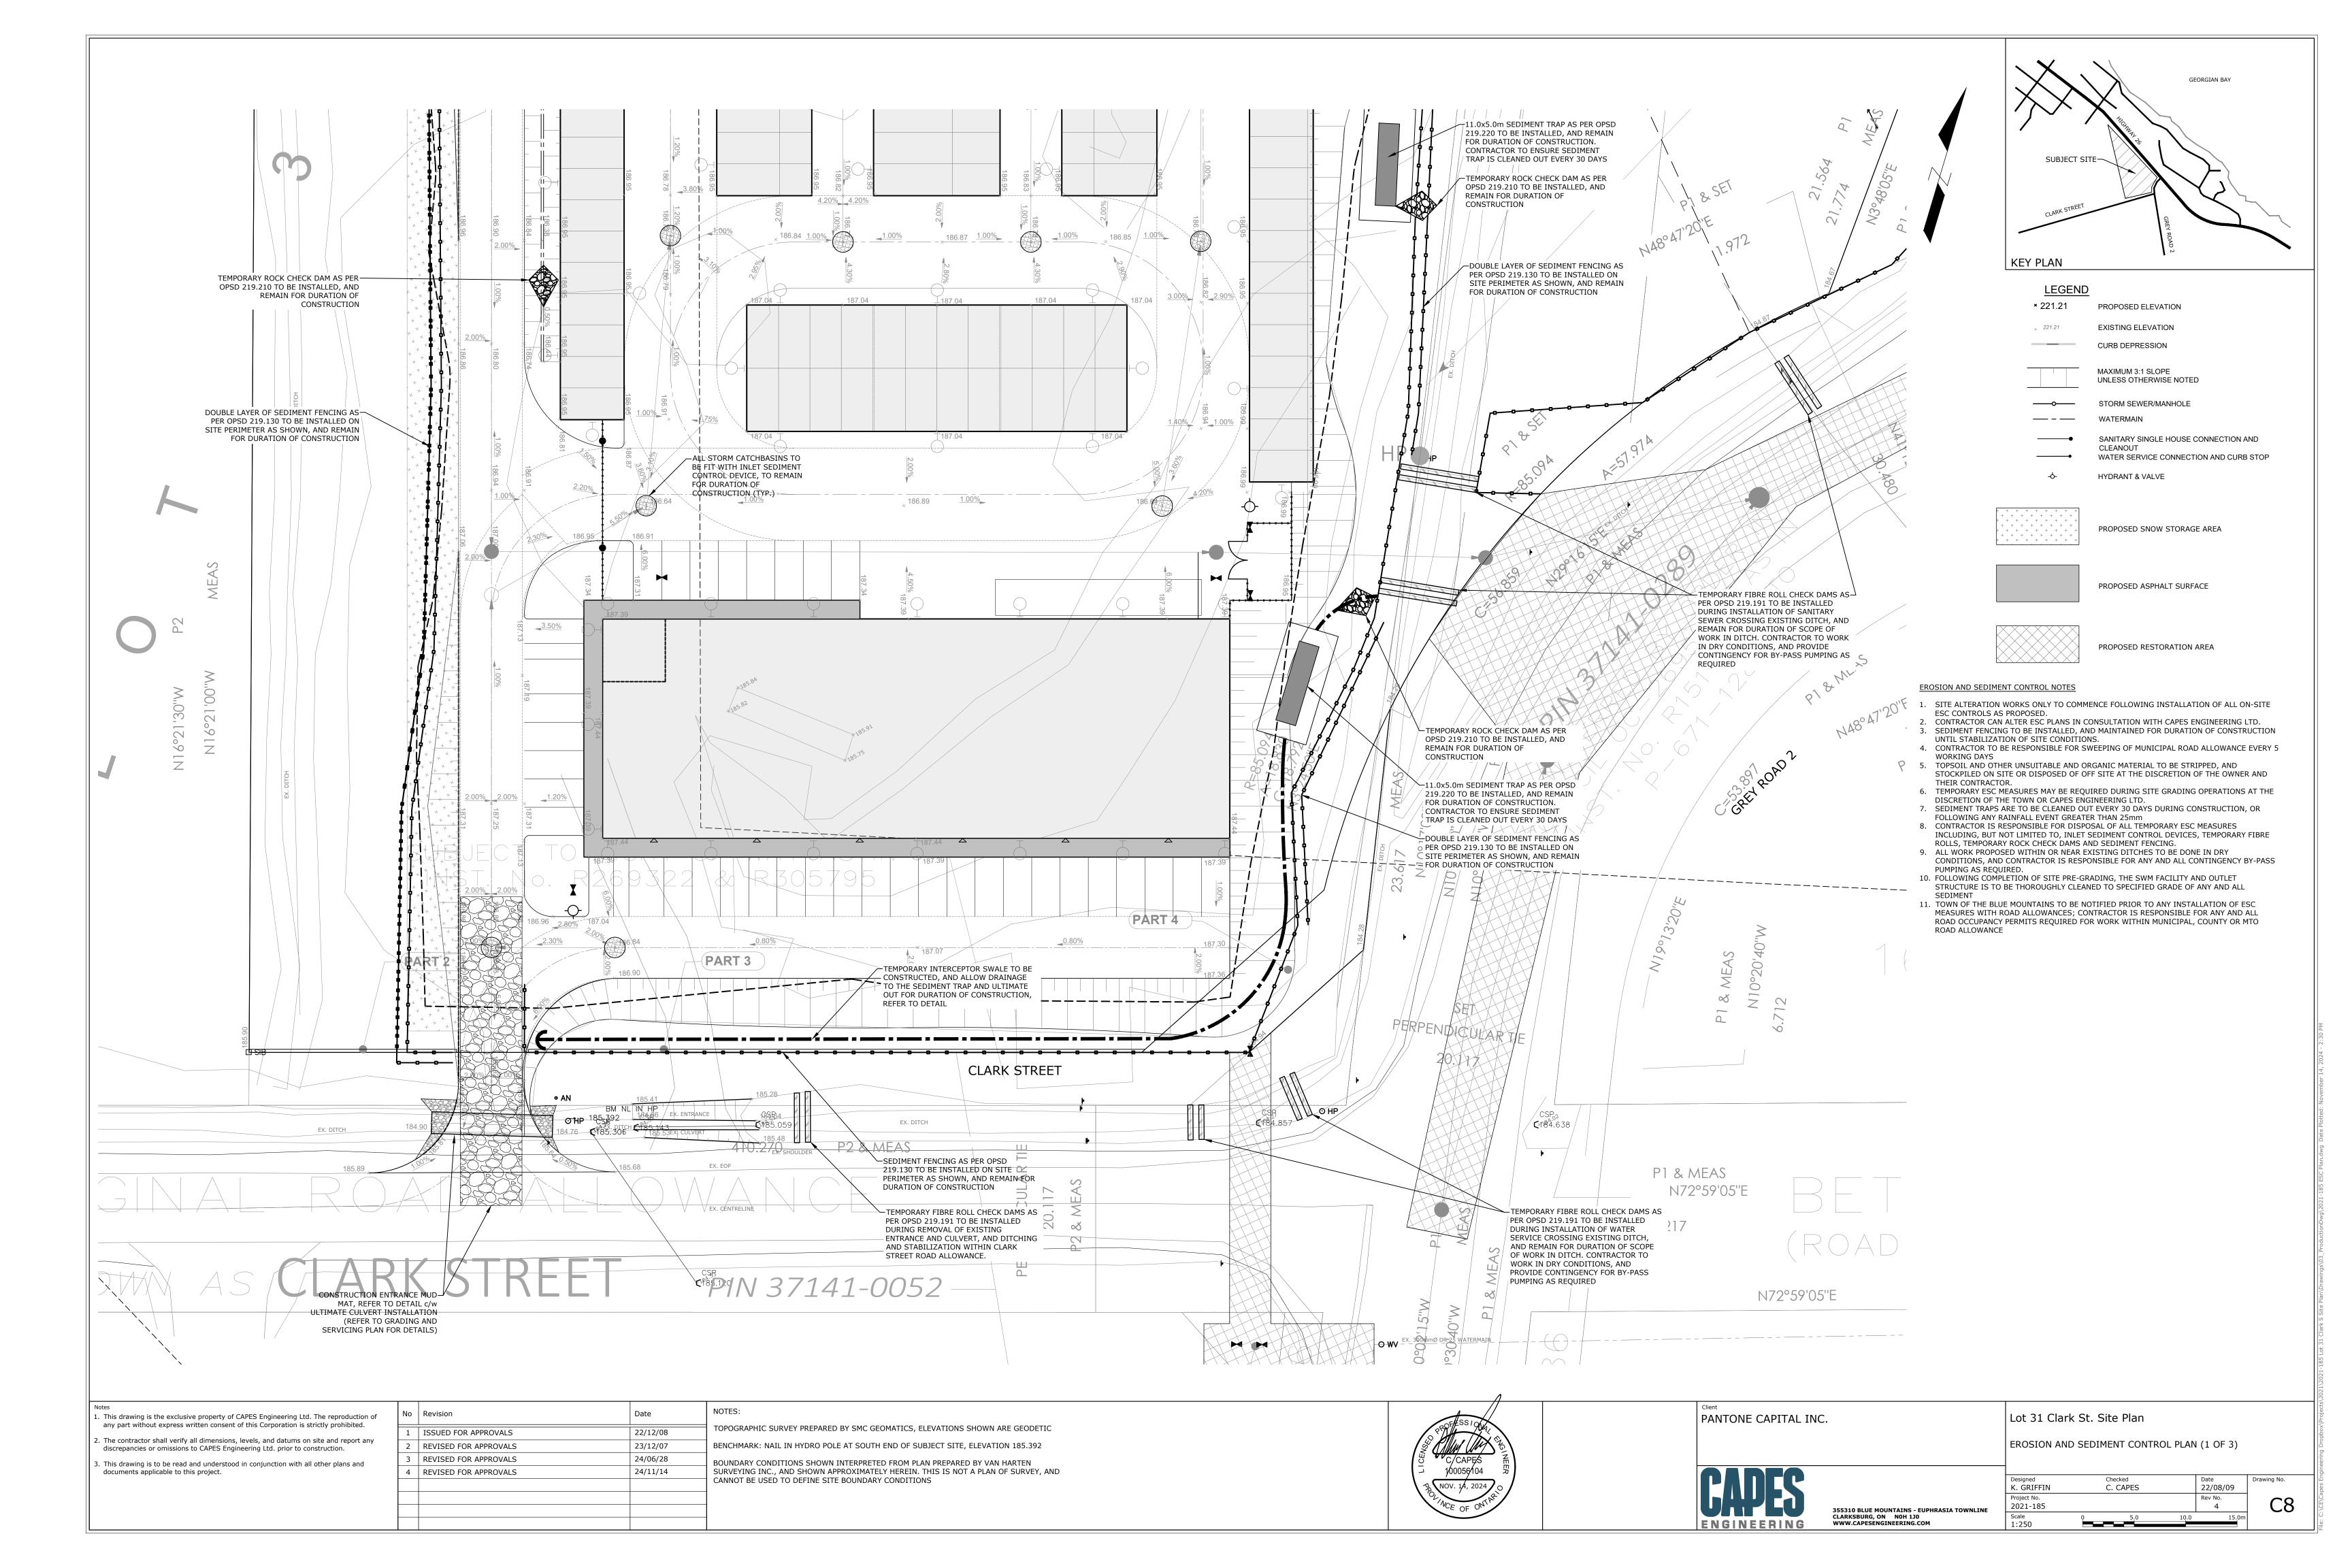

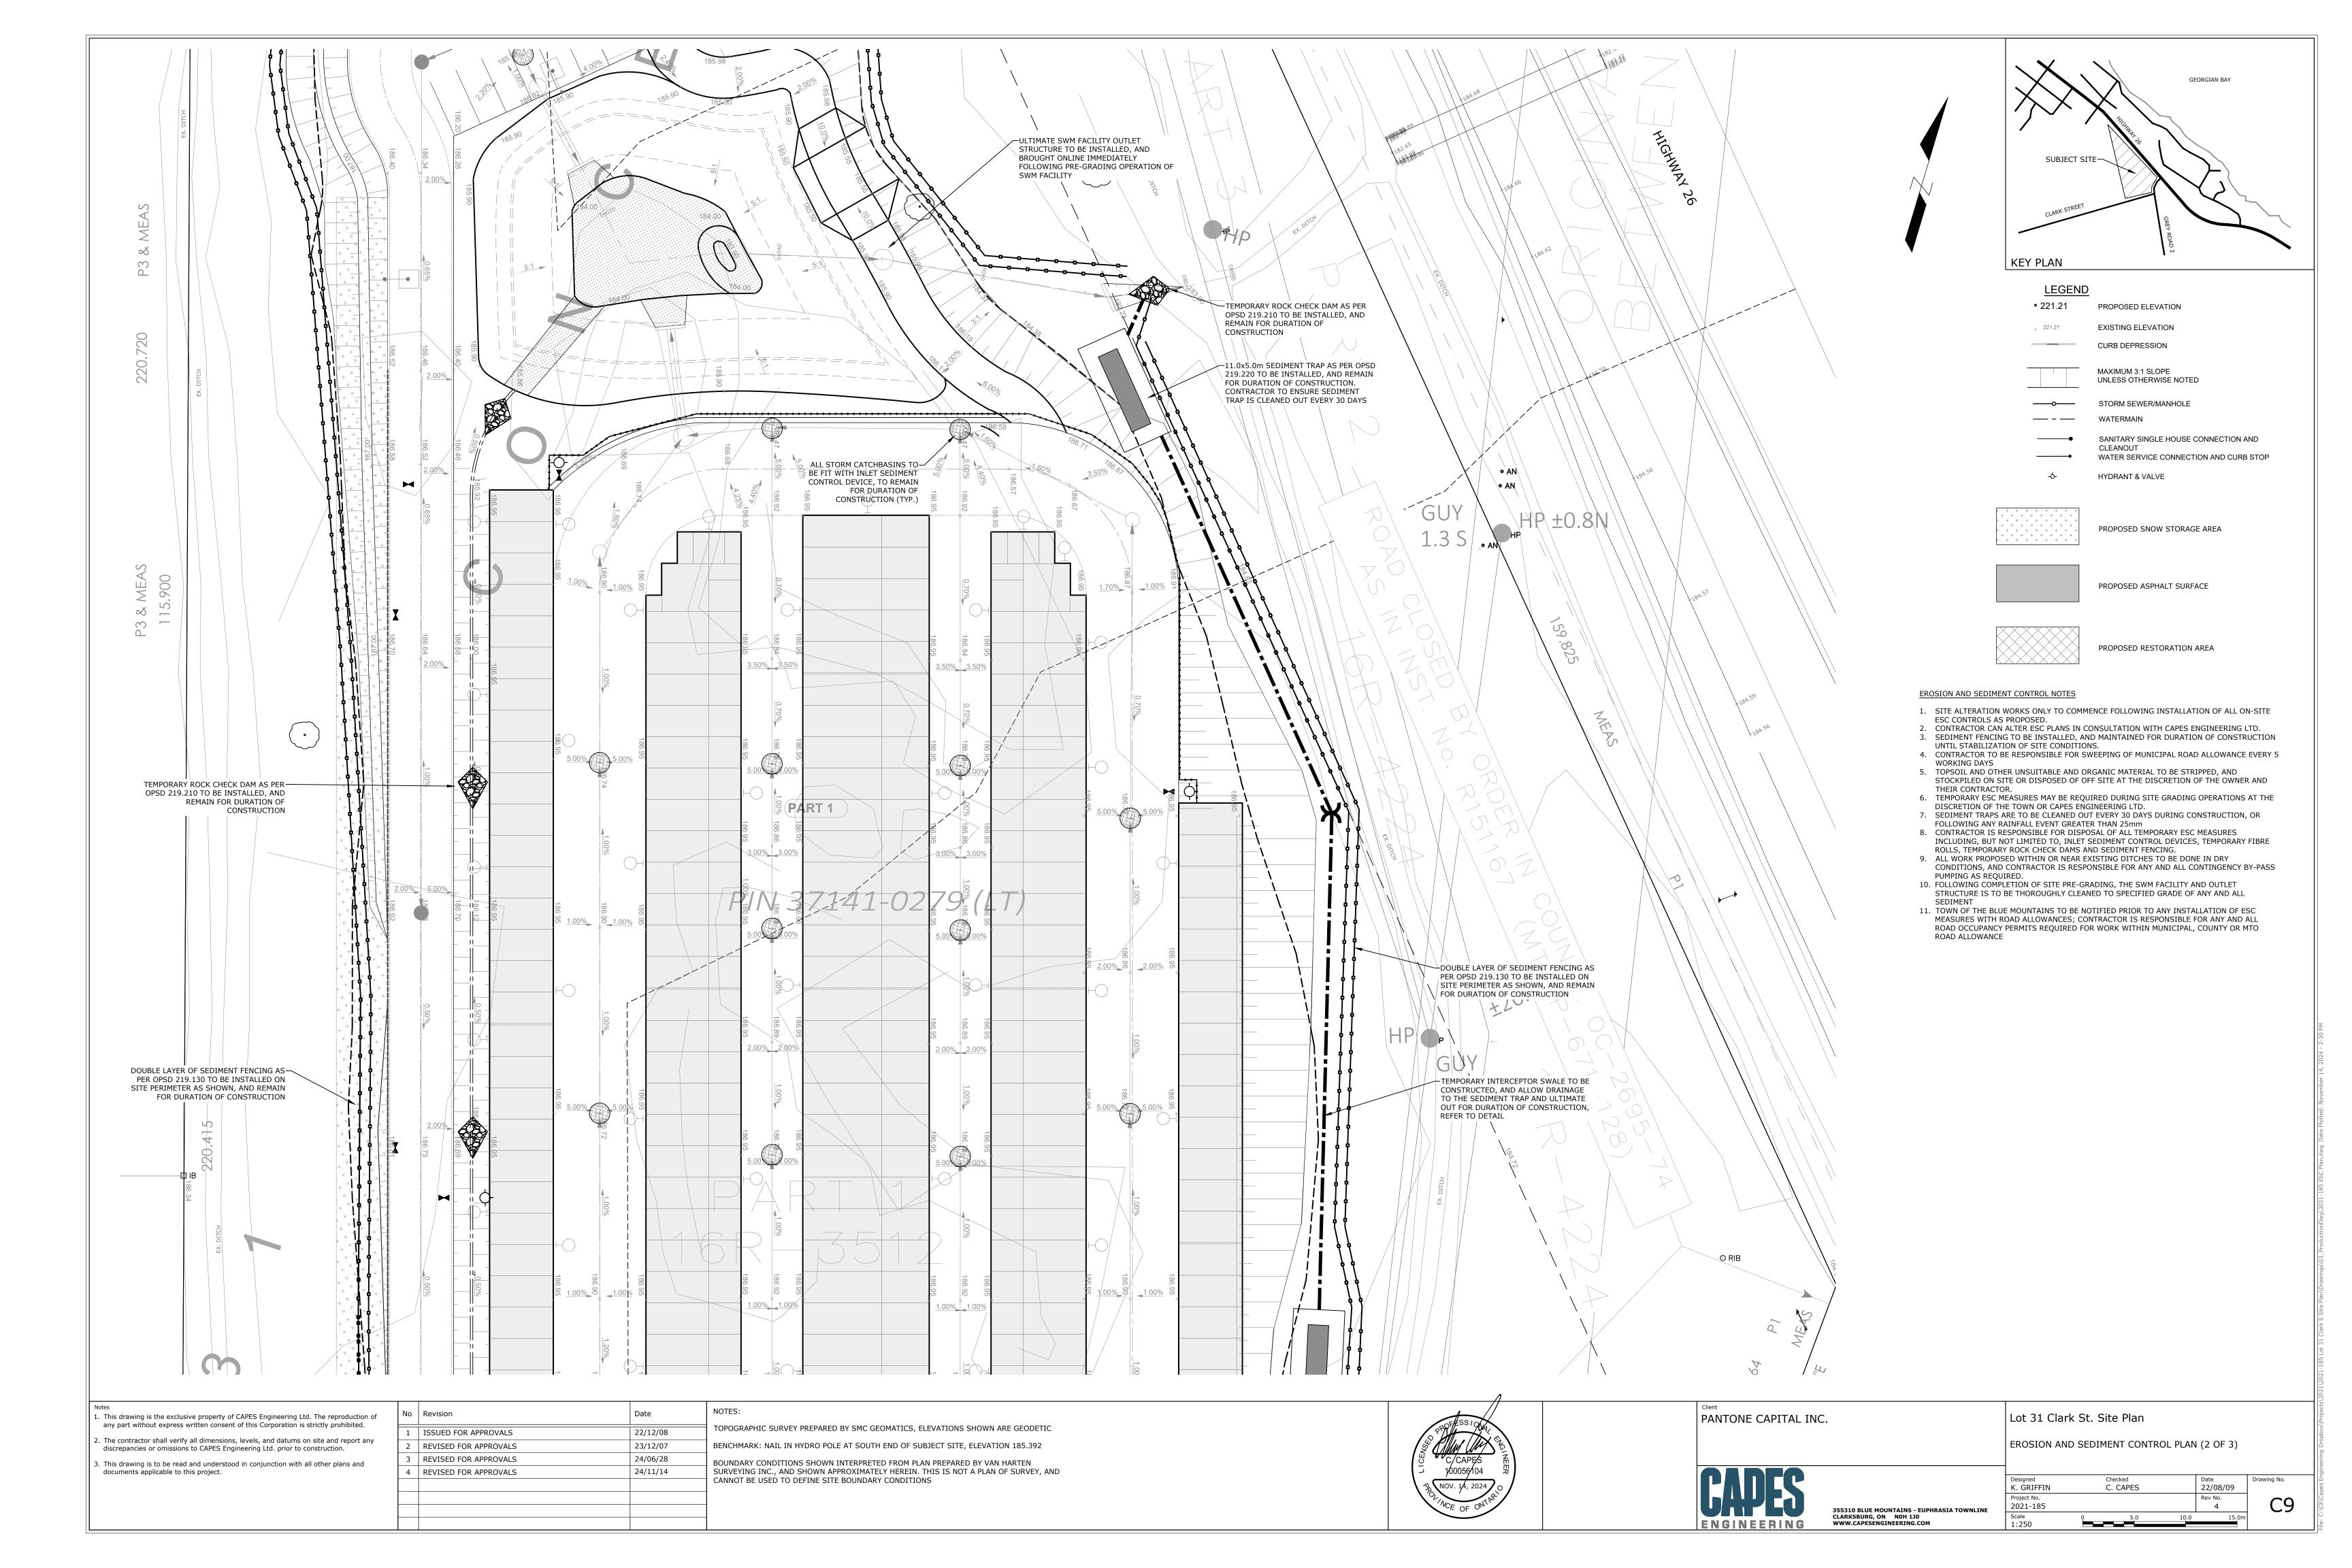

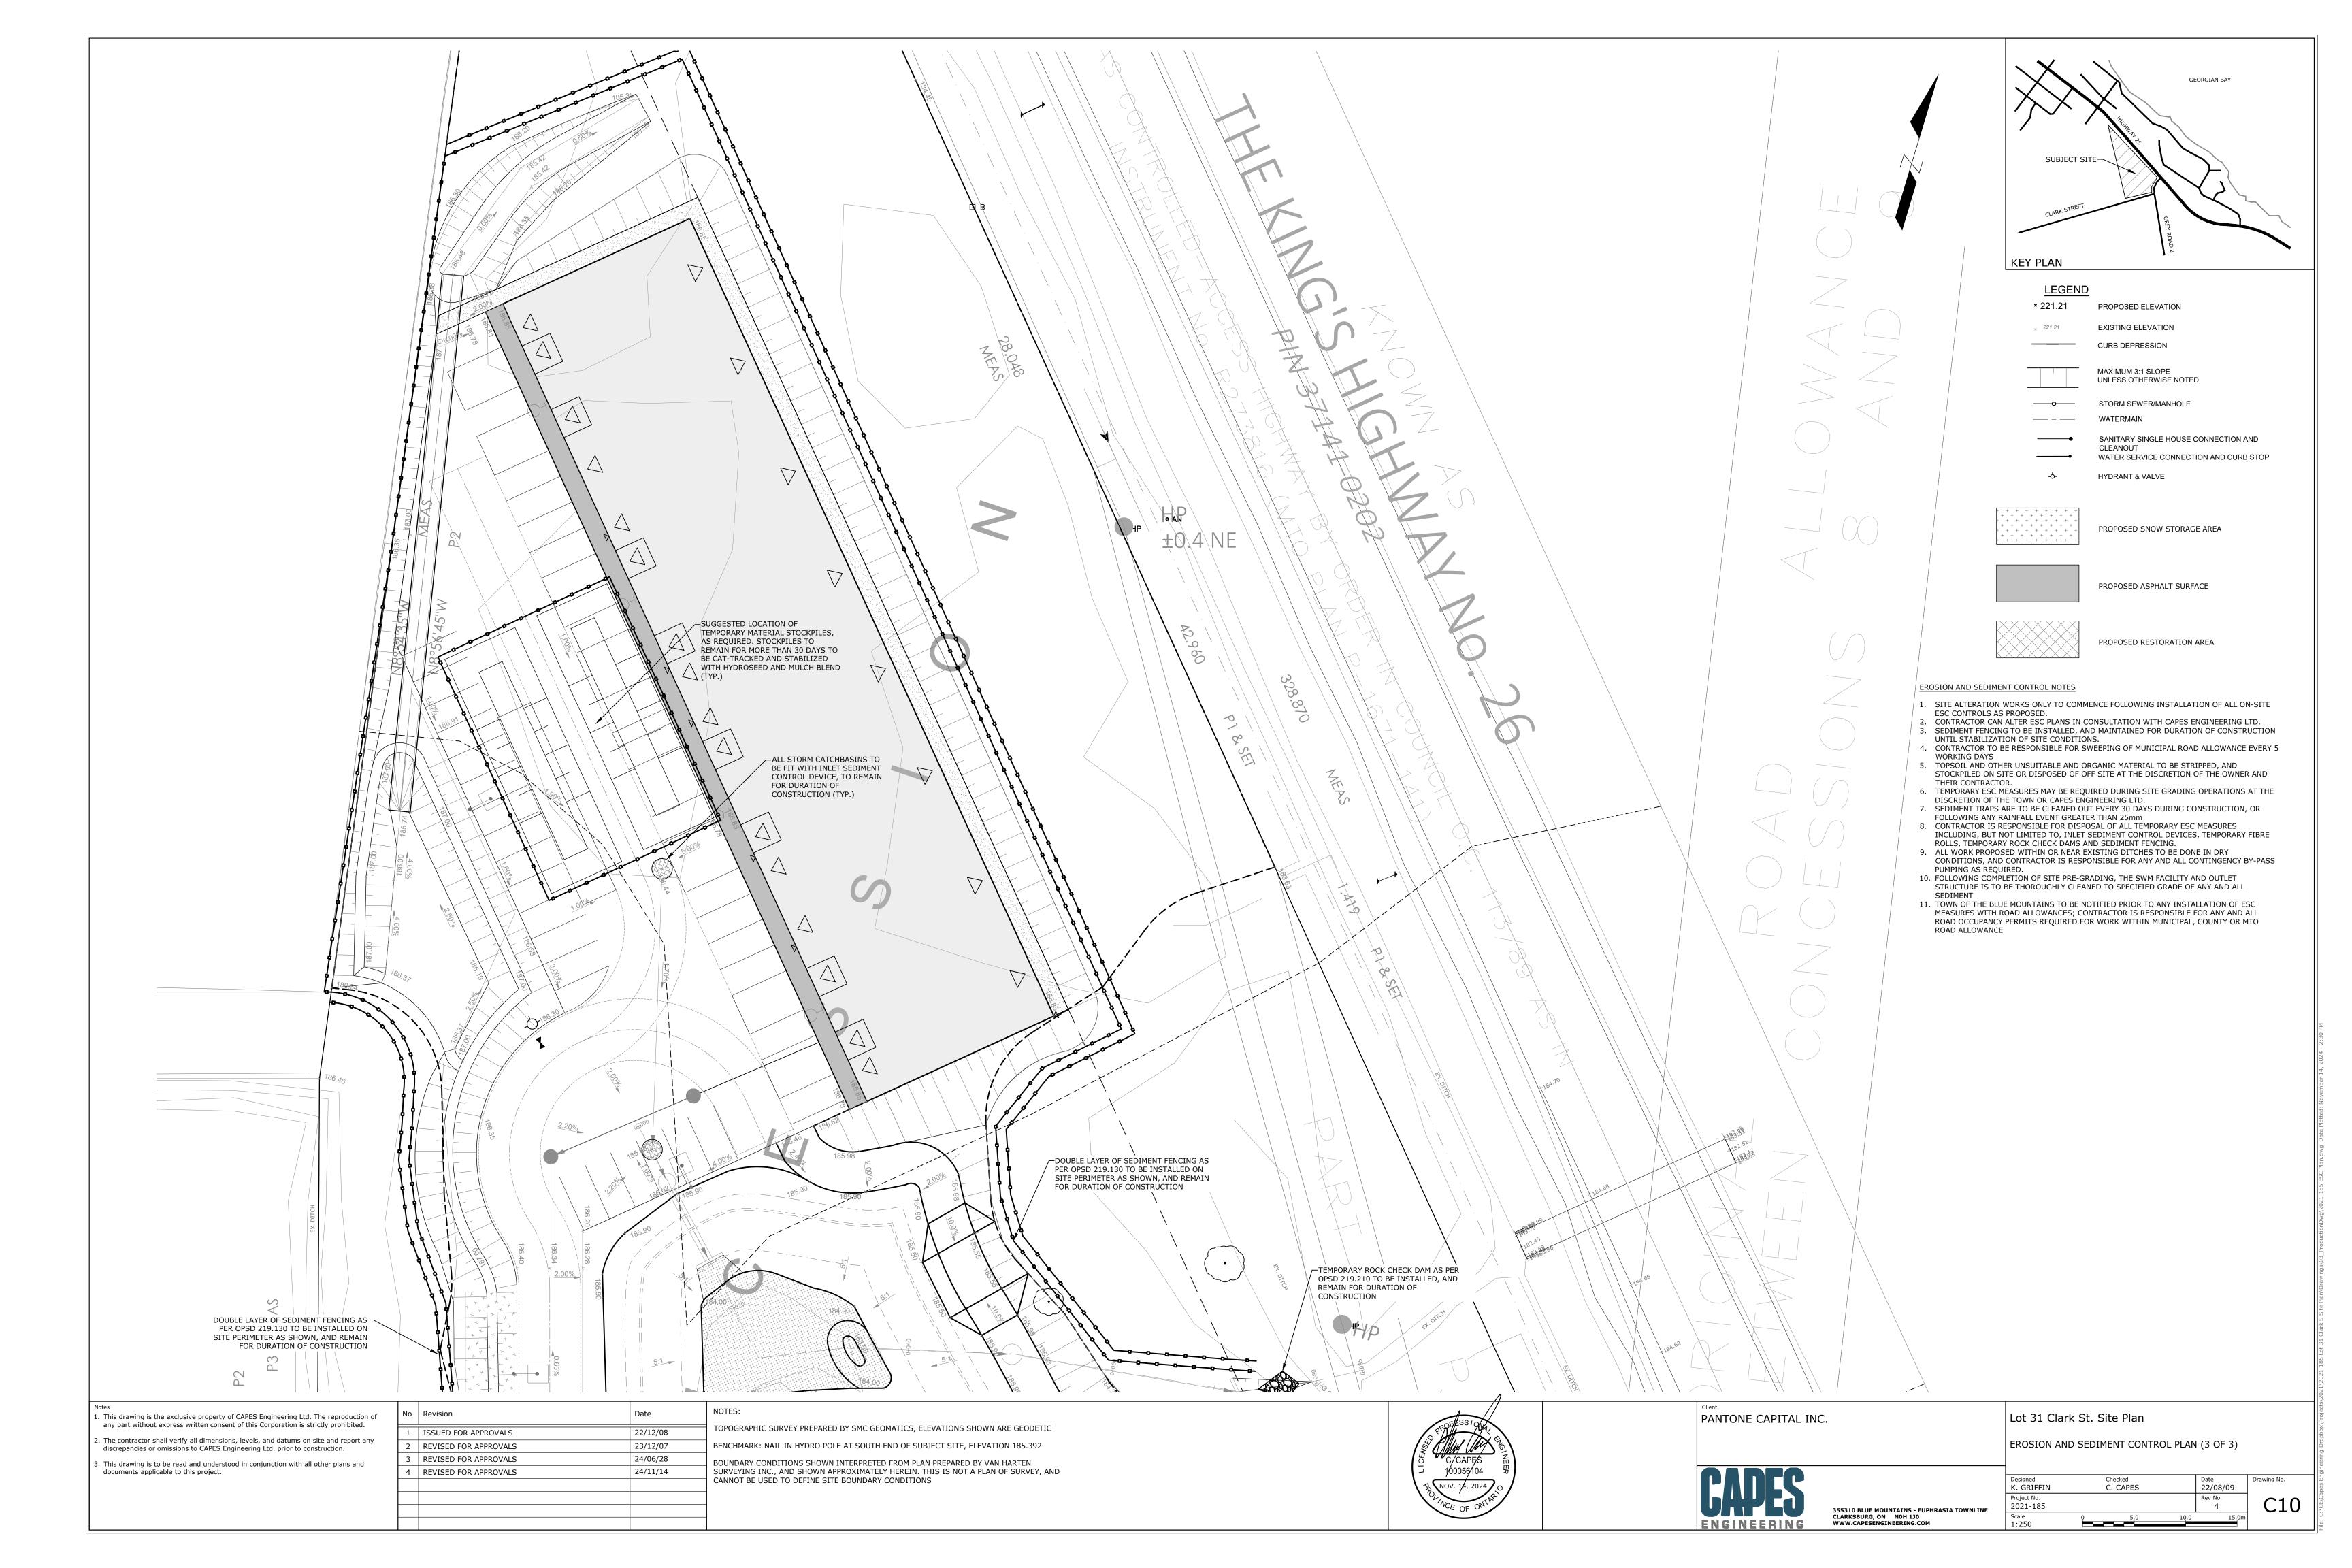

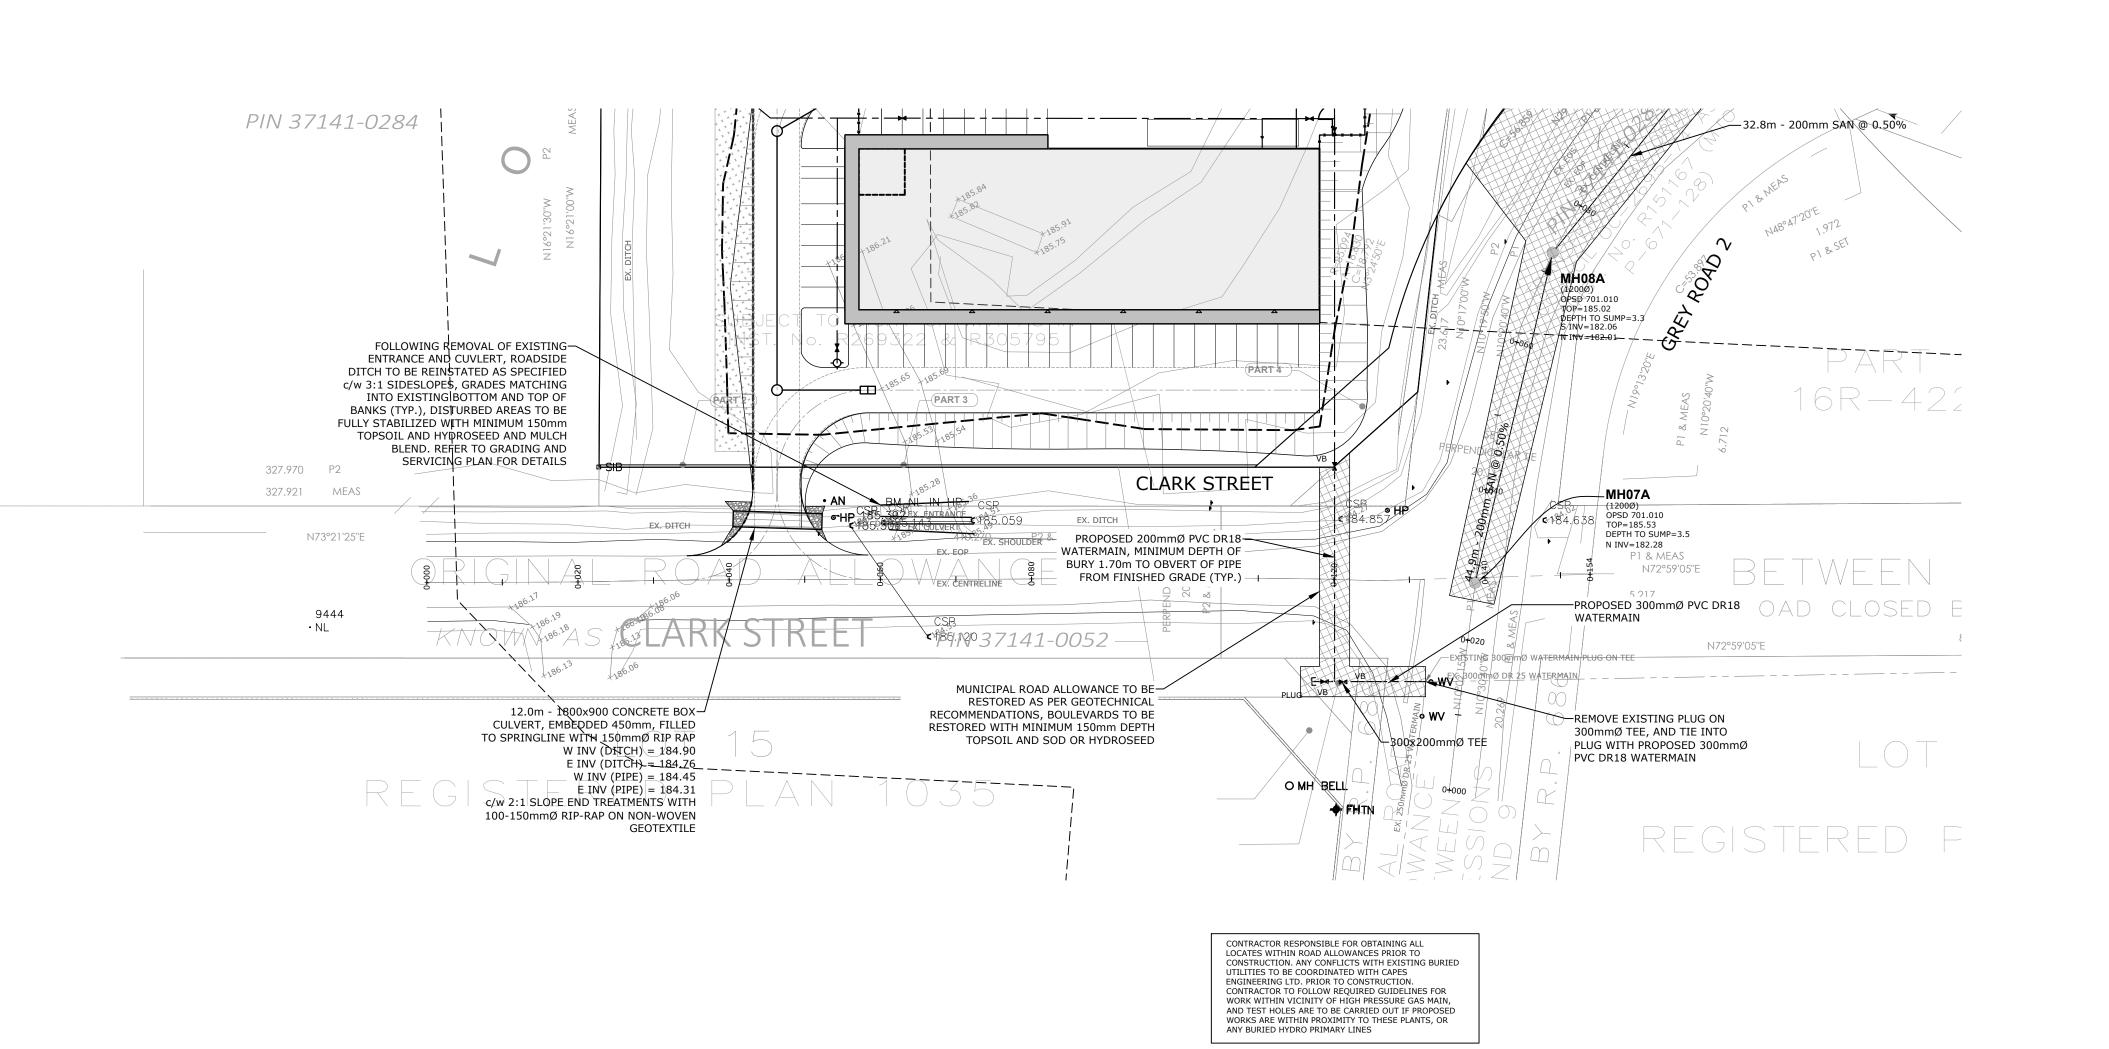

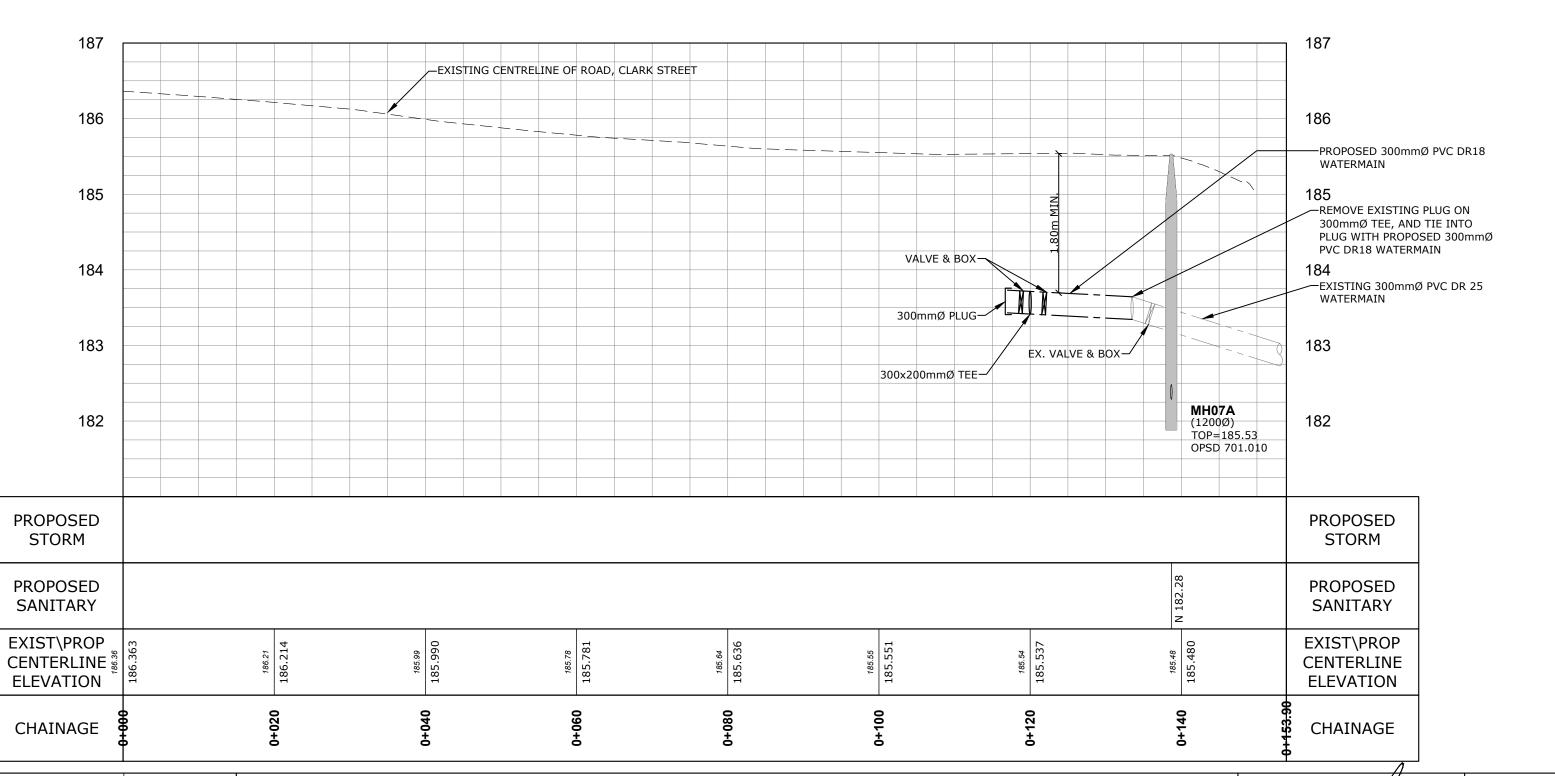


. This drawing is the exclusive property of CAPES Engineering Ltd. The reproduction of any part without express written consent of this Corporation is strictly prohibited. . The contractor shall verify all dimensions, levels, and datums on site and report any

discrepancies or omissions to CAPES Engineering Ltd. prior to construction. 3. This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.

No	Revision	Date
1	ISSUED FOR APPROVALS	22/12/08
2	REVISED FOR APPROVALS	23/12/07
3	REVISED FOR APPROVALS	24/06/28
4	REVISED FOR APPROVALS	24/11/14

NOTES: TOPOGRAPHIC SURVEY PREPARED BY SMC GEOMATICS, ELEVATIONS SHOWN ARE GEODETIC BENCHMARK: NAIL IN HYDRO POLE AT SOUTH END OF SUBJECT SITE, ELEVATION 185.392 BOUNDARY CONDITIONS SHOWN INTERPRETED FROM PLAN PREPARED BY VAN HARTEN SURVEYING INC., AND SHOWN APPROXIMATELY HEREIN. THIS IS NOT A PLAN OF SURVEY, AND

CANNOT BE USED TO DEFINE SITE BOUNDARY CONDITIONS



PANTONE CAPITAL INC.

PLAN AND PROFILE

355310 BLUE MOUNTAINS - EUPHRASIA TOWNLINE CLARKSBURG, ON NOH 1JO WWW.CAPESENGINEERING.COM H 1:500 V 1:50

CLARK STREET K. GRIFFIN

Lot 31 Clark St. Site Plan

STA 0+000 to STA 0+154 C. CAPES 22/08/09 Project No. 2021-185

GEORGIAN BAY

SUBJECT SITE-

LEGEND

PROPOSED ELEVATION

EXISTING ELEVATION

CURB DEPRESSION

MAXIMUM 3:1 SLOPE

WATERMAIN

CLEANOUT

HYDRANT & VALVE

1. PROPOSED WATER SERVICE CONNECTIONS TO BE PE SERIES 160 OR

CADWELD METHOD, AND COVERED WITH MASTIK MATERIAL PER

5. REFER TO TOWN OF BLUE MOUNTAINS ENGINEERING STANDARDS FOR

ALL ANODES TO BE PACKAGED ZINC ANODES THE ZINC ANODE COATING

BE A GYPSUM/SODIUM SULPHATE/BENTONITE MIXTURE HAVING AN

7. DURATRON SYSTEMS LIMITED, CATHODIC TECHNOLOGY LTD., MAPLE AGENCIES AND CORROSION SERVICE COMPANY LIMITED PRESENTLY

9. HYDRANTS SHALL BE SPACED AT A MAXIMUM DISTANCE OF 100 M IN RESIDENTIAL AND 90 M IN COMMERCIAL OR INDUSTRIAL AREAS. 10. ALL HYDRANTS SHALL BE PAINTED CHROME YELLOW. ALL HYDRANTS SHALL HAVE A FLEXSTAKE HYDRANT MARKER MODEL FHV804, 1.2 M LONG, COLOUR

11. A FIRE HYDRANT MARKER SHALL BE INSTALLED 0.3M BEHIND EACH

MANUFACTURE ANODES TO THE SPECIFIED REQUIREMENTS.

8. FIRE HYDRANTS SHALL BE CANADA VALVE, OPEN LEFT.

RIGHT PORT AS VIEWED FROM THE STREET.

MOUNTED 1.5M ABOVE GRADE.

TO BE TAKEN TO THE HYDRANT.

CAP PAINTED BLUE

OPSD 701.010

APPROVED EQUIVALENT

PROTECTO-CAPS CAT. No. 175P190 OR APPROVED EQUAL.

3. CATHODIC PROTECTION TO BE PROVIDED FOR WATERMAIN AS PER TOWN OF BLUE MOUNTAINS STANDARDS. ANODES TO BE CONNECTED USING THE

MANUFACTURER'S RECOMMENDATIONS. ANODE TO BE CONNECTED TO VALVE

SHALL HAVE A 316 STAINLESS STEEL CORE WIRE. THE ZINC ANODE CASTING IS TO BE PACKAGED IN CARDBOARD OR A CLOTH BAG HAVING A MINIMUM DIAMETER OF 100 MM. THE BACKFILL MATERIAL WITHIN THE PACKAGE SHALL

ELECTRICAL RESISTIVITY LESS THAN 50 OHM CM WET. AN INSULTED COPPER (AWG 10 12) WIRE 3 METRES IN LENGTH SHALL BE BRAZED TO THE END OF

YELLOW WITH A REFLECTIVE HYDRANT GRAPHIC ON BOTH SIDES AT THE TOP OF THE MARKER. THE REQUIRED HYDRANT MARKER IS POSITIONED ON THE

HYDRANT. THE SIGN SHALL BE REFLECTIVE WITH A RED HYDRANT ON A WHITE BACKGROUND AND MEASURE 0.3 M X 0.3M. THE SIGN SHALL BE

12. FIRE HYDRANTS REQUIRE STORTZ CONNECTIONS ON ALL STEAMER PORTS. ACCESS PATHS (3.0 M WIDE) SHALL BE PROVIDED TO ALL HYDRANTS WHERE

SIDE DITCHES ARE REQUIRED. PROVIDE CULVERTS AS REQUIRED.

14. ALL OWNERS OF PRIVATE FIRE HYDRANTS MUST PARTICIPATE IN THE

#D001). A YEARLY FEE WILL BE CHARGED FOR THIS SERVICE

15. ISOLATION VALVES SHALL BE RESILIENT SEAT GATE VALVES WITH

16. PROPOSED SANITARY SERVICE GRAVITY LINES TO BE PVC SDR-28 OR

WATERPROOF JOINT SEALING (OR APPROVED EQUIVALENT). 18. PROPOSED STORM CATCHBASINS TO BE REINFORCED CONCRETE AS PER OPSD 705.010, GRATE ARRANGEMENT AS PER PLAN SPECIFICATIONS 19. PROPOSED STORM MANHOLE STRUCTURE TO BE REINFORCED CONCRETE PER

17. PROPOSED SANITARY MANHOLE STRUCTURE TO BE REINFORCED CONCRETE

20. PROPOSED STORM SEWER TO BE PVC SDR-35 OR APPROVED EQUIVALENT

APPROVED ALTERNATIVE, AS PER TOWN OF BLUE MOUNTAINS STANDARDS (ie. CLEAR STONE IN HIGH GROUNDWATER CONDITIONS AS REQUIRED). 22. PROPOSED CSP CULVERT TO BE MINIMUM 2.0mm GAUGE CORRUGATED

ALLOWANCE. CONTRACTOR IS RESPONSIBLE FOR ALL ROAD OCCUPATION

PROCEDURES, AND THE PRESENCE OF A THIRD PARTY WATER OPERATIONS

21. PIPE BEDDING TO BE COMPACTED GRANULAR 'A' TO 98% SPMDD, OR

23. CONTRACTOR TO CONTACT CAPES ENGINEERING AND TOWN OF BLUE MOUNTAINS STAFF PRIOR TO MAKING CONNECTION TO EXISTING WATERMAIN AND SANITARY, AND PRIOR TO ANY WORK WITHIN THE ROAD

24. CONTRACTOR IS RESPONSIBLE FOR ALL WATERMAIN COMMISSIONING

CONTRACTOR FOR COMMISSIONING PROCEDURES. WATERMAIN COMMISSIONING TO FOLLOW TOWN OF BLUE MOUNTAINS STANDARDS.

PER OPSD 701.010, AND JOINTS TO BE WRAPPED WITH DENSO VISCOTAQ

13. HYDRANT SETS SHALL BE INSTALLED AT NOT LESS THAN 0.9 M FROM THE

CENTRE OF THE VALVE TO THE CENTRE OF THE HYDRANT. TRACER WIRE SHALL BE ATTACHED TO THE OUTSIDE OF THE VALVE BOX AND WIRE

BROUGHT INTO VALVE BOX UNDER CAP. THE TRACER WIRE DOES NOT NEED

TOWN'S "PRIVATELY OWNED FIRE HYDRANT MAINTENANCE PROGRAM" (FORM

MECHANICAL JOINTS, OPEN LEFT, CLOW OR MUELLER. VALVE BOXES SHALL BE 5 SL 48 SLIDING OR MUELLER MVB COMPOSITE COMPLETE WITH GUIDE PLATE AND DUCTILE ADJUSTABLE TOP AND LID OR APPROVED EQUAL WITH

RISERS AND CURB STOPS WITH AN ELECTRICAL BRASS GROUNDING CLAMP. 4. ALL FITTING BOLTS TO BE FIT WITH 19mm SACRIFICAL ZINC CAPS PER

UNLESS OTHERWISE NOTED

STORM SEWER/MANHOLE

SANITARY SINGLE HOUSE CONNECTION AND

WATER SERVICE CONNECTION AND CURB STOP

× 221.21

× 221.21

GENERAL NOTES


APPROVED EQUIVALENT

ANODE SIZING CHART.

THE CORE WIRE.

2. PROPOSED WATERMAIN TO BE PVC DR18

KEY PLAN

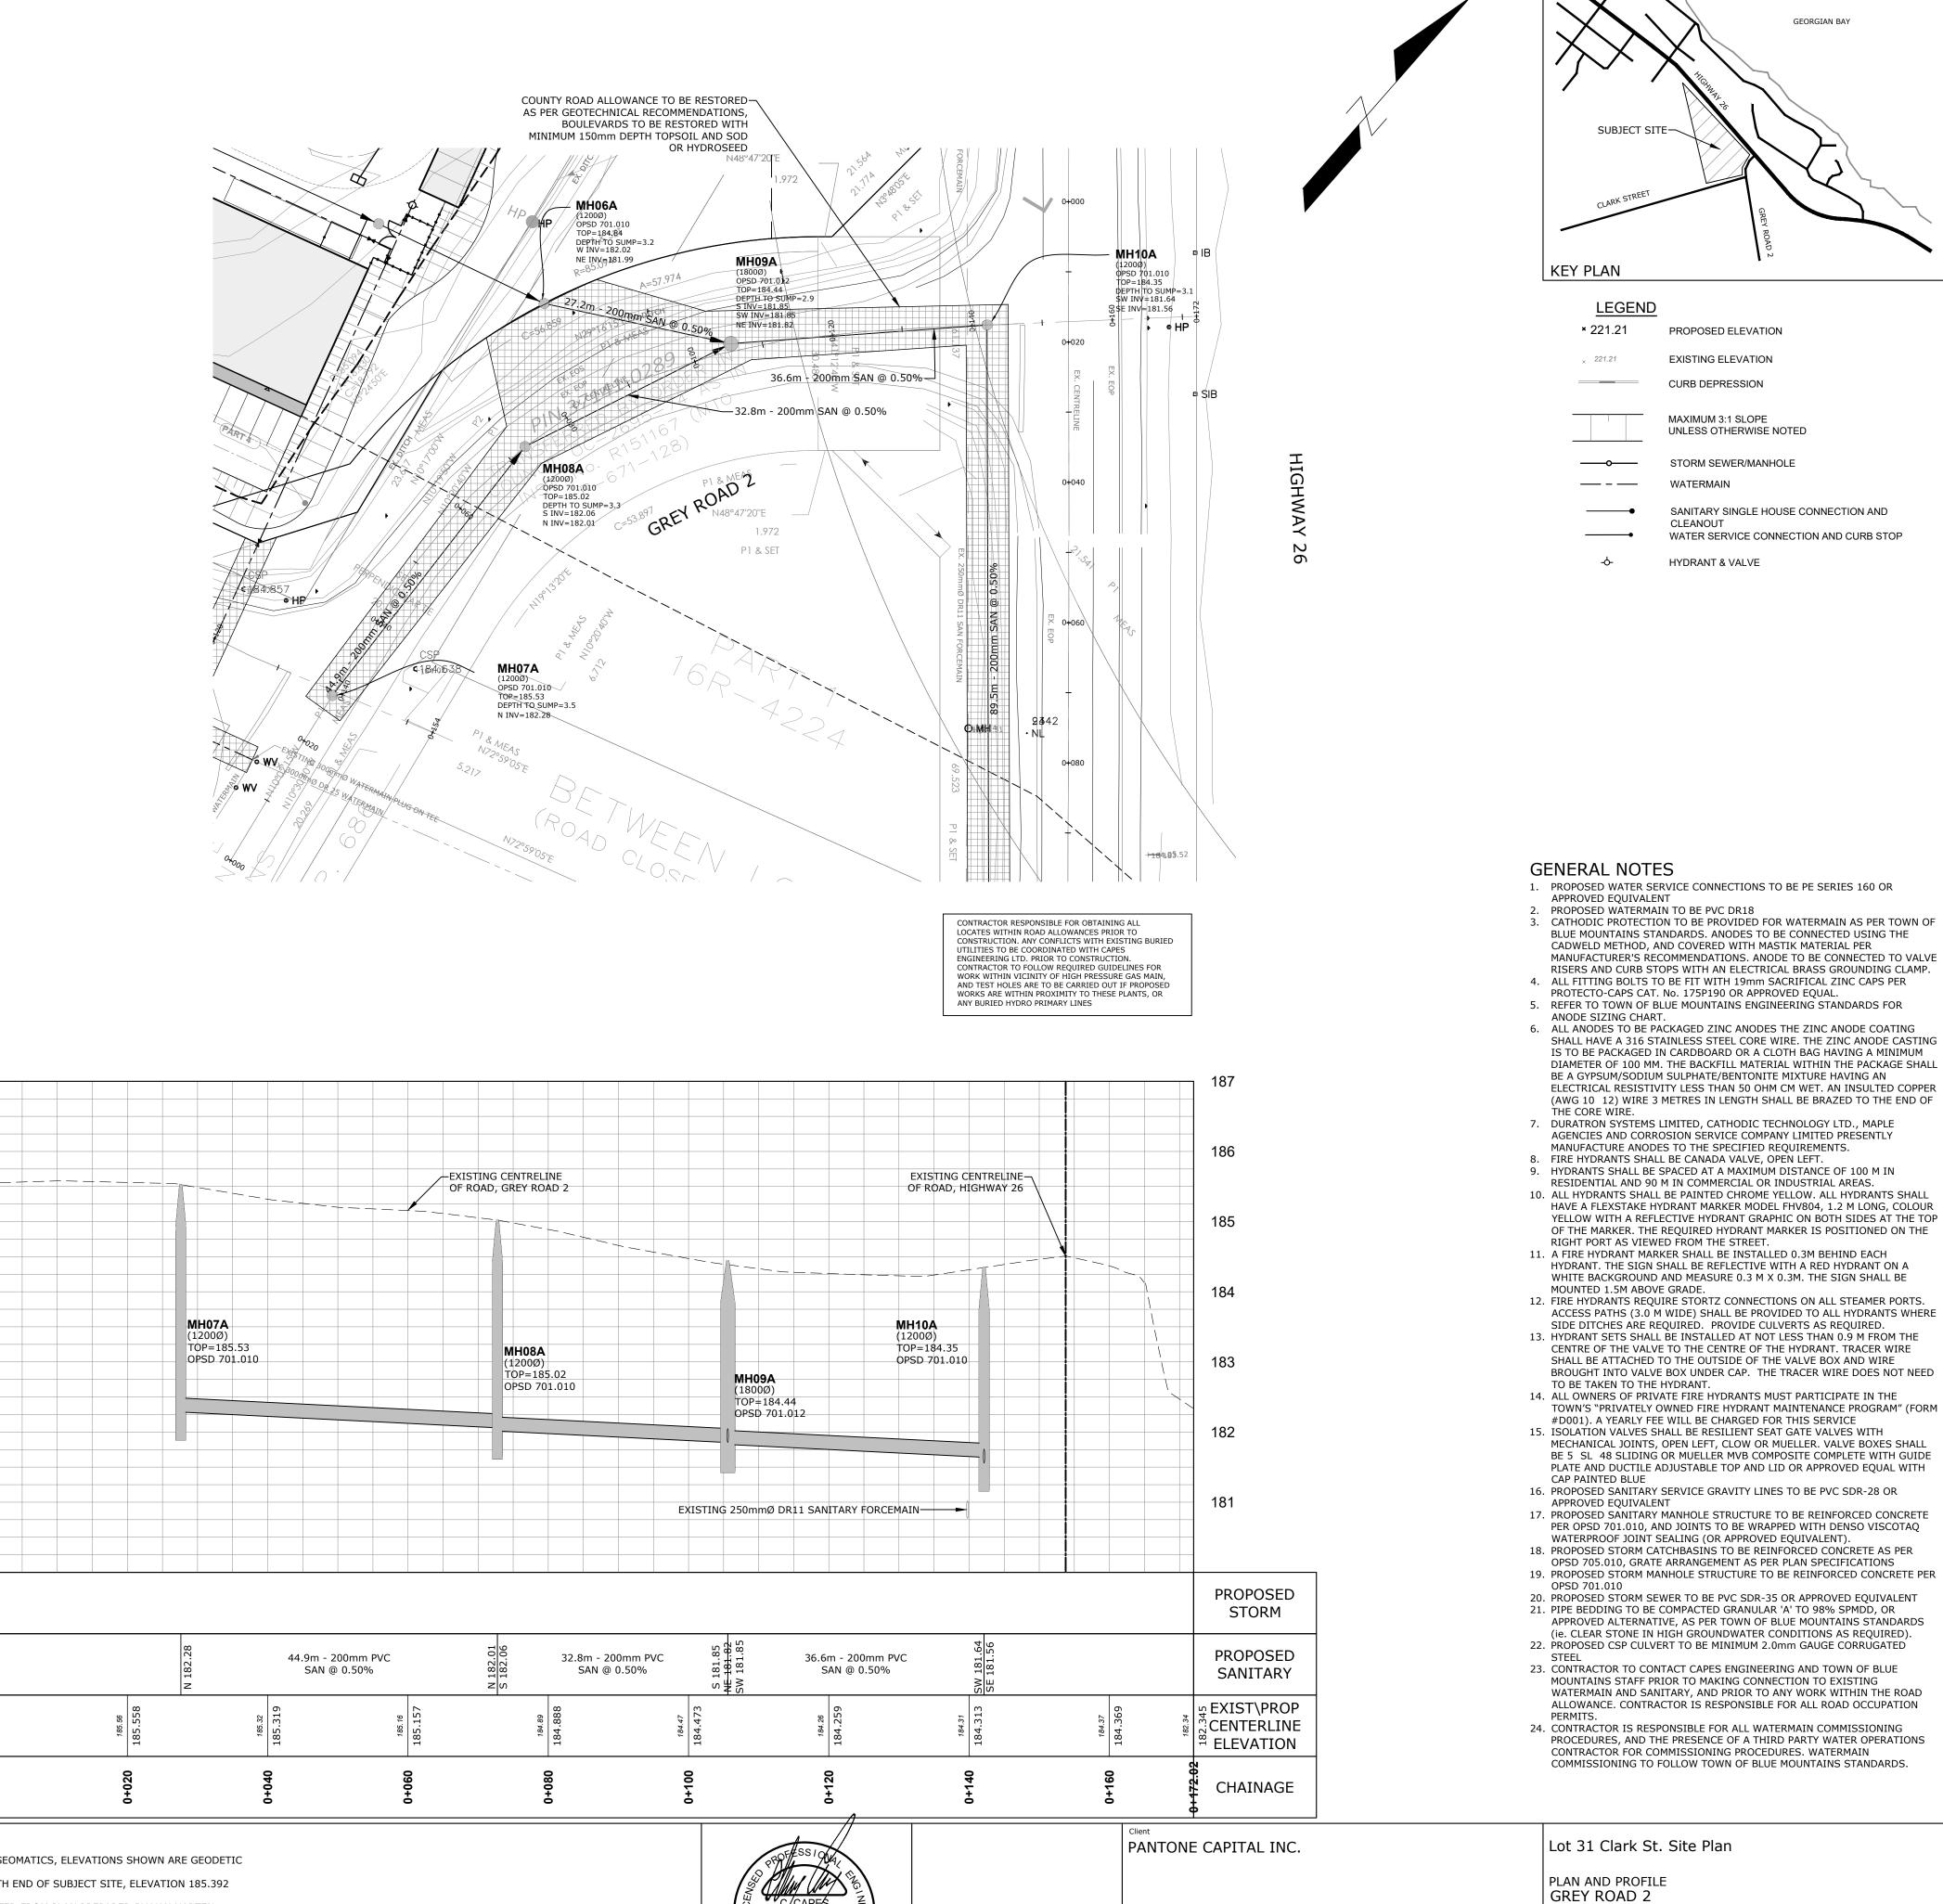

. This drawing is the exclusive property of CAPES Engineering Ltd. The reproduction of any part without express written consent of this Corporation is strictly prohibited. 2. The contractor shall verify all dimensions, levels, and datums on site and report any

discrepancies or omissions to CAPES Engineering Ltd. prior to construction. 3. This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.

1	ISSUED FOR APPROVALS	22/12/08
2	REVISED FOR APPROVALS	23/12/07
3	REVISED FOR APPROVALS	24/06/28
4	REVISED FOR APPROVALS	24/11/14

NOTES: TOPOGRAPHIC SURVEY PREPARED BY SMC GEOMATICS, ELEVATIONS SHOWN ARE GEODETIC BENCHMARK: NAIL IN HYDRO POLE AT SOUTH END OF SUBJECT SITE, ELEVATION 185.392

186

185

184

183

182

PROPOSED

STORM

PROPOSED

SANITARY

EXIST\PROP

CENTERLINE S

ELEVATION

CHAINAGE

BOUNDARY CONDITIONS SHOWN INTERPRETED FROM PLAN PREPARED BY VAN HARTEN SURVEYING INC., AND SHOWN APPROXIMATELY HEREIN. THIS IS NOT A PLAN OF SURVEY, AND CANNOT BE USED TO DEFINE SITE BOUNDARY CONDITIONS

1/00056/104

355310 BLUE MOUNTAINS - EUPHRASIA TOWNLINE CLARKSBURG, ON NOH 1J0

WWW.CAPESENGINEERING.COM

STA 0+000 to STA 0+172


H 1:500 V 1:50

K. GRIFFIN C. CAPES 22/08/09 Project No. 2021-185

GEORGIAN BAY

CLEANOUT

HYDRANT & VALVE

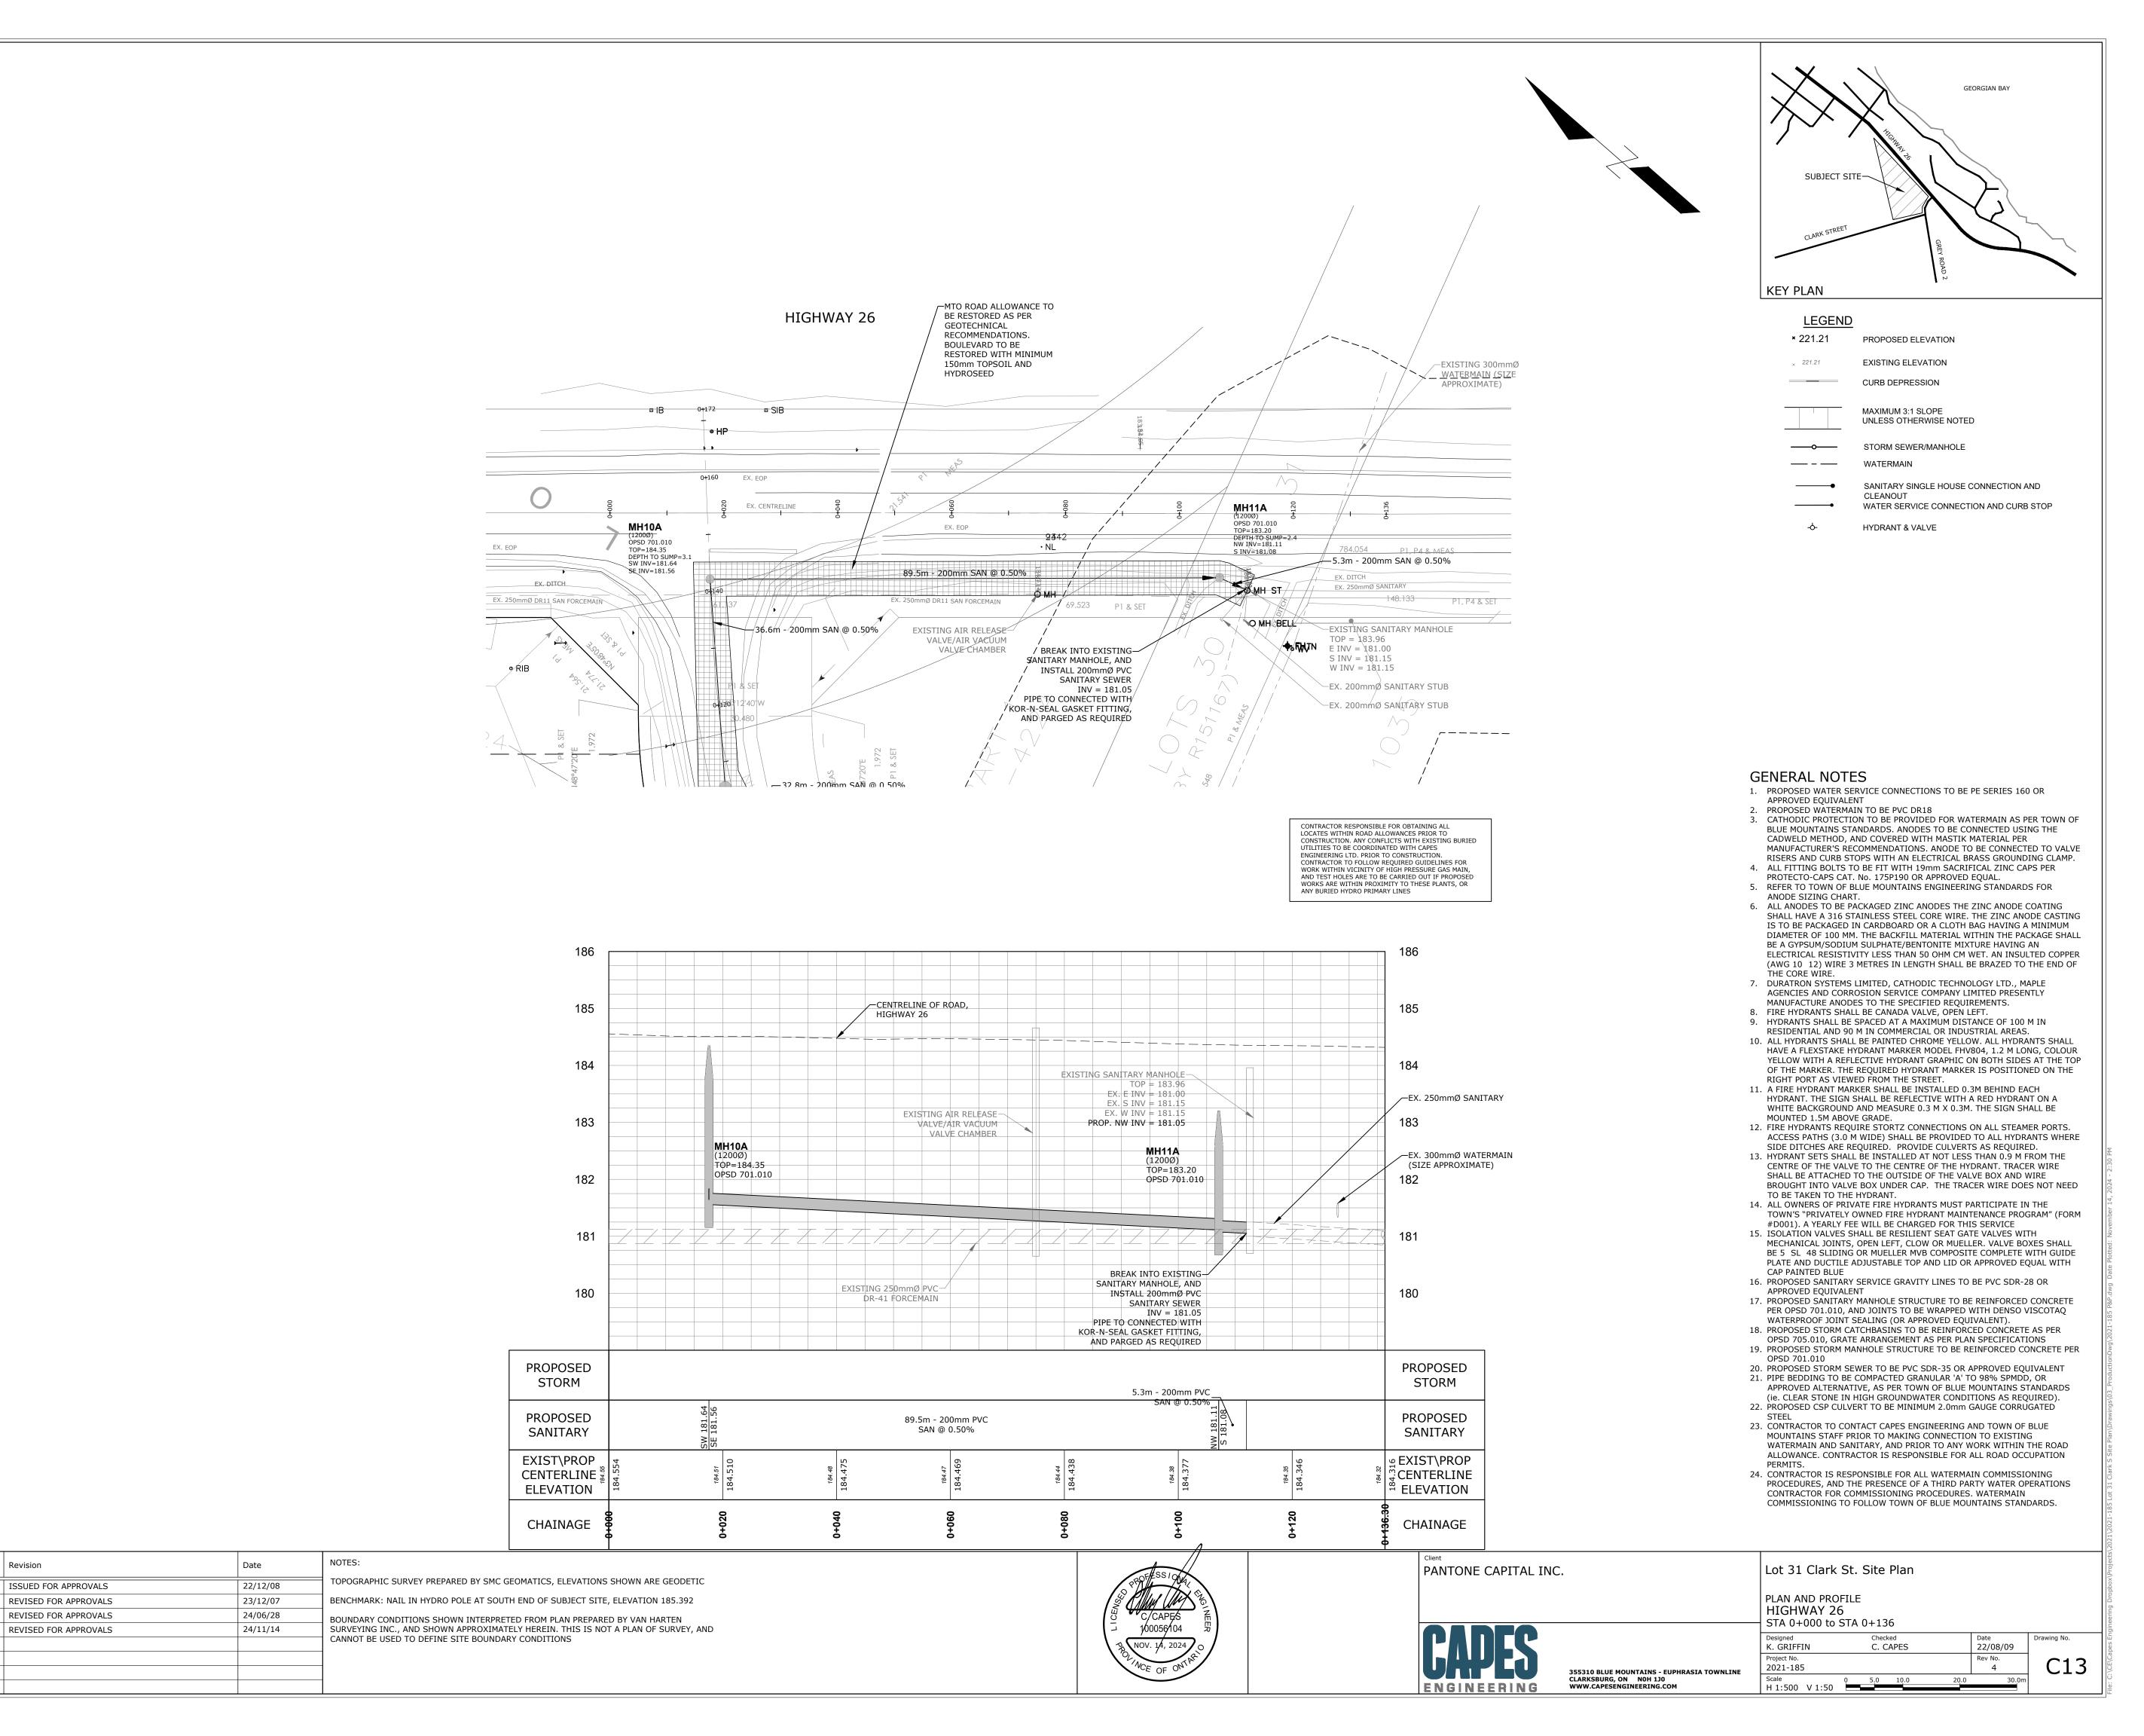

. This drawing is the exclusive property of CAPES Engineering Ltd. The reproduction of

. The contractor shall verify all dimensions, levels, and datums on site and report any


any part without express written consent of this Corporation is strictly prohibited.


3. This drawing is to be read and understood in conjunction with all other plans and


discrepancies or omissions to CAPES Engineering Ltd. prior to construction.


documents applicable to this project.


Revision

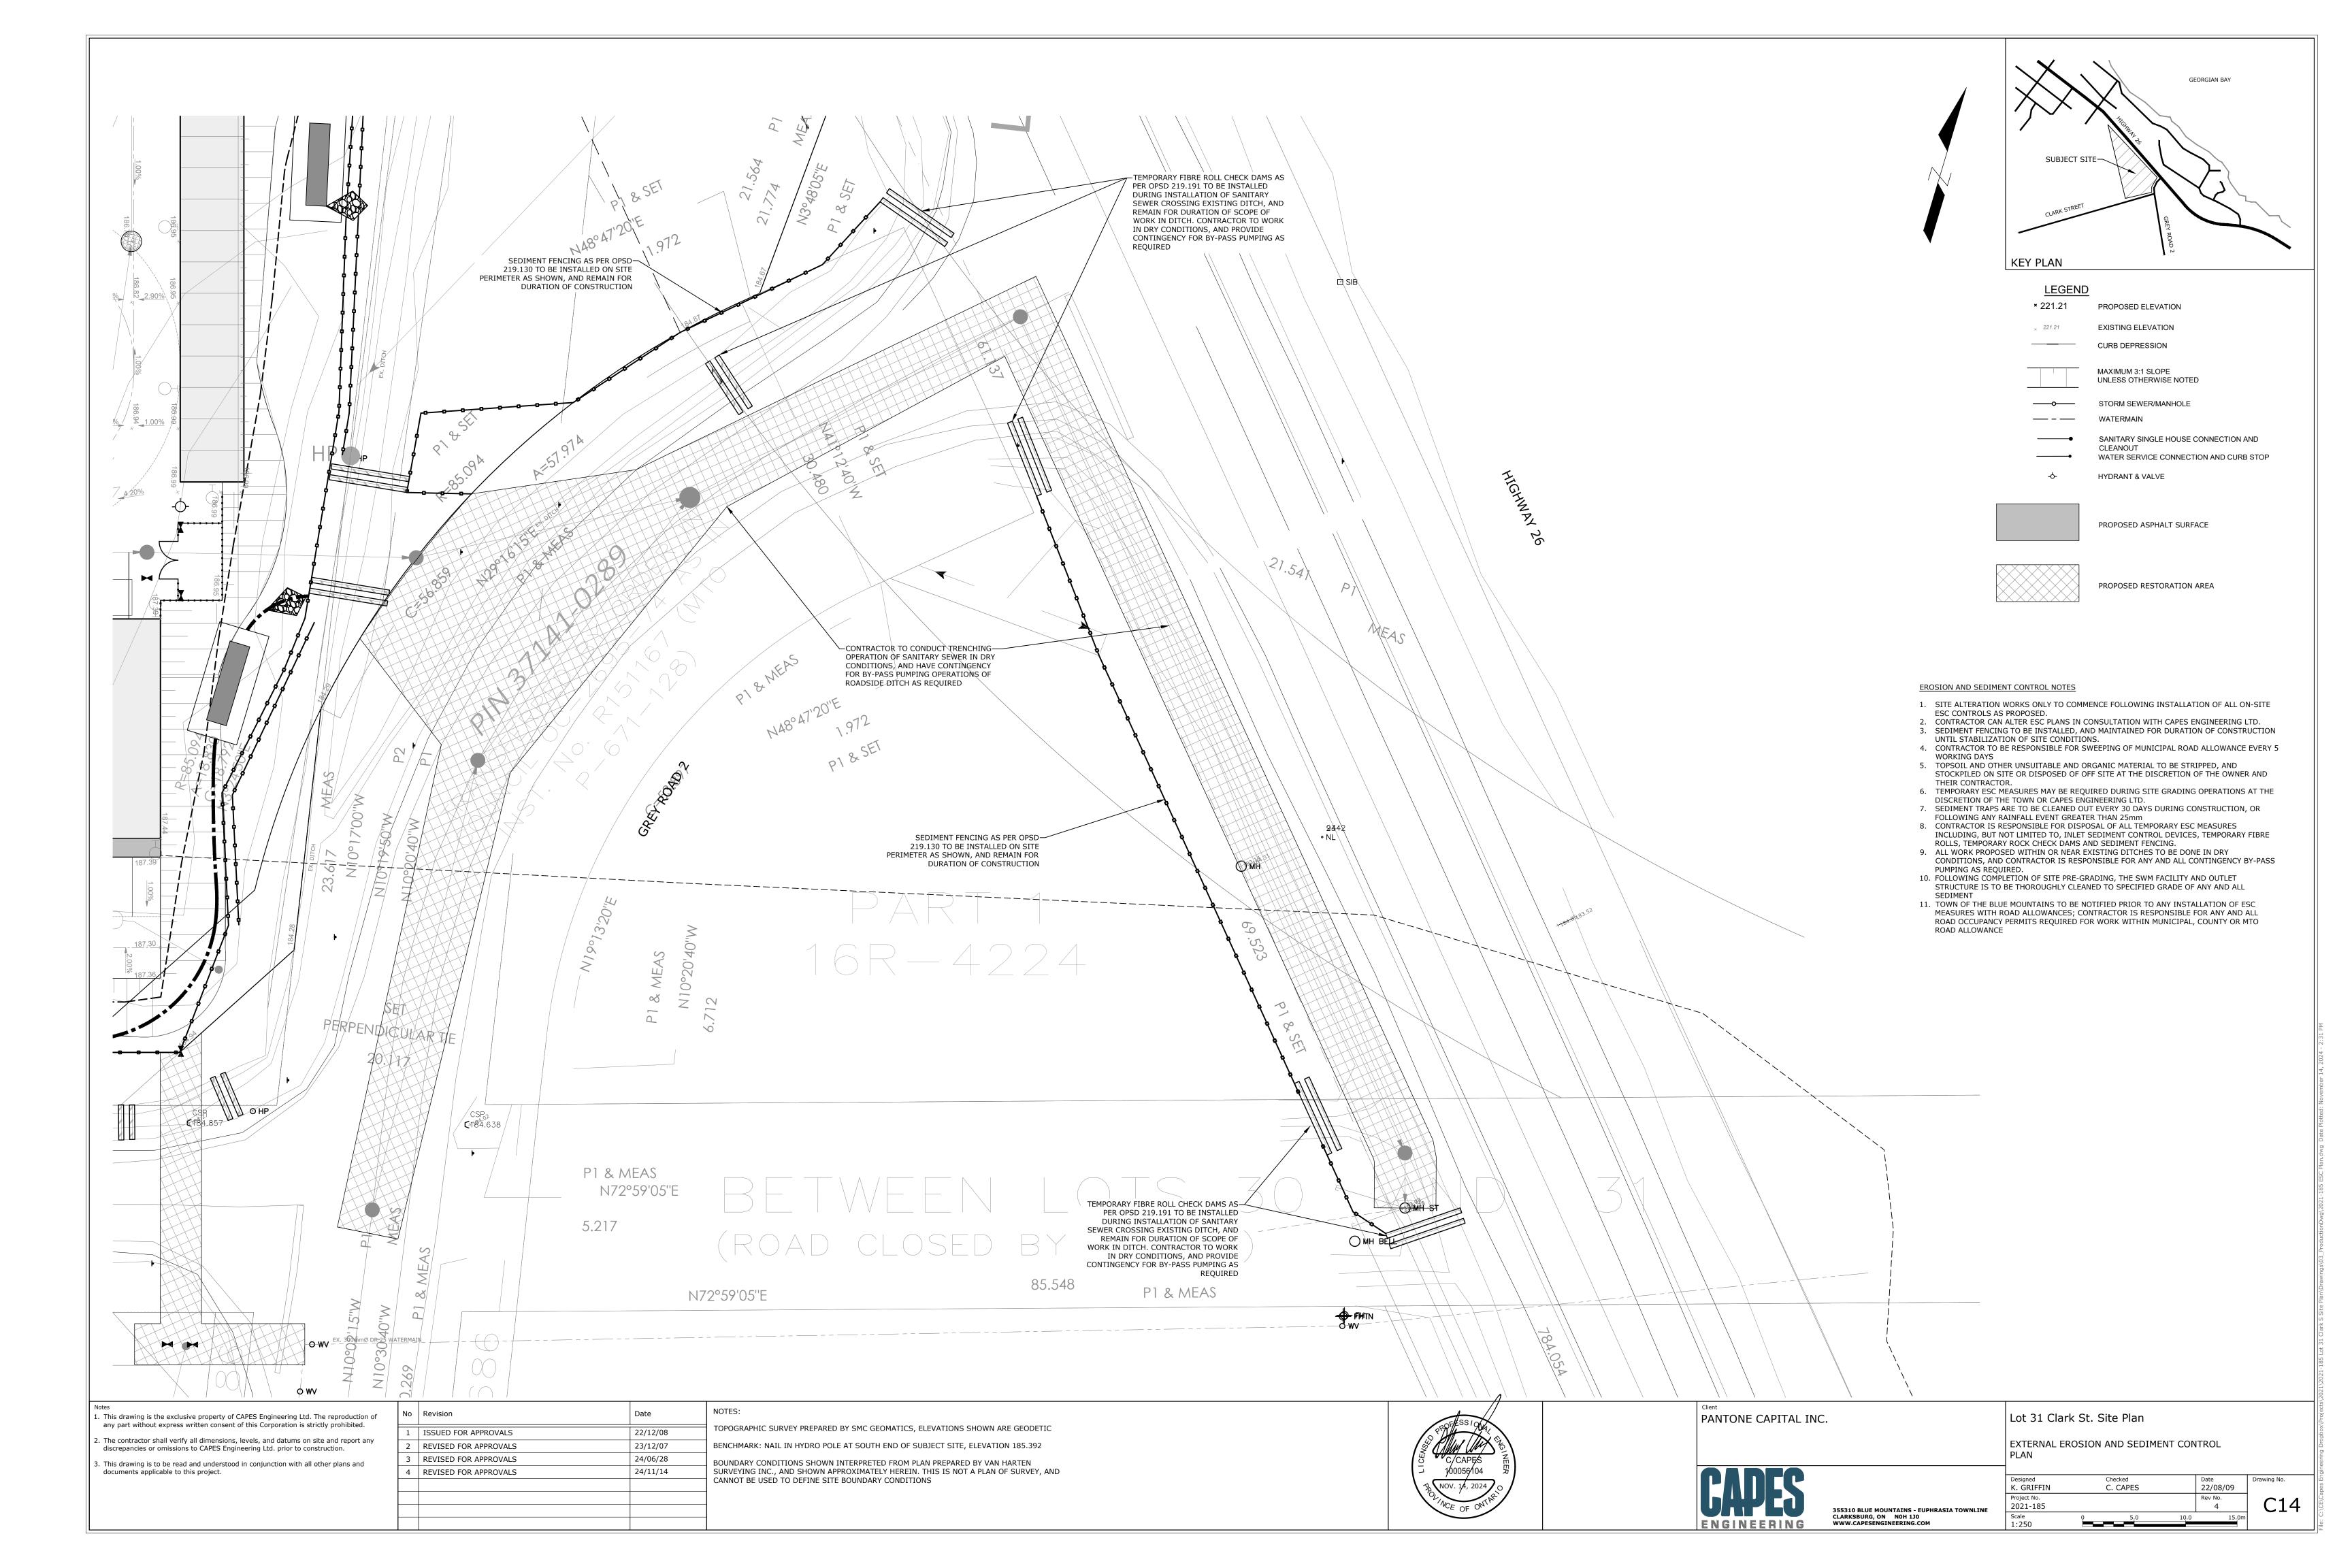


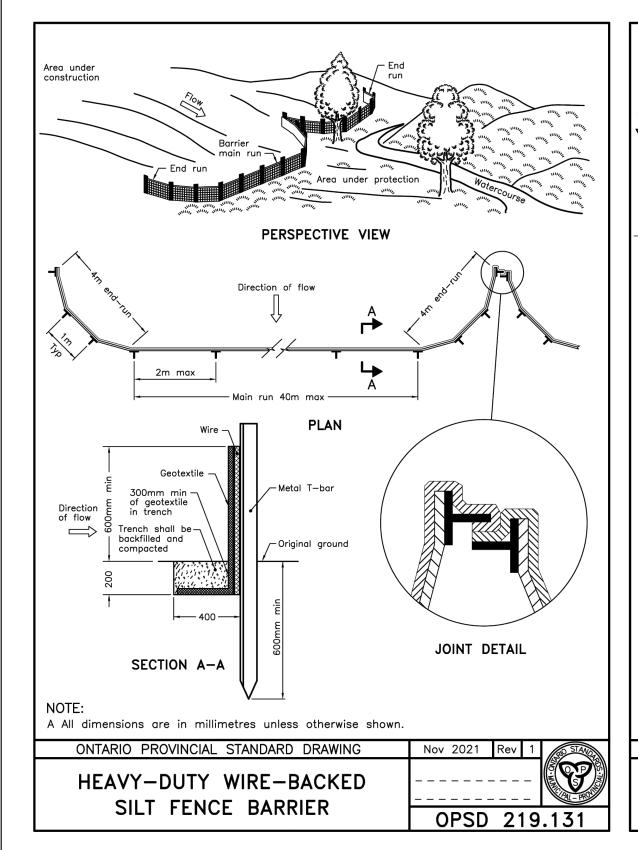


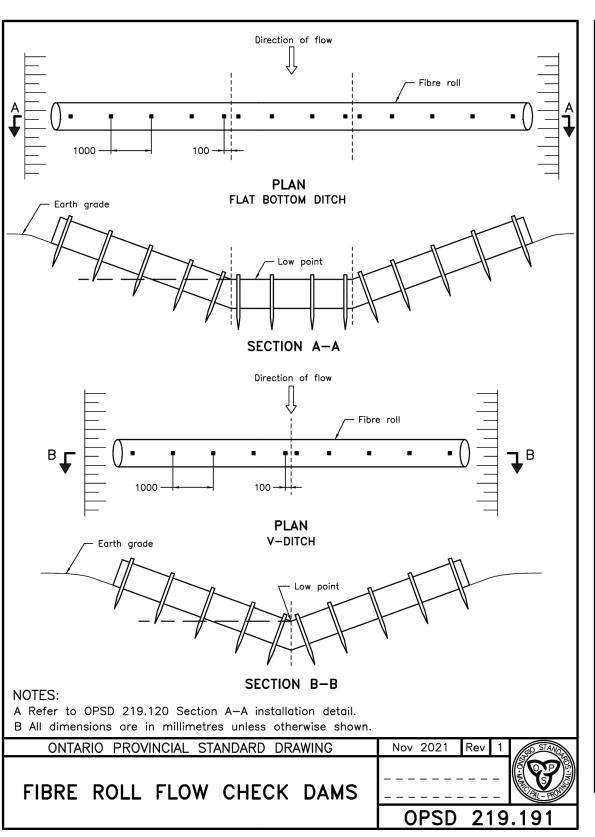


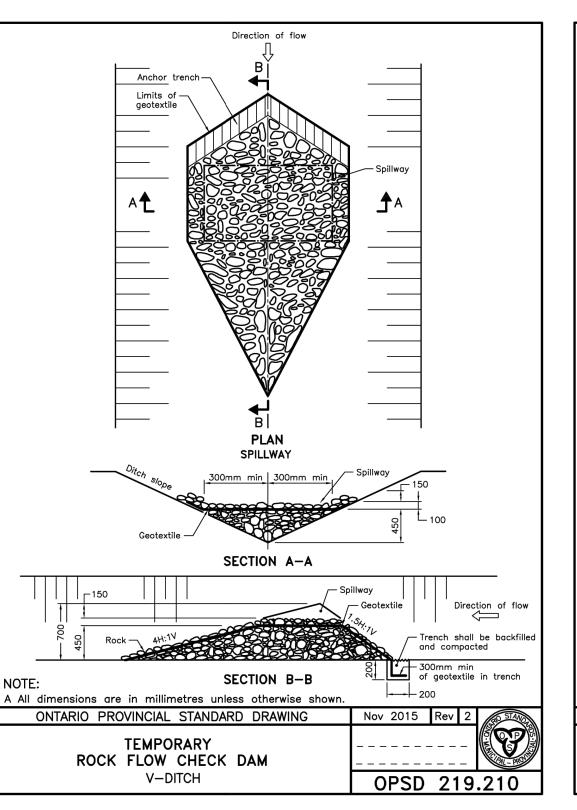


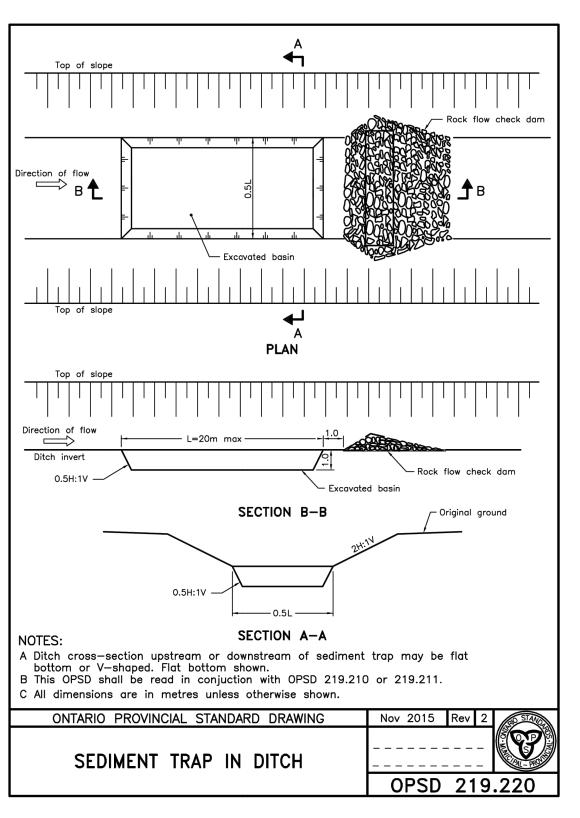


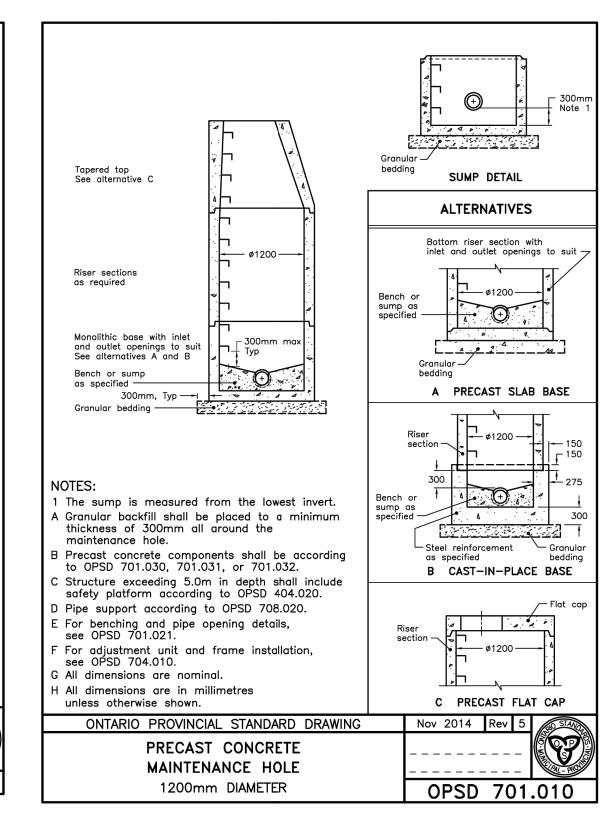

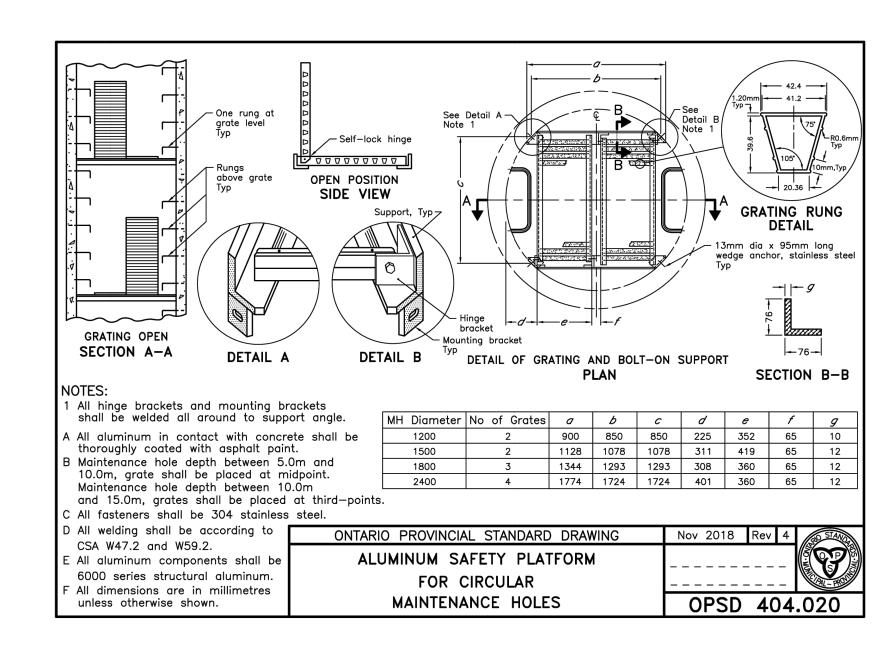

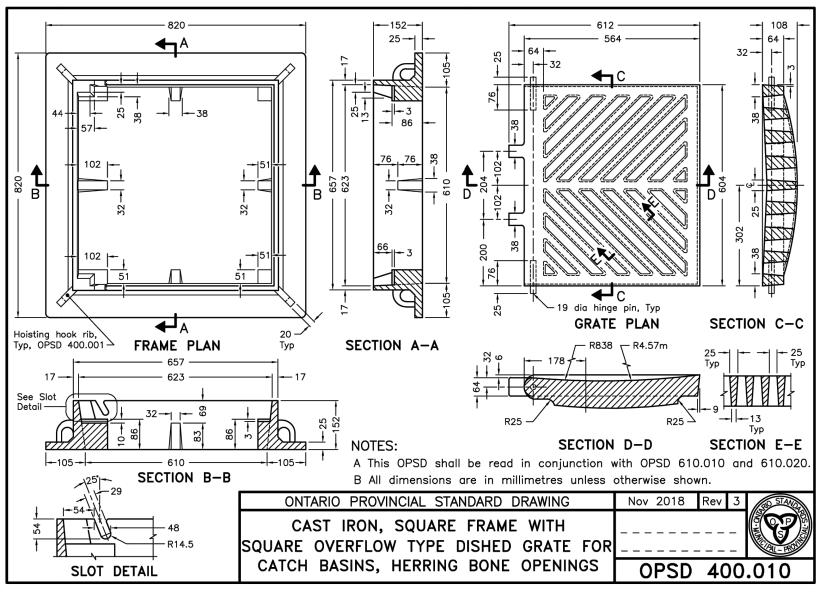

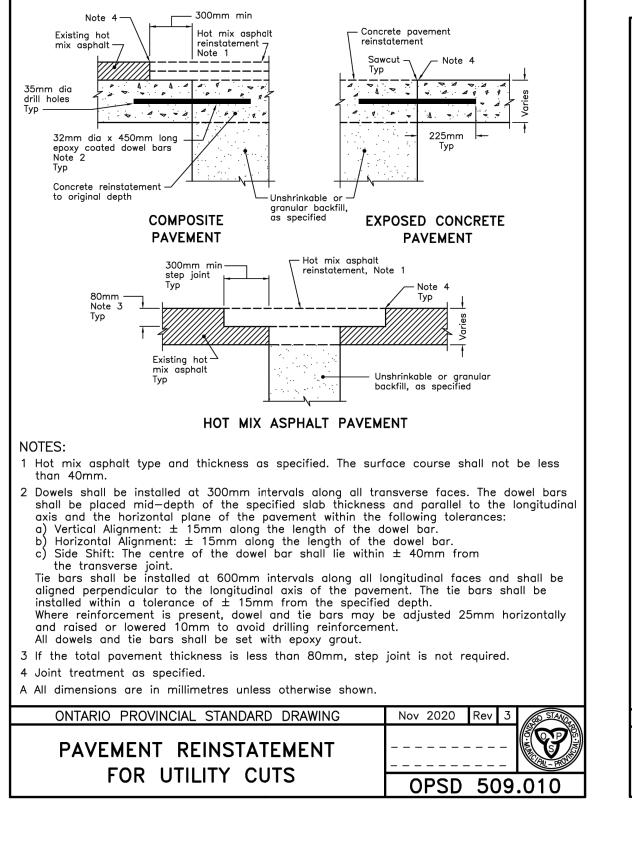

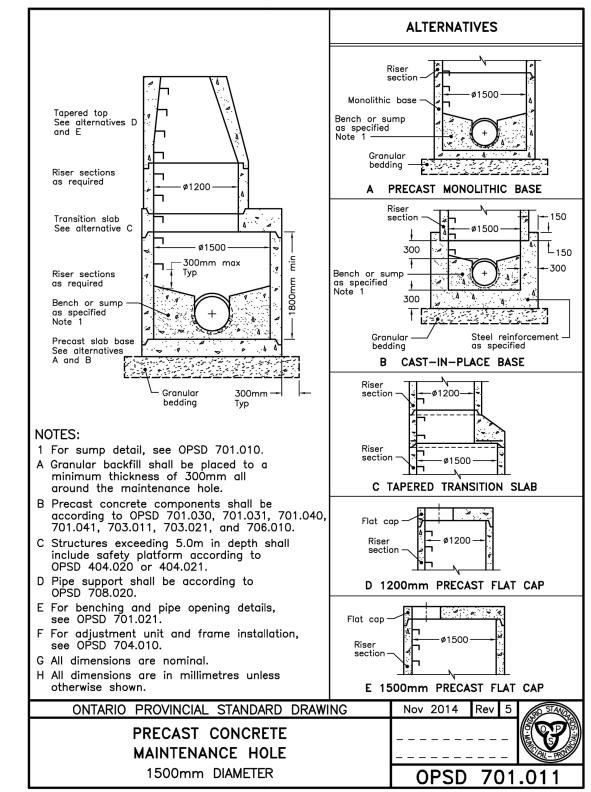

	Notes
1	 This drawing is the exclusive property of CAPES Engineering Ltd. The reproduction of any part without express written consent of this Corporation is strictly prohibited.
2	2. The contractor shall verify all dimensions, levels, and datums on site and report any

2. The contractor shall varify all discouring levels and detune as site and second and	- '	10002
The contractor shall verify all dimensions, levels, and datums on site and report any discrepancies or omissions to CAPES Engineering Ltd. prior to construction.	2	REVISE
3. This drawing is to be read and understood in conjunction with all other plans and	3	REVISE
documents applicable to this project.	4	REVISE


No	Revision	Date
1	ISSUED FOR APPROVALS	22/12/08
2	REVISED FOR APPROVALS	23/12/07
3	REVISED FOR APPROVALS	24/06/28
4	REVISED FOR APPROVALS	24/11/14

NOTES:

TOPOGRAPHIC SURVEY PREPARED BY SMC GEOMATICS, ELEVATIONS SHOWN ARE GEODETIC

BENCHMARK: NAIL IN HYDRO POLE AT SOUTH END OF SUBJECT SITE, ELEVATION 185.392


BOUNDARY CONDITIONS SHOWN INTERPRETED FROM PLAN PREPARED BY VAN HARTEN SURVEYING INC., AND SHOWN APPROXIMATELY HEREIN. THIS IS NOT A PLAN OF SURVEY, AND CANNOT BE USED TO DEFINE SITE BOUNDARY CONDITIONS





Client	
PANTONE CAPITAL INC.	Lot 31 Clark St. Site Plan
	STANDARD DETAILS





Designed	Checked	Date	Drawing No.
K. GRIFFIN	C. CAPES	22/08/09	
Project No.		Rev No.	│ ╭ ₄┍
2021-185		4	J C15
Scale]
AS NOTED			

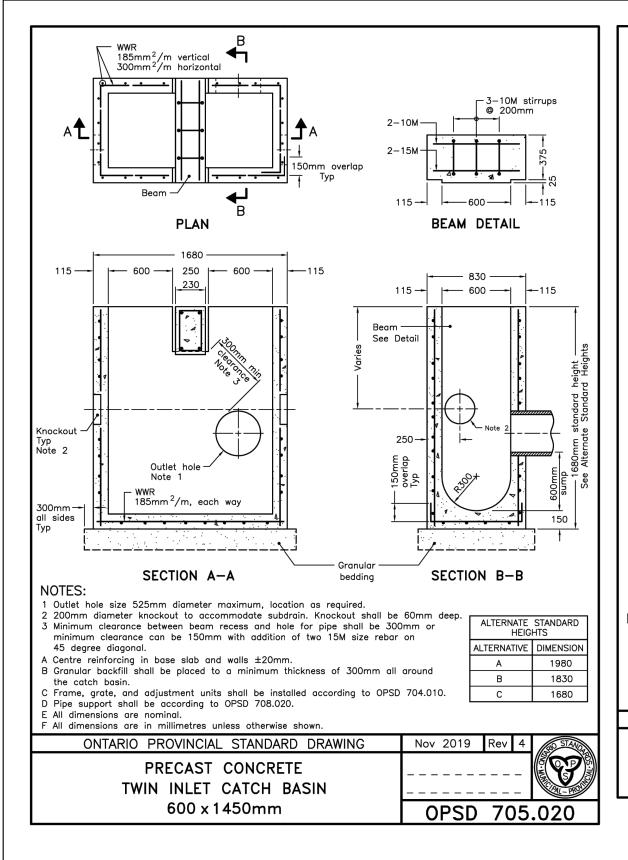


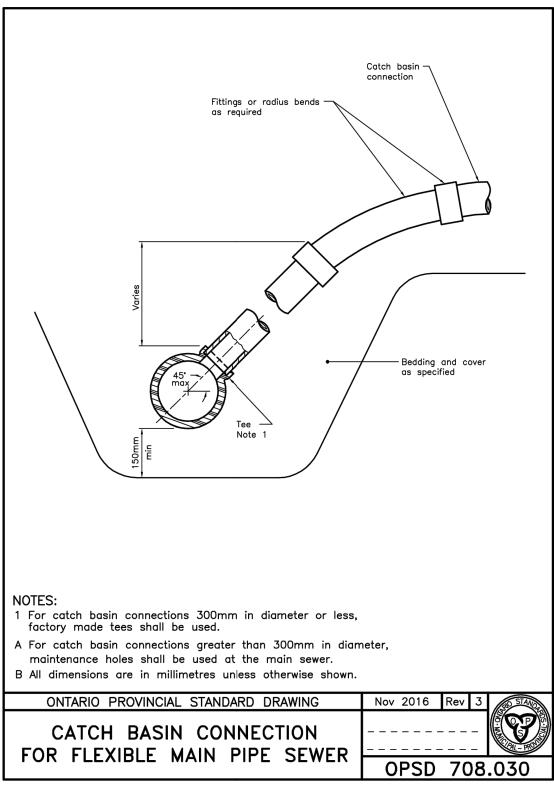

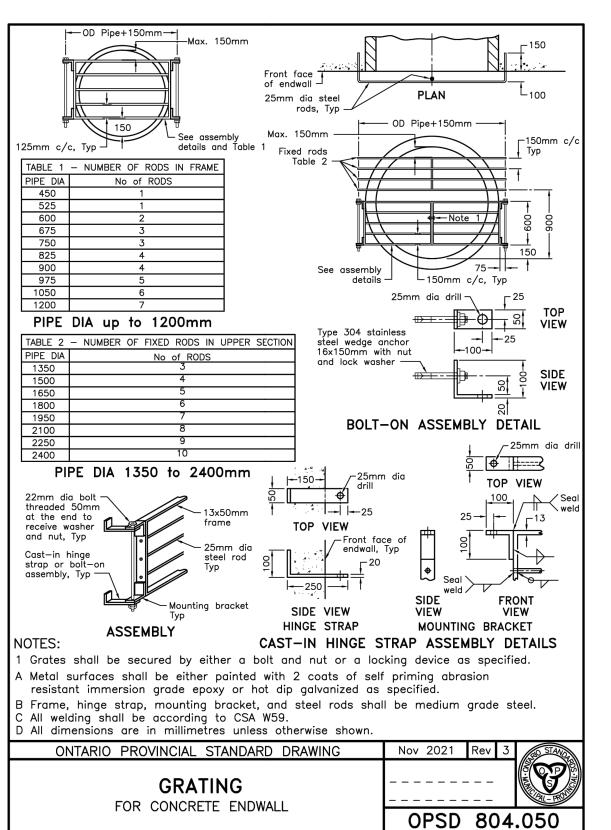

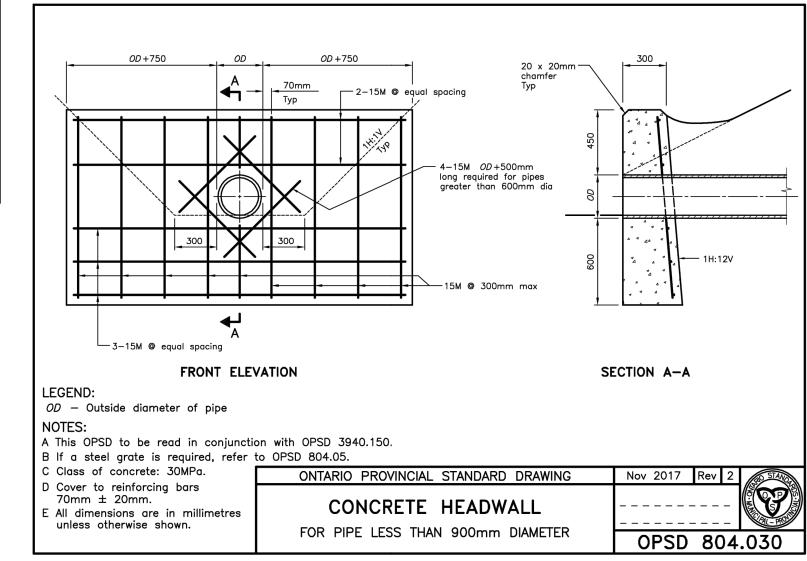

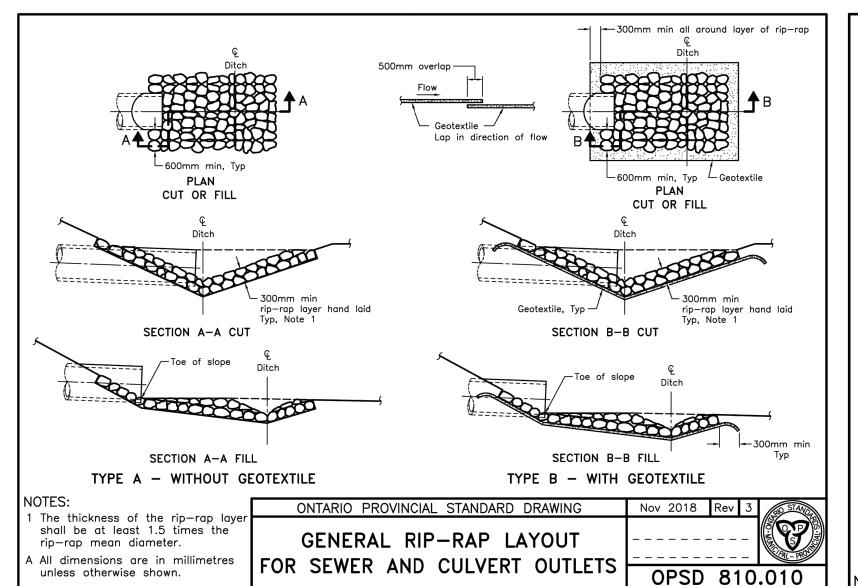

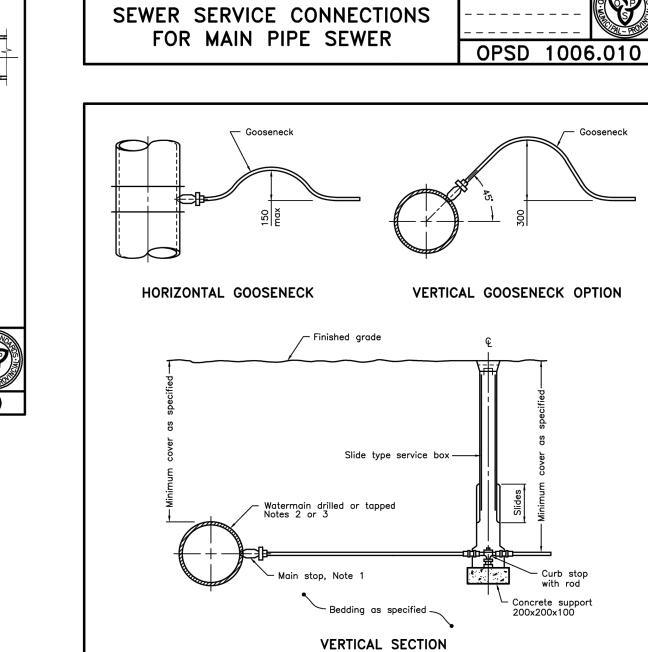

1.2m long gooseneck.

factory made tees.

option shall be used.

2 Direct tap ductile iron pipe with approved

3 Service connections to plastic watermains

shall be made using service saddles or

ONTARIO PROVINCIAL STANDARD DRAWING WATER SERVICE CONNECTION

19 and 25mm DIAMETER SIZES

tool with standard AWWA inlet thread.

A When specified, the vertical gooseneck

Fittings or radius bends —

as required

as required

as specified

Bedding and cover

Vertical risers shall be as specified.

before that pipe is laid.

service connections greater than 200mm.

Slope 1% min ─

as specified

Slope 1% min —

CONNECTION WITHOUT VERTICAL RISER

– Backfill — 2% desirable

CONNECTION WITH VERTICAL RISER

Sewer service connections to the main pipe sewer shall be made

Maintenance holes shall be used at the main sewer to connect

Approved cut—in tool shall be used for field made connections.

3 For new construction, saddles shall be installed on the main pipe

Cap or plug at property line shall be adequately braced.

O All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING

using factory made tees, strap—on—saddles, or other approved saddles.

as specified

100 to 150mm dia as specified Watertight cap or plug —


as specified, Note 3


100mm min-


100 to 150mm dia

Watertight cap or plug —

as specified, Note 3

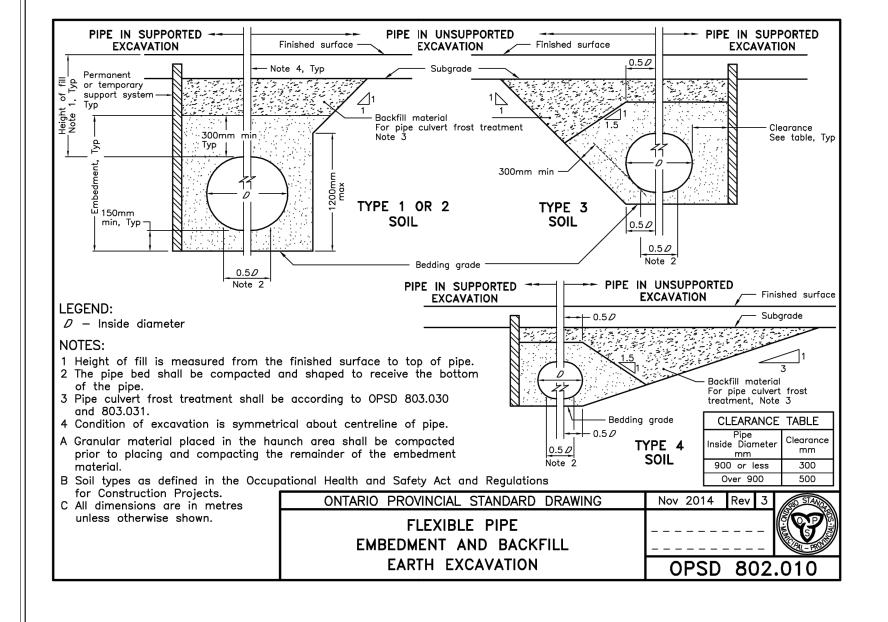

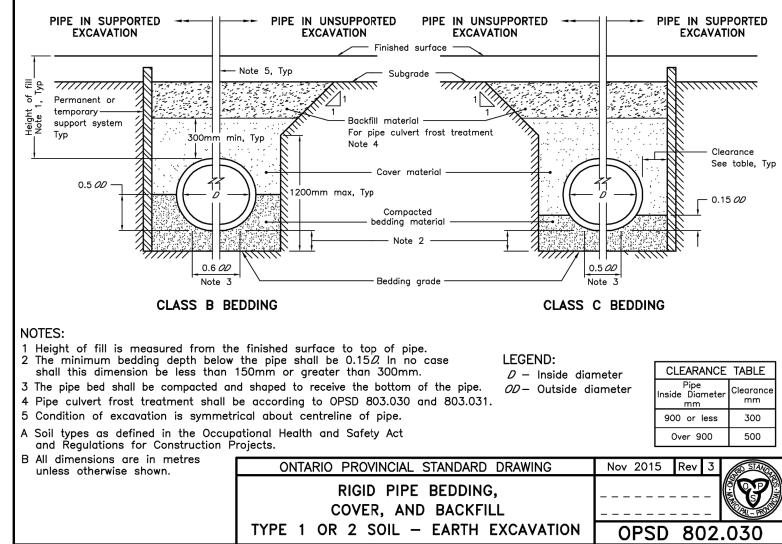




discrepancies of offissions to CAI ES Engineering Eta. prior to construction.
This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.

f	No	Revision	Date
	1	ISSUED FOR APPROVALS	22/12/08
	2	REVISED FOR APPROVALS	23/12/07
	3	REVISED FOR APPROVALS	24/06/28
	4	REVISED FOR APPROVALS	24/11/14

NOTES: TOPOGRAPHIC SURVEY PREPARED BY SMC GEOMATICS, ELEVATIONS SHOWN ARE GEODETIC BENCHMARK: NAIL IN HYDRO POLE AT SOUTH END OF SUBJECT SITE, ELEVATION 185.392 BOUNDARY CONDITIONS SHOWN INTERPRETED FROM PLAN PREPARED BY VAN HARTEN SURVEYING INC., AND SHOWN APPROXIMATELY HEREIN, THIS IS NOT A PLAN OF SURVEY, AND

CANNOT BE USED TO DEFINE SITE BOUNDARY CONDITIONS





Lot 31 Clark St. Site Plan STANDARD DETAILS

1 For plastic service pipes, install main stop at 15° above horizontal with a minimum

B Couplings shall not be permitted unless the service length exceeds 20m between

specified.

the service length exceeds 20m between

D Backfill material within 500mm of service

_ _ _ _ _ _

Nov 2018 Rev 4

OPSD 1104.010

box shall be native or imported, as

C All water services shall be installed 90° to the longitudinal axis of the watermain.

the main stop and curb stop.


E All dimensions are in millimetres

unless otherwise shown.



	Designed K. GRIF
355310 BLUE MOUNTAINS - EUPHRASIA TOWNLINE	Project No 2021-1
CLARKSBURG, ON NOH 1J0 WWW.CAPESENGINEERING.COM	Scale AS NOT

FFIN C. CAPES 22/08/09

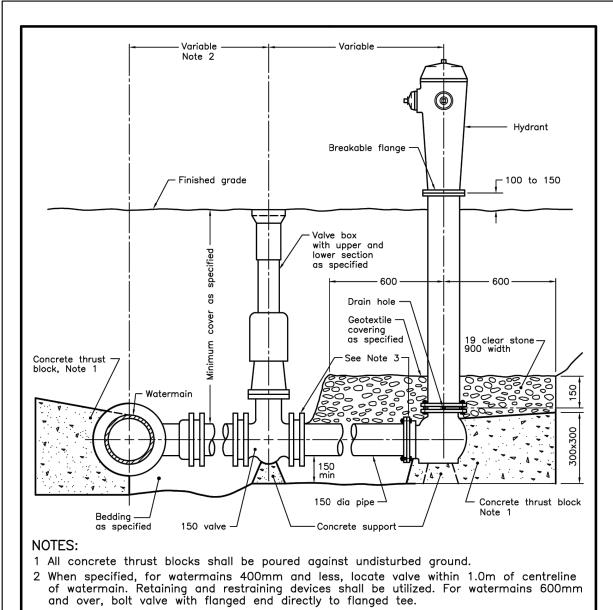

Retaining and restraining devices shall be as specified. A Bond breaker shall be used between the concrete and the fittings and


B Bolts and nuts for buried flange to flange connections shall be stainless steel. C When required, flange of standpipe extensions shall not be in frost zone. D This OPSD shall be read in conjunction with OPSD 1103.010 and 1103.020.

F Tracer wire shall be installed as specified. G All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING


HYDRANT INSTALLATION

E Backfill material within 500mm of service box shall be native or imported, as specified. Nov 2018 Rev 3 OPSD 1105.010

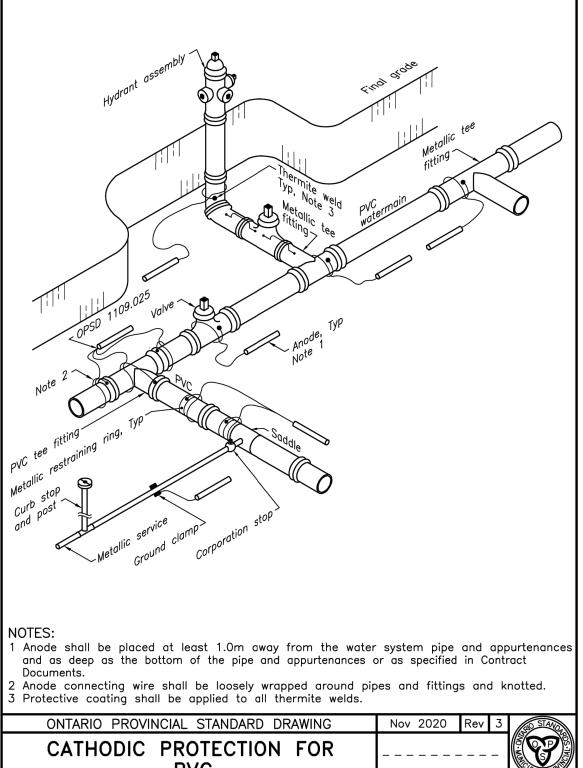



OPSD 1109.011


WATERMAIN SYSTEMS

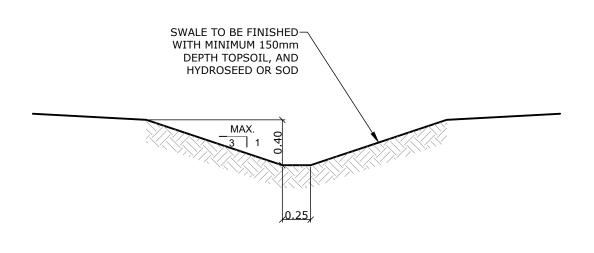


TYPICAL SWALE N.T.S.

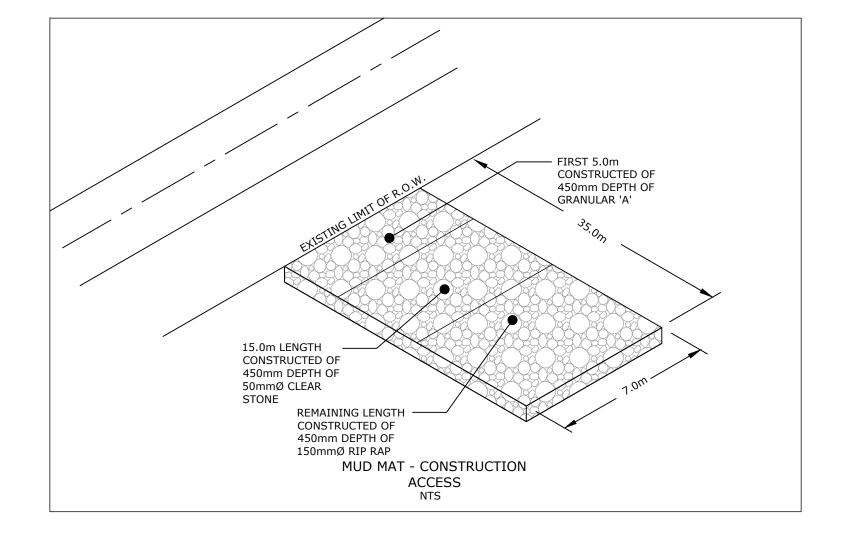


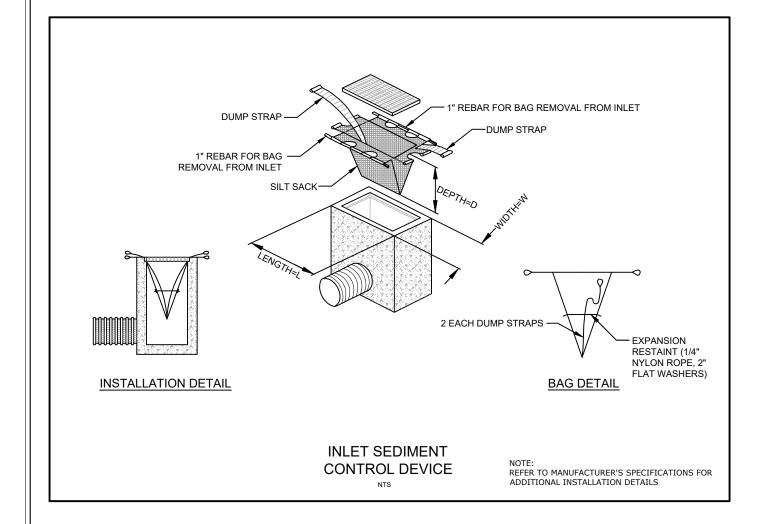


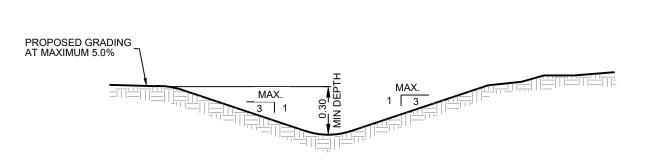

TEMPORARY INTERCEPTOR SWALE N.T.S.

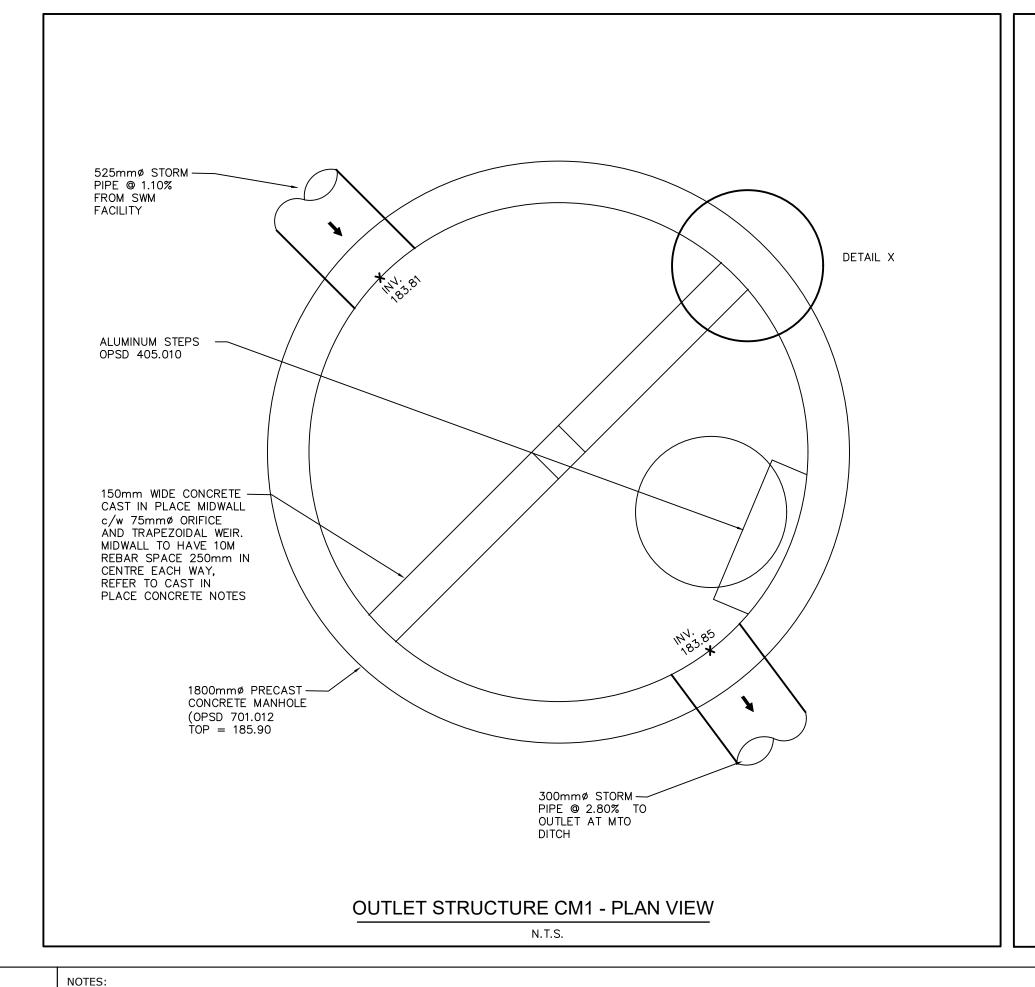

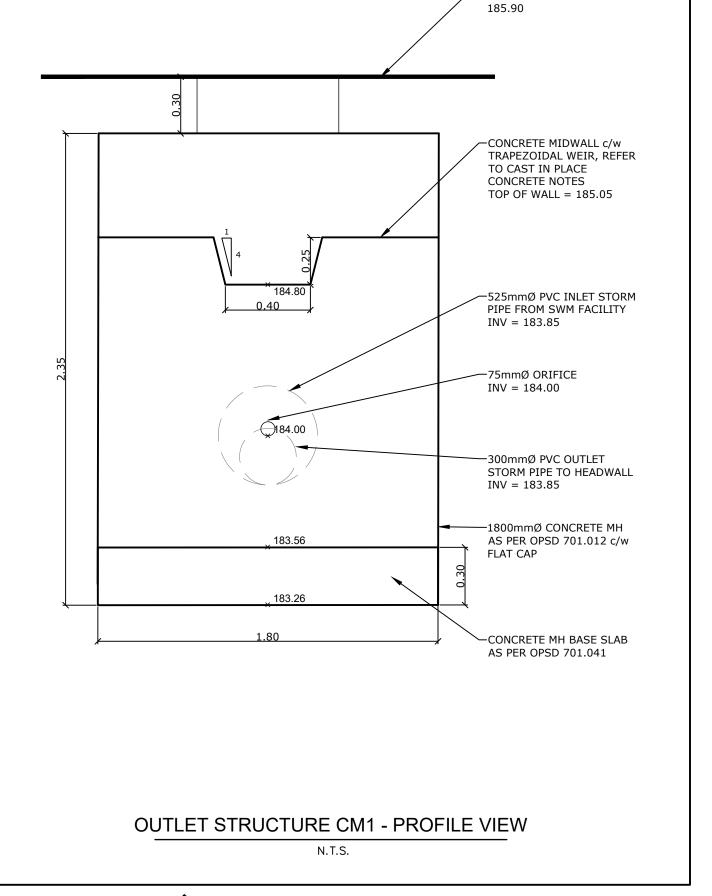

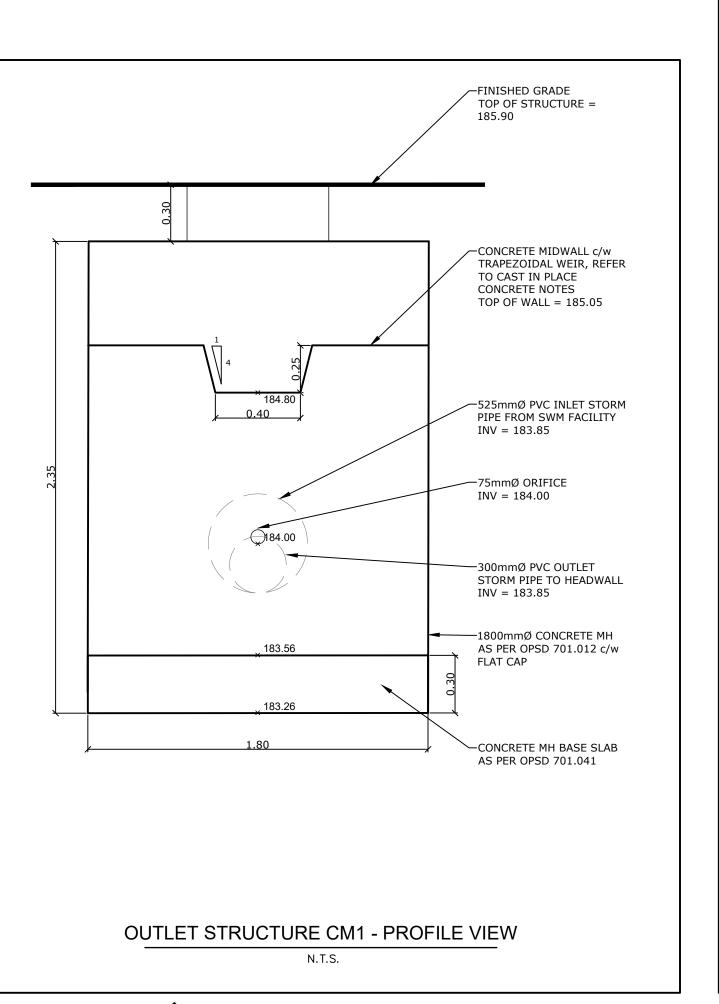

Notes					
1. This drawing is the exclusive property of CAPES Engineering Ltd. The reproduction of					
any part without express written consent of this Corporation is strictly prohibited.					


^{2.} The contractor shall verify all dimensions, levels, and datums on site and report any

discrepancies of offissions to CAI ES Engineering Eta. prior to construction.
This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.

No	Revision	Date
1	ISSUED FOR APPROVALS	22/12/08
2	REVISED FOR APPROVALS	23/12/07
3	REVISED FOR APPROVALS	24/06/28
4	REVISED FOR APPROVALS	24/11/14

TOPOGRAPHIC SURVEY PREPARED BY SMC GEOMATICS, ELEVATIONS SHOWN ARE GEODETIC BENCHMARK: NAIL IN HYDRO POLE AT SOUTH END OF SUBJECT SITE, ELEVATION 185.392 BOUNDARY CONDITIONS SHOWN INTERPRETED FROM PLAN PREPARED BY VAN HARTEN SURVEYING INC., AND SHOWN APPROXIMATELY HEREIN. THIS IS NOT A PLAN OF SURVEY, AND

CANNOT BE USED TO DEFINE SITE BOUNDARY CONDITIONS



Lot 31 Clark St. Site Plan PANTONE CAPITAL INC. STANDARD DETAILS

BASE SEE

OPSD 701.051

CAST IN PLACE CONCRETE NOTES:

FOR WORK OF OTHER SECTIONS.

GRADE 400R.

REINFORCING STEEL.

THAN 15 DEGREES CELSIUS.

15M HORIZONTAL

LAP SPLICE VERTICAL

CONTINUOUS WATERSTOP-

STEEL

BUTYL SEAL -IN PC JOINTS

TOLERANCÈS, AND FINISHING CONCRETE.

AGGREGATE TO BE 20mm DIAMETER. 1.3. AIR-ENTRAINING ADMIXTURE: TO ASTM C260.

GENERAL 1. CONFORM TO CSA — A23 SERIES OF STANDARDS, AND THE RSIC MANUAL OF STANDARD PRACTICE (LATEST EDITION) FOR DESIGN, MATERIALS, CONSTRUCTION, CURING, TESTING,

1.2. WATER, FINE AGGREGATES, COARSE AGGREGATES: TO CSA-A23.1. MAXIMUM COARSE

1.5. CURING-SEALING COMPOUND: WHEN WATER CURING IS NOT PRACTICAL AS APPROVED BY

1.6. HYDROPHILLIC TYPE WATERSTOP: HYDROTITE CJK - BY MME MULTIURETHANES (1 800 663 $|\hspace{-.1em}|$

1.7. REINFORCING STEEL: NEW, DEFORMED, BILLET-STEEL BARS TO CSA STANDARDS G30.18,

SUPPLY CONCRETE AS PER CSA A23.1-09, PERFORMANCE BASED SPECIFICATION CLEARLY COORDINATING MIX DESIGNATIONS WITH STRUCTURAL AND ARCHITECTURAL CRITERIA FOUND

WITHIN THE CONTRACT DOCUMENTS. FOR ALL CONCRETE MIXES CLEARLY IDENTIFY AND CONFIRM THE UNDERSTANDING OF THE CONCRETE REQUIREMENTS IN WRITING PRIOR TO

PRODUCTION FOR ALL MIXES. SUCH A SUBMISSION SHALL INCLUDE, AS A MINIMUM; THE

LOCATION OF EACH MIX DESIGN TO BE USED IN THE STRUCTURE, THE CEMENT TYPE, ALL

SUPPLEMENTARY MATERIALS, CLASS OF EXPOSURE, COMPRESSIVE STRENGTHS, AGGREGATE SIZE, AND CONCRETE DENSITY. USE READY-MIXED CONCRETE TO GIVE MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 35 MPa @ 28 DAYS, WITH EXPOSURE CLASS C1. COORDINATE WITH THE GENERAL CONTRACTOR WITH RESPECT TO WORKABILITY ISSUES, AND CONFIRM THE CRITERIA IN THE SUBMISSION (SLUMP, PUMP MIX, DESIGN CONCRETE TEMPERATURE, ETC.).

PROVIDE STEEL CHAIRS OR CONCRETE SPACERS TO MAINTAIN SPECIFIED 60mm COVER TO

AND COLD JOINTS, CHIPS AND SPALLS. PATCH DEFECTS AND TIE HOLES.

CONCRETE SHALL BE FREE FROM HONEYCOMBING, VOIDS, LOSS OF FINES, VISIBLE FLOW LINES

LAP ALL REINFORCING WITH CLASS B' SPLICES U/N. ALL STEEL MUST BE ADEQUATELY TIED AND ACCURATELY PLACED PRIOR TO THE COMMENCEMENT OF ANY CONCRETE POUR.

PROTECT FRESH CONCRETE FROM PREMATURE DRYING, SUNSHINE, EXCESSIVELY HOT OR COLD

TEMPERATURE FOR AS LONG AS REQUIRED FOR HYDRATION OF THE CEMENT AND CURING OF

THE CONCRETE. REFER TO CSA A23.1 FOR HOT AND COLD WEATHER CONCRETING PRACTICES.

PROTECT FRESH CONCRETE FROM COLD TEMPERATURES BELOW 5 DEGREES CELSIUS. PROVIDE

- CONTINUOUS HYDROPHILLIC TYPE WATERSTOP CLOSE TO MID-THICKNESS

10M DOWEL X 350 LONG HORIZONTAL

GROUT INTO MANHOLE USING HILTI

LAP WITH HORIZONTAL STEEL.

OF WALL

- 40mm EMBEDMENT

"ICE" EPOXY RESIN.

— 25mm CHAMFER TOP EDGE

___60mm MIN. CONCRETE COVER TO STEEL

OFFSET TO AVOID BASE REINFORCING

– ELEVATION

- WATERSTOP

- 75ø ORIFICE INV = 184.00SEE CIVIL

> - 90mm MIN. DOWEL EMBEDMEN1

PLANS

<u>10M X 50</u>0 DOWELS @

250 C/C VERTICAL GROUT WITH HILTI

"ICE" EPOXY RESIN

185.05

-10M @ 250 AT C/C EACH WAY

- FORM ORIFICE

-10M X 500 DOWELS

15M HORIZONTAL

@ TOP

TEMPORARY HEAT FOR A MINIMUM OF 3 DAYS TO MAINTAIN A TEMPERATURE OF GREATER

TEMPERATURES AND MECHANICAL INJURY. MAINTAIN AT A RELATIVELY CONSTANT

DETAIL X

SECTION Y

N.T.S.

N.T.S.

THE ENGINEER, USE A CLEAR LIQUID PRODUCT TO ASTM C-309, TYPE 1. USE SEALTIGHT

1.1. CEMENT GENERAL TYPE GU PORTLAND CEMENT TO CSA A3001.

1.4. CHEMICAL ADMIXTURES: TO ASTM C494 OR ASTM C1017.

VOCOMP20 BY W.R. MEADOWS OF CANADA LIMITED.

XECUTION
. USE VIBRATORS FOR CONSOLIDATION OF CONCRETE.


INSTALL, OR SUPPLY AND INSTALL, ANCHORAGE, FASTENINGS AND BLOCKING AS REQUIRED,




K. GRIFFIN C. CAPES 22/08/09 Project No. 2021-185 AS NOTED

SECTION Z-Z

N.T.S.

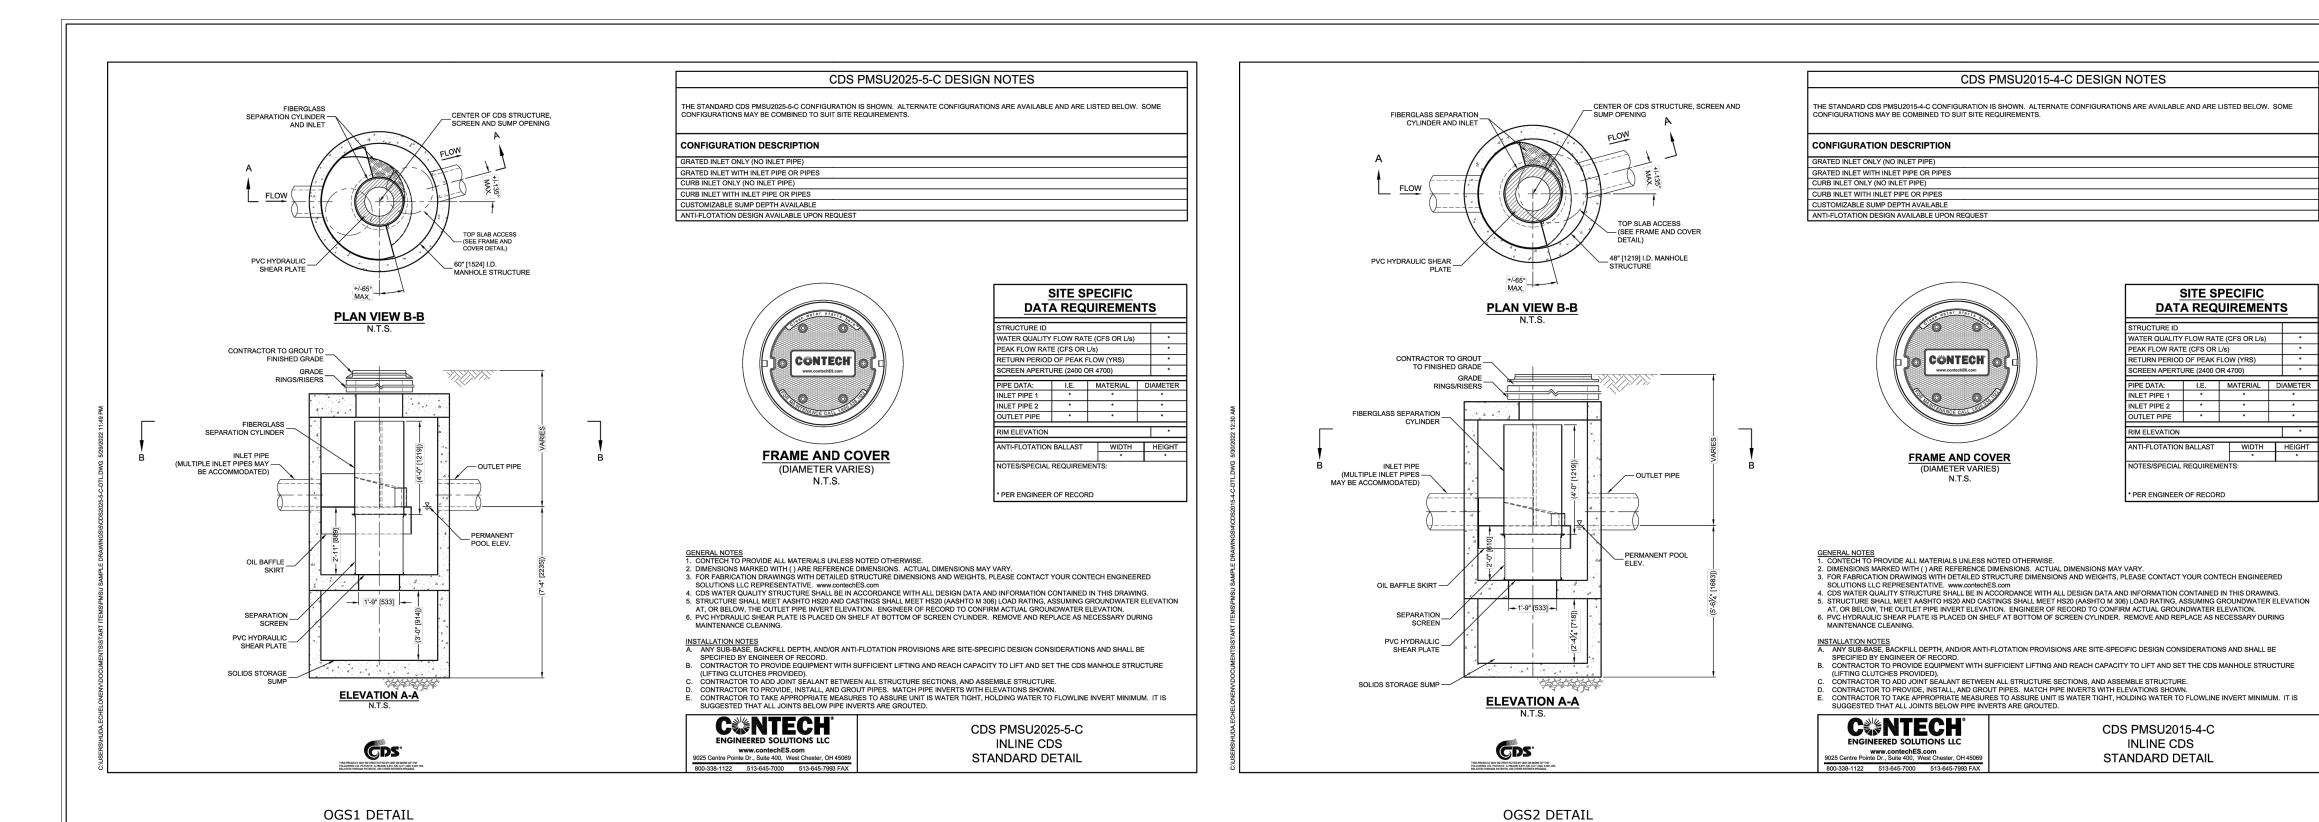

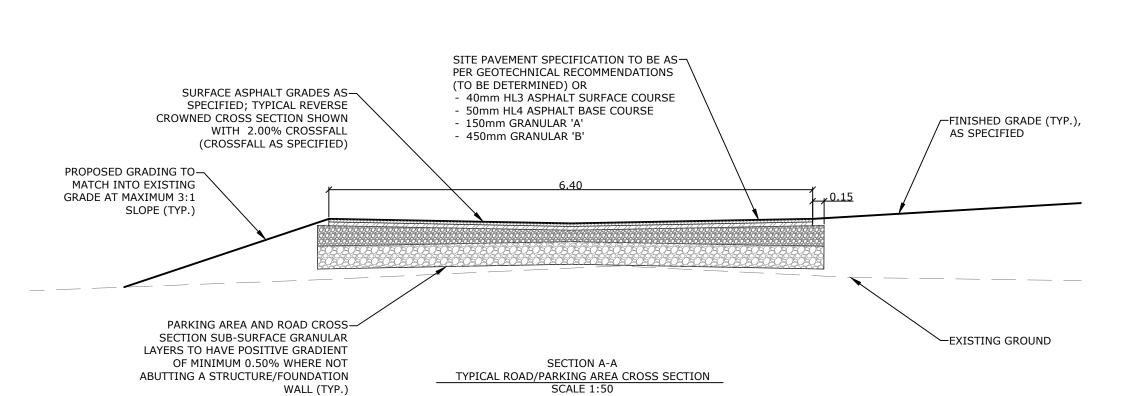


This drawing is the exclusive property of CAPES Engineering Ltd. The reproduction of any part without express written consent of this Corporation is strictly prohibited.
The contractor shall verify all dimensions, levels, and datums on site and report any discrepancies or omissions to CAPES Engineering Ltd. prior to construction.

	discrepancies of offissions to CAI ES Engineering Eta. prior to construction.
3.	. This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.

No	Revision	Date
1	ISSUED FOR APPROVALS	22/12/08
2	REVISED FOR APPROVALS	23/12/07
3	REVISED FOR APPROVALS	24/06/28
4	REVISED FOR APPROVALS	24/11/14

NOTES: TOPOGRAPHIC SURVEY PREPARED BY SMC GEOMATICS, ELEVATIONS SHOWN ARE GEODETIC BENCHMARK: NAIL IN HYDRO POLE AT SOUTH END OF SUBJECT SITE, ELEVATION 185.392 BOUNDARY CONDITIONS SHOWN INTERPRETED FROM PLAN PREPARED BY VAN HARTEN SURVEYING INC., AND SHOWN APPROXIMATELY HEREIN. THIS IS NOT A PLAN OF SURVEY, AND CANNOT BE USED TO DEFINE SITE BOUNDARY CONDITIONS



SITE SPECIFIC DATA REQUIREMENTS

RUCTURE ID
ATER QUALITY FLOW RATE (CFS OR L/s)

PEAK FLOW RATE (CFS OR L/s)

RETURN PERIOD OF PEAK FLOW (YRS)

**RETURN PERIOD OF PEAK FLOW (YRS)

 PIPE DATA:
 I.E.
 MATERIAL
 DIAMETER

 INLET PIPE 1
 *
 *
 *

 INLET PIPE 2
 *
 *
 *

 OUTLET PIPE
 *
 *
 *

ANTI-FLOTATION BALLAST WIDTH HEIGHT

NOTES/SPECIAL REQUIREMENTS:

CREEN APERTURE (2400 OR 4700)

PER ENGINEER OF RECORD

CDS PMSU2015-4-C

INLINE CDS

STANDARD DETAIL

Lot 31 Clark St. Site Plan STANDARD DETAILS



	Designed K. GRIFFIN
355310 BLUE MOUNTAINS - EUPHRASIA TOWNLINE CLARKSBURG, ON NOH 1JO WWW.CAPESENGINEERING.COM	Project No. 2021-185
	Scale AS NOTED

	Checked	Date	Drawing No.
IN	C. CAPES	22/08/09)
		Rev No.	\neg
5		4	
_			
D			